

# City of North Charleston Permitting Standards and Procedures Manual



Date: September 2008



# TABLE OF CONTENTS

## CHAPTER 1 – GENERAL

- 1.1 Purpose .....1-1**
- 1.2 Scope .....1-2**
- 1.3 Manual Organization.....1-2**
- 1.4 Authorization.....1-3**
  - 1.4.1 NPDES MS4 General Permit SCR300000 .....1-3**
  - 1.4.2 City of North Charleston Ordinances, Regulations and Standards 1-3**
- 1.5 Updates to the Design Manual .....1-4**
- 1.6 Stormwater Management.....1-4**
  - 1.6.1 Effects of Development on Watershed Hydrology .....1-4**
  - 1.6.2 Steps to Successful Stormwater Management Plans.....1-5**
  - 1.6.3 Innovative Design Approach .....1-6**
  - 1.6.4 Best Management Practices and Site Planning Process .....1-6**
    - 1.6.4.1 Maintaining Site Resources and Natural Undisturbed Areas..... 1-7**
    - 1.6.4.2 Lower Impact Site Layout Techniques ..... 1-7**
    - 1.6.4.3 Minimization of Impervious Cover..... 1-8**
    - 1.6.4.4 Utilization of Natural Features for Stormwater Management ..... 1-8**
    - 1.6.4.5 Engineered/Proprietary Devices ..... 1-8**
- 1.7 Engineering Design Accountability .....1-9**
- 1.8 Legal Aspects.....1-9**
- 1.9 Contact Information .....1-10**
- 1.10 Definitions.....1-10**



## CHAPTER 2 – STORMWATER PERMITTING PROCEDURES

<b>2.1</b>	<b>Duty to Comply .....</b>	<b>2-1</b>
<b>2.2</b>	<b>Stormwater Permit Application and Approval Procedures.....</b>	<b>2-1</b>
<b>2.2.1</b>	<b>Final Approval .....</b>	<b>2-2</b>
<b>2.2.2</b>	<b>Site Construction and Project Closeout .....</b>	<b>2-3</b>
<b>2.2.2.1</b>	<b>Permit Transfer .....</b>	<b>2-3</b>
<b>2.2.2.2</b>	<b>Project Closeout.....</b>	<b>2-4</b>
<b>2.2.3</b>	<b>Exemptions .....</b>	<b>2-5</b>
<b>2.2.4</b>	<b>Expiration of Permit.....</b>	<b>2-5</b>
<b>2.2.5</b>	<b>Responsibility of Owner/Operator.....</b>	<b>2-6</b>
<b>2.2.6</b>	<b>Waivers .....</b>	<b>2-6</b>
<b>2.2.7</b>	<b>Non-Floodplain Variances .....</b>	<b>2-6</b>
<b>2.2.8</b>	<b>Encroachment Permits.....</b>	<b>2-7</b>
<b>2.2.9</b>	<b>Easements .....</b>	<b>2-7</b>
<b>2.2.9.1</b>	<b>Storm Drain Pipe.....</b>	<b>2-7</b>
<b>2.2.9.2</b>	<b>Ditches/Canals .....</b>	<b>2-8</b>
<b>2.2.9.3</b>	<b>Detention Ponds .....</b>	<b>2-8</b>
<b>2.2.9.4</b>	<b>Other Stormwater Facilities and BMPs .....</b>	<b>2-8</b>
<b>2.2.9.5</b>	<b>Offsite Easements .....</b>	<b>2-8</b>
<b>2.2.10</b>	<b>Stormwater Facility Ownership and Maintenance .....</b>	<b>2-9</b>
<b>2.2.10.1</b>	<b>Ownership .....</b>	<b>2-9</b>



2.2.10.2 Maintenance..... 2-9

2.2.11 Single Family Residential (SFR) Applications.....2-9

2.2.12 Type I – Minor Applications ..... 2-10

2.2.13 Type II – Small/Intermediate Applications ..... 2-10

2.2.14 Type III – Medium/Large Applications ..... 2-16

2.3.14.1 Pre-Submittal Meeting.....2-16

2.3.14.2 Stormwater Master Plan.....2-17

2.2.15 Utility Applications..... 2-17

## CHAPTER 3 - DESIGN REQUIREMENTS

3.1 General Design Standards.....3-1

3.2 Hydrologic Computation Methods .....3-5

3.2.1 Inputs .....3-5

3.2.2 Stormwater Management Design Methodologies.....3-6

3.2.3 Hydrographs .....3-7

3.3 Water Quantity Control Standards.....3-7

3.3.1 General Water Quantity Criteria .....3-7

3.3.2 Detention Ponds/Reservoirs.....3-8

3.3.3 Underground Detention Devices .....3-8

3.3.4 Infiltration Devices .....3-9

3.3.5 Water Quantity Design/Construction References..... 3-11



**3.3.6 Accepted Water Quantity Controls.....3-11**

**3.3.7 Standard Water Quantity Design Procedures..... 3-12**

**3.4 Water Quality Control Standards .....3-14**

**3.4.1 Characterization of Urban Stormwater Runoff Quality ..... 3-14**

**3.4.1.1 Suspended Solids.....3-16**

**3.4.1.2 Oxygen Demanding Matter and Bacteria.....3-16**

**3.4.1.3 Nutrients .....3-17**

**3.4.2 Accepted Water Quality BMPs ..... 3-17**

**3.4.3 Water Quality Design Standards ..... 3-21**

**3.4.3.1 General Standards .....3-21**

**3.4.3.2 Typical Water Quality Design Procedures.....3-22**

**3.5 Erosion Prevention and Sediment Control Standards.....3-25**

**3.5.1 Accepted EPSC BMPs..... 3-25**

**3.5.1.1 Erosion Prevention Measures .....3-25**

**3.5.1.2 Temporary Sediment Control Measures .....3-26**

**3.5.1.3 Runoff Control and Conveyance Measures.....3-27**

**3.5.1.4 Temporary Vegetation/Seeding .....3-28**

**3.5.1.5 Permanent Vegetation/Seeding.....3-30**

**3.5.2 EPSC Design requirements ..... 3-34**

**3.5.2.1 General Standards .....3-34**



3.5.2.2 Typical EPSC Design Procedures.....3-38

3.6 Stormwater Drainage System Design Standards .....3-38

3.7 Open Channel Hydraulics .....3-44

3.8 Special Protection Areas.....3-46

3.8.1 Water Quantity Issues..... 3-47

3.8.2 Water Quality Issues ..... 3-47

## CHAPTER 4 – INSPECTIONS AND ENFORCEMENT

4.1 Stormwater Management Inspections.....4-1

4.1.1 Inspector Duties/Responsibilities .....4-1

4.1.2 Inspection Process and Procedures.....4-2

4.2 Permittee Inspection Responsibilities.....4-3

4.3 Enforcement .....4-3

4.3.1 Correction Orders .....4-3

4.3.2 Notices of Violation (NOV) .....4-4

4.3.3 Stop Work Order.....4-4

4.3.4 Civil Penalties.....4-5

4.3.5 Criminal Penalties .....4-5

## CHAPTER 5 – REFERENCES

## APPENDIX A – APPLICATION FORMS

## APPENDIX B – OPERATING PERMIT FOR MAINTENANCE



**APPENDIX C – PERMITTING PROCESS FLOWCHART**

**APPENDIX D – TABLES OF BMP SUGGESTED USES**

**APPENDIX E – PLAN REVIEW CHECKLIST**

**APPENDIX F – INSPECTION CHECKLIST**

**APPENDIX G – ENFORCEMENT FORMS**

**APPENDIX H– TRANSFER OF OWNERSHIP APPLICATION**

**APPENDIX I – BMP DETAILS**

**LIST OF TABLES**

Table 2.1: Storm Drain Pipe Easements ..... 2-7

Table 3.1: Design Storm Precipitation Data (in Inches) for North Charleston, S. C..... 3-5

Table 3.2: Recommended Methodologies Based on Land Disturbance Area ..... 3-6

Table 3.3: Recommended Hydrologic Methods for Designing Various Stormwater Management Systems and Controls ..... 3-7

Table 3.4: Accepted Water Quantity Controls ..... 3-12

Table 3.5: Typical Stormwater Pollutants and Sources..... 3-15

Table 3.6: Average Pollutant Concentrations for Various Land Uses (mg/l)..... 3-18

Table 3.7: Accepted Water Quality Controls..... 3-19

Table 3.8: Limited Structural Controls..... 3-20

Table 3.9: Erosion Prevention BMP Suggested Uses..... 3-26

Table 3.10: Temporary Sediment Control BMP Suggested Uses ..... 3-27

Table 3.11: Runoff Control and Conveyance Measure BMP Suggested Uses..... 3-27

Table 3.12: Temporary Vegetation Schedule ..... 3-30

Table 3.13: Temporary Vegetation Schedule for Steep Slopes/Cut Slopes ..... 3-30

Table 3.14: Permanent Vegetation Schedule..... 3-33

Table 3.15: Permanent Vegetation Schedule for Steep Slopes/Cut Slopes ..... 3-33

Table 3.16: Maximum Permissible Velocities for Vegetated Channels..... 3-46



# CHAPTER 1 – GENERAL INFORMATION

## 1.1 Purpose

It is the purpose of this Manual and the Stormwater Management Ordinance to protect, maintain, and enhance water quality and the environment of the City of North Charleston and the short-term and long-term public health, safety, and general welfare of the citizens of the City of North Charleston. This Manual and the Stormwater Management Ordinance is also designed to minimize property damage by establishing requirements and procedures to control the potential adverse effects of increased stormwater runoff and related pollutant loads associated with both future development and existing developed land. Proper management of stormwater runoff will further the purpose of this Manual and the Stormwater Management Ordinance to ensure a functional drainage system, reduce the effects of development on land and stream channel erosion, attain and maintain water quality standards, enhance the local environment associated with the drainage system, reduce local flooding, maintain where necessary pre-developed runoff characteristics of the area in terms of flow rate, volume and pollutant concentration, and facilitate economic development while mitigating associated pollutant, flooding, erosion, and drainage impacts.

This Manual is for stormwater management purposes only, and the requirements herein are specific to the City's stormwater management program and do not preclude the Planning, Zoning and Building Departments from performing their permit, plan review, inspection or other related duties and collecting applicable fees.

This Manual describes the policies and procedures used by the Public Works Director to implement the Stormwater Management Ordinance and the City's Stormwater Management Program (SWMP). These standards and procedures will:

1. Clearly describe the construction activity application requirements and approval process as it relates to stormwater management;
2. Convey the technical design standards to the engineering community, to include standards which address flow rates, runoff volume, and pollutant load/concentration, as well as specific standards during construction and for long-term performance;
3. Provide general information on approaches to improve water quality, prevent illicit discharges, and minimize stormwater runoff impacts due to development and re-development;
4. Convey other protection provisions related to stormwater discharges such as wetlands and watercourse conservation.

Every effort has been made throughout this Manual to cover the common conditions and information needed by those involved in construction activities, however, these design standards and the City Ordinances should be reviewed carefully to ensure that all requirements are being met. Developments may also be impacted by state and federal requirements to include, but not be limited to, the NPDES Phase II Construction General Permit (CGP) for Stormwater



Discharges from Large and Small Construction Activities. Those projects not subject to NPDES requirements must still comply with applicable City standards.

## 1.2 Scope

The scope of this Manual is limited to the requirements related to stormwater management as reviewed and approved by the City of North Charleston's Public Works Director. This Manual is not intended as a textbook or a comprehensive engineering design reference. It was instead developed under the assumption that the user possesses a basic understanding of stormwater control design, construction, or land development depending on the user's particular area of expertise. References to guidance documents from federal, state, and local agencies, as well as commercial products are given throughout this Manual to provide additional information to users. Two common examples are the Natural Resources Conservation Service's (NRCS) TR-55 and SCDHEC's Best Management Practices (BMP) Manual. A copy of SCDHEC's Best Management Practices may be found at [http://www.scdhec.gov/environment/ocrm/pubs/tech\\_docs\\_water.htm](http://www.scdhec.gov/environment/ocrm/pubs/tech_docs_water.htm).

The design standards are not intended to restrain or inhibit engineering creativity, freedom of design, or the need for engineering judgment. When shown to be applicable, it is encouraged that new methods, techniques, and innovative stormwater BMPs be submitted with supporting documentation. However, the use of such approaches should be substantiated with submitted documentation by design professionals showing that the proposed design is equal to, or exceeds the traditional procedures in terms of performance and economic feasibility.

On projects that require site specific designs pertaining to stormwater management and water quality, site plans, details, calculations, construction specifications, and other technical documents must be designed and sealed by a professional engineer that is registered in the state of South Carolina, with sufficient knowledge and experience to accomplish all design elements of the site plan. Users who are not justly qualified by education or experience in the fields of stormwater control design, construction, or land development should consult with a qualified professional in one or more of these areas prior to planning for construction activities.

## 1.3 Manual Organization

The design standards are divided into five (5) chapters, organized to present recommended technical and engineering procedures along with criteria obtained from local, state, and federal requirements. The remainder of this chapter provides information on the City's authority to develop and enforce design requirements along with several legal matters, some background information on stormwater management and its importance, and definitions for terms used throughout this Manual. Chapter 2 describes the application process for obtaining a construction permit. Chapter 3 contains specific design criteria and the site design credit system. Chapter 4 describes the inspection and enforcement process. Chapter 5 contains references for designing components of the stormwater management system.



## 1.4 Authorization

This Manual has been prepared under the direction of the Public Works Director, which has been granted the authority to develop engineering design standards and enact programs and policies to ensure compliance with the NPDES Phase II General Permit for Stormwater Discharges from Regulated Small Municipal Separate Storm Sewer Systems (MS4s), SCR300000, and the City's pertinent ordinances.

### 1.4.1 NPDES MS4 General Permit SCR300000

The City of North Charleston, like many other cities and counties across the United States, is required to have an NPDES MS4 permit to discharge stormwater. Because construction activities contribute to the discharge of pollutants, the NPDES MS4 permit requires that the City of North Charleston encourage, promote, and implement certain practices, programs, and procedures for the purpose of reducing or limiting discharge of pollutants to Waters of the State. The permit requires that the City of North Charleston develop and implement a Stormwater Management Program to control the discharge of pollutants from its MS4 to the maximum extent practicable (MEP). The SWMP has several components that must be met and this Manual provides partial compliance with several, including construction and post-construction management, and public education. A link to the MS4 permit can be found at [http://www.scdhec.gov/environment/ocrm/pubs/tech\\_docs\\_water.htm](http://www.scdhec.gov/environment/ocrm/pubs/tech_docs_water.htm).

### 1.4.2 City of North Charleston Ordinances, Regulations, and Standards

The City of North Charleston has developed and adopted ordinances and standards, largely based on State and Federal regulations, specifically to address concerns associated with uncontrolled stormwater runoff. The principal ordinances and standards for the City that affect the selection of stormwater management control measures are:

1. **Stormwater Management Ordinance:** Established the engineering design standards and procedures for obtaining a construction permit within the City of North Charleston. The Public Works Director was authorized by this ordinance to develop all necessary regulations, as detailed in this Manual for properly controlling stormwater runoff and mitigating existing and future impacts.
2. **Zoning and Land Development Regulations Ordinance:** Issues that may be impacted by this Ordinance when designing stormwater management systems include but are not limited to: limits on building density, buffer and setback requirements, parking lot islands, required parking spaces, tree protection, planting species selection, and screening requirements for ponds and other BMPs. Applicants should specifically check to make sure a desired development type is allowed in the planned location.
3. **Building Services:** this office issues building permits and enforces all applicable provisions of the building codes and floodplain management regulations.



## 1.5 Updates to the Design Standards

This Manual is subject to updates. As design technology and criteria evolve or change or it becomes evident that additional measures are needed to ensure the public general welfare, the Manual will be updated as needed. Updates will be approved by the City's Public Works Director. Users of this manual are encouraged to provide comments on the content of this manual at anytime in writing to the Public Works Director. The comments shall include proposed changes, reasoning, and justification (including any supporting technical documents supporting the changes). All comments will be considered during manual updates. This Manual can also be found on the City of North Charleston website at [www.northcharleston.org](http://www.northcharleston.org).

## 1.6 Stormwater Management

Development has the potential to alter the natural drainage patterns, flow rates, and volumes, and quality of the City's water resources. Traditional solutions have removed stormwater as efficiently as possible, while maintaining runoff quantity controls. The following sections discuss these impacts and the design considerations that are available and encouraged.

### 1.6.1 Effects of Development on Watershed Hydrology

Development and urbanization have the following impacts on receiving waterbodies:

- Changes to Stream Flow;
  - Increased runoff volumes;
  - Increased peak runoff discharges;
  - Greater runoff velocities;
  - Increased flooding frequency;
  - Lower dry weather flows (base flow) due to reduction in groundwater recharge;
  - Increase in floodplain elevation;
- Changes to Stream Geometry;
  - Stream channel enlargement;
  - Stream down cutting;
  - Changes in channel bed due to sedimentation;
- Degradation of Aquatic Habitat;
  - Degradation of habitat structure;
  - Decline in stream biological functions;



- Water Quality Impacts;
  - Reduced oxygen in streams;
  - Microbial contamination;
  - Hydrocarbons and toxic materials;
  - Sedimentation;
- Property Damage and Safety Concerns;
- Unsightly Aesthetic Stream Channel Conditions and Restricted Use of Recreational Waters.

### **1.6.2 Steps to Successful Stormwater Management Plans**

Proper planning is necessary to ensure that stormwater management is considered and fully integrated at the various stages of the site-development process. This involves a comprehensive approach to site planning and a thorough understanding of the physical characteristics and resources associated with the project site. This planning includes addressing each of the following categories:

- Stormwater quantity controls;
- Erosion and sediment controls;
- Stormwater quality controls;
- Stormwater conveyance controls;
- Maintenance schedules for construction and post construction activities.

The design of successful stormwater management plans involves adhering to the following principles, where applicable:

- Pre-submittal site meeting/site visit;
- Review of site development requirements;
- Detailed site analysis and supporting calculations;
- A thorough knowledge of the impacts the stormwater system may have on the watershed;
- Creation of a Stormwater Concept Plan;
- Design aspects of the stormwater management plans;



- Approval and completion of the land disturbance permit application.

In Chapter 2, the procedure for including the necessary documentation for a complete land disturbance application is provided.

### **1.6.3 Innovative Design Approach**

When designing for land disturbance activities, the design must address the following four categories of control: water quantity (flood control), design storm control (rate and volume), erosion prevention and sediment control, and pollution control (water quality standards, long-term). If an innovative stormwater design approach is to be used, the design professional should take the following considerations in mind, in addition to meeting these categories of control:

- Stormwater quantity and quality are best controlled at the source of the problem by reducing the potential maximum amount of runoff and pollutants. Source control will typically be more economical in order to treat the first flush of a storm event since a simple BMP for a large area will only treat the first flush from the closest portions of the site;
- Best management practices (BMPs) address stormwater runoff by using simple, structural and nonstructural methods along with or in place of traditional stormwater management structures when applicable;
- Equaling or exceeding traditional stormwater management designs in terms of performance (rate/volume attenuation, pollutant removal) and economic feasibility (long-term) are essential to a proposed concept's eventual approval.

Innovative approaches to site design focus on source control for stormwater runoff that limit the amount of runoff generated for a BMP to control.

### **1.6.4 Best Management Practices and Site Planning Process**

The first step in addressing stormwater management begins in the site planning and design stage of the development project. By implementing BMPs during the site planning process, the amount of runoff and pollutants generated from a site can be reduced by minimizing the amount of impervious area and utilizing natural on-site treatments. The minimizing of adverse stormwater runoff impacts by the use of BMPs and site planning should be a major consideration for a design professional.

The reduction of runoff volumes and stormwater pollutants decreases the total number and size of stormwater management controls that must be implemented under the guidelines set forth in this Manual. BMPs reduce the amount of total post-development impervious areas and maintain natural characteristics of the pre-development site conditions. Therefore, the post-development curve number(s) and time of concentrations are maintained more closely to the pre-development conditions. This reduces the overall hydrologic and hydraulic impact of the development.



#### **1.6.4.1 Maintaining Site Resources and Natural Undisturbed Areas**

Conservation of site resources and natural undisturbed areas helps to reduce the post development runoff volume and provides areas for natural stormwater management. Some natural site resources that should be maintained include, but are not limited to:

- Natural drainageways;
- Vegetated buffer areas along natural waterways;
- Floodplains;
- Areas of undisturbed vegetation;
- Low areas within the site terrain;
- Natural forested infiltration areas;
- Wetlands.

#### **1.6.4.2 Lower Impact Site Layout Techniques**

Lower impact site layout techniques involve identifying and analyzing the location and configuration of structures on the site to be developed. Where applicable, the following options that create lower impact layouts should be used:

- Fit the design layout to follow the natural contours of the site to minimize clearing and grading and preserve natural drainage ways and patterns;
- Limit the amount of clearing and grading by identifying the smallest possible area on the site that would require land disturbance;
- Place development areas on the least sensitive areas of the site and avoid steeply sloped areas when possible;
- Utilize nontraditional designs to reduce the overall imperviousness of the site by providing more undisturbed open space and minimizing clear-cutting;
- Consider the utilization of cisterns and rain barrels to collect stormwater for reuse;
- Level spreaders or other energy dissipation devices should be used at all discharge points. Level spreaders should also be considered for discharge points into ponds and other basin-type BMPs. More information on these devices is provided in Chapter 3.



### **1.6.4.3 Minimization of Impervious Cover**

The minimization of total impervious area directly relates to a reduction in stormwater runoff volume and the associated pollutants from a development site. The amount of impervious cover on a site can be reduced by the following techniques where applicable:

- Reduce building footprints by constructing some buildings as multi-story;
- Reduce parking lot areas and use porous/pervious pavement surfaces for desired overflow parking where feasible;
- Increase the amount of vegetated parking lot “islands” that can also be utilized for stormwater management practices such as Bioretention areas;
- Disconnect impervious surfaces by directing runoff to adjacent pervious areas so that runoff can be filtered and infiltrated.

### **1.6.4.4 Utilization of Natural Features for Stormwater Management**

Structural stormwater drainage controls are traditionally designed to quickly remove stormwater runoff from the site without utilizing any of the natural storage areas. These natural drainage areas should be considered as potential stormwater drainage systems. These natural areas can be utilized in the following ways where applicable:

- Vegetated buffers and undisturbed areas on the site are useful to control sheet flow (not concentrated flows) by providing infiltration, runoff velocity reduction, and pollutant removal;
- Various natural drainageways should be maintained and not disturbed to provide a natural stormwater drainage system to carry runoff to an existing outlet. The use of natural drainageways allows for more storage of stormwater runoff, lower peak flow rates, a reduction in erosive runoff velocities, and the capture and treatment of pollutants;
- Curb and gutter systems may be combined with vegetated swales at outfalls to provide added water quality benefits versus the traditional piped outfall designs;
- When applicable, direct rooftop runoff to pervious natural areas for water quality treatment and infiltration instead of connecting rooftop drains to roadways and other structural stormwater conveyance systems.

### **1.6.4.5 Engineered/Proprietary devices**

The City of North Charleston is aware of the potential benefit in using a number of stormwater engineered devices currently available on the market, such as baffle boxes, cartridge filters, bioretention, and sock and tube erosion control devices. The Public Works Director will evaluate any and all such devices specified for a given product and require appropriate drawings,



specifications, and discussions as to the applicability of the product, expected performance, and required maintenance. The Public Works Director reserves the right to request that certain devices be installed and maintained.

## **1.7 Engineering Design Accountability**

This Manual will assist engineers, plan reviewers, inspectors, and contractors in the design and layout of most land disturbance projects. However, this Manual does not replace or otherwise excuse the need for professional engineering judgment and knowledge. The user of this Manual is hereby cautioned that many aspects of engineering design must be considered, including but not limited to:

- Public health and safety;
- Site-specific conditions or unusual features of a project site that warrant special designs;
- Current versions of design texts, manuals, technical documents, and research.

The design engineer (with assistance from other design professionals as needed) is expected to thoroughly investigate field conditions and coordinate all design efforts with the City of North Charleston. For applicable projects, construction plans must be stamped and signed by a professional engineer actively licensed in the state of South Carolina, unless otherwise stated in this Manual. The design professional must have sufficient education and experience to perform a complete and thorough design of each element shown on the construction plans, and must also have complete control to change or alter plans during the design phase. The professional's stamp is a public guarantee that their design has the highest regard for health and safety, protects the environment (air, soil, water) to the maximum degree possible, and serves the interests of the general public within the City of North Charleston. A Certificate of Authorization (COA) is required on the construction plans in addition to the engineer's professional certification.

The City of North Charleston requires a certain level of design expertise for stormwater calculations and flooding analyses. Stormwater design criteria are based upon current scientific knowledge and engineering judgment. It should be realized by engineering designers that floods and flooding may occur at any time due to any number of factors beyond the reasonable control of the City of North Charleston, such as: greater amounts of precipitation or different rainfall patterns than used in design storms, wet soil conditions, debris or blockage of key stormwater channels, high groundwater tables, etc.

## **1.8 Legal Aspects**

If any portion of this Manual is ruled to be invalid or unconstitutional by any court with adequate jurisdiction over the City of North Charleston, then such portion shall be considered to have been selectively removed from the design standards without affecting this Manual's overall applicability and legal standing to the land disturbance process. This Manual will be revised on a periodic basis to reflect known changes to laws and regulations. All local, state, and federal laws and regulations shall be considered in regards to this Manual. In each instance, the more



restrictive requirement shall govern unless sound engineering judgment can determine and prove that the more restrictive requirements would be otherwise unnecessary. In most instances, laws and regulations that are phrased more explicitly shall apply over those items that are described in general terms.

## 1.9 Contact Information

The City of North Charleston should be contacted for any questions, clarifications, or other information related to stormwater management and this Manual.

### Contact for stormwater issues:

City of North Charleston  
Department of Public Works  
Engineering Division  
1021 Aragon Street  
North Charleston, S.C. 29405  
(843) 745-1026  
Fax: (843) 745-1099

## 1.10 Definitions

Words used in this Manual shall have their customary meanings as determined by the standard dictionary definition except for the following specific words and terms which are herein defined or are otherwise defined in the City of North Charleston's Stormwater Management Ordinance. In any case, the Public Works Director shall have the right to define or interpret any other word or term contained within this Manual. The rules of verbal construction found in the Stormwater Management Ordinance apply to this Manual.

1. Building: (1) a relatively permanent enclosed structure over a plot of land, having a roof and usually windows and often more than one level, used for any of a wide variety of activities, as living, entertaining, or manufacturing; (2) anything built or constructed; (3) the act, business, or practice of constructing houses, office buildings, etc.
2. Culvert: any structure not classified as a bridge which provides an opening under any roadway, including pipe culverts, and any structure so named in the plans.
3. Contour: an imaginary line, or its representation on a contour (topographic) map, joining points of equal elevation.
4. Detention: the collection and storage of stormwater runoff in a surface or sub-surface facility for subsequent controlled discharge to a watercourse or water body.
5. Development: any person, or others who acts in his own behalf, that is required to submit an application for approval to disturb land or encroachment and is thereafter



responsible for maintaining compliance with this Ordinance and conditions of the approved application.

6. Ditch: a drainage channel in earth created by natural or artificial means to convey surface and/or subsurface water, flowing continuously or intermittently.
7. Drainage: a general term applied to the removal of surface or subsurface water from a given area either by gravity via natural means or by systems constructed to remove water, and is commonly applied herein to surface water.
8. Elevation: height in feet above a given known datum, such as mean sea level.
9. Embankment or Fill: a deposit of soil, rock or other material placed by man.
10. EPSC: Erosion Prevention and Sediment Control
11. Grading: any displacement of soil by stripping, excavating, filling, stockpiling, or any combination thereof, including the land in its excavated or filled state.
12. Impervious surface: a surface which has been compacted or covered with a layer of material so that it is highly resistant to infiltration by water. The term includes most conventionally surfaced streets, roofs, sidewalks, parking lots, and other similar structures.
13. Mean sea level (MSL): the average (mean) height of the sea or ocean, in reference to NAVD88.
14. Outlet facility: stormwater management facility designed to regulate the elevation, rate, and volume of stormwater discharge from detention facilities.
15. Owner/Operator: means the property owner, or any person who acts in his own behalf, that submits an application for approval to disturb land or vegetation or for encroachment, and the person, if so designated by default or on legal documents, as the responsible party for maintenance of a stormwater management system(s) and/or facility(s). Certification statements must be signed by this person.
16. Post-Development Conditions: those conditions which are expected to exist, or do exist, after alteration, of the natural topography, vegetation, and rate, volume or direction of stormwater runoff, (resulting from development activity).
17. Pre-Development Conditions: those conditions, in terms of the existing topography, vegetation and rate, volume or direction of stormwater runoff, which exist at the time the applicant submits an application form for a land disturbance permit or Waiver.
18. Project: improvements and structures proposed by the applicant to be constructed on a defined site as part of a common plan of development.



19. Public Works Director: the Public Works Director of the City of North Charleston or his designee.
20. Rate: volume of water passing a point per unit of times, generally expressed in cubic feet per second (cfs).
21. Redevelopment: See Development.
22. Retention: the collection and storage of stormwater runoff without subsequent discharge to surface waters.
23. Retrofit: the process of altering an existing drainage system to function properly or more efficiently than currently exists. Retrofitting will be a common method used by the City to address Total Maximum Daily Loads (TMDLs) to include installation of water quality/runoff treatment devices.
24. Runoff: that part of rainfall that is not absorbed into the sites but flows over the site as surface waters.
25. Sediment: fine, particulate material, whether mineral or organic, that is in suspension and is being transported, or has been transported, from its site of origin by water or air.
26. Sedimentation: the process which operates at or near the surface of the ground, or deposits soils, debris and other materials either on other ground surfaces or in the waterbody.
27. Sedimentation Facility: any structure or area which is designed to retain suspended sediments from collected stormwater runoff, to include sediment basins.
28. Site: any tract, lot, or parcel of land or combination of tracts, lots, or parcels of land which are in common ownership, or are contiguous and in diverse ownership where development is to be performed as part of a unit, subdivision, or project.
29. Site Construction: is considered the act or process of altering the natural cover or topography and alters the quality or quantity of stormwater runoff.
30. Special Protection Areas: designated areas in the City within which more stringent design standards have been established to address an existing problem, such as flooding or water quality. Construction activities occurring within these areas will be required to comply with the additional or more stringent design criteria.
31. Storm Frequency: rate of likely recurrence of a rainstorm over a period of specified time.
32. Stormwater Management Plan: the plan to manage stormwater in terms of collection, conveyance, storage, treatment and disposal of stormwater runoff in a manner to meet the objectives of this Ordinance and its terms, including, but not limited to, measures that control the increased volume and rate of stormwater runoff and water



quality impacts caused by man-made changes to the land. This plan is approved as detailed in this document and includes the engineering calculations and construction drawings.

33. Structures: anything constructed or erected, the use of which requires a location on the ground, or attached to something having a location on the ground, including, but not limited to, tennis courts, swimming pools, fences, and buildings.
34. Subdivision: all divisions of a tract or parcel of land into two or more lots, building sites, or other divisions for the purpose, whether immediate or future, of sale, lease, or building development, and includes all division of land involving a new street or change in existing streets, and includes re-subdivision which would involve the further division or relocation of lot lines of any lot or lots within a subdivision previously made and approved or recorded according to law; or, the alteration of any streets or the establishment of any new streets within any subdivision previously made and approved or recorded according to law, and includes a combination of lots of record.
35. Vegetation: all plant growth, especially trees, shrubs, mosses, and grasses.
36. Wetlands: those areas that are inundated or saturated by surface or ground water at a frequency and duration sufficient to support, and that under normal circumstances do support, a prevalence of vegetation typically adapted for life in saturated soil conditions and delineated as freshwater wetlands by the U.S. Army Corps of Engineers.



## CHAPTER 2 - STORMWATER PERMITTING PROCEDURES

This chapter provides developers, owners, engineers, contractors, and others with the information needed to obtain approval of a stormwater management plan from the Public Works Director as required for certain construction activities within incorporated City of North Charleston and encompassed municipalities as authorized under intergovernmental agreements. This section describes conditions when a permit is needed, the types of applications used by the Public Works Director that apply to different situations, application package requirements, and when and if waivers of such requirements are applicable for certain exempted activities.

### 2.1 Duty to Comply

Unless otherwise allowed by the Stormwater Management Ordinance or this Manual, the surface of land in the City of North Charleston shall not be disturbed or altered for any purpose whatsoever, nor any major drainage channel or component of the stormwater system impeded or encroached upon without approval from the Public Works Director. Construction activities cannot commence prior to approval from the Public Works Director and issuance of a City Construction Permit.

### 2.2 Stormwater Permit Application and Approval Procedures

A Construction Permit is required for all new single family residential construction, new development, and redevelopment projects that disturb 5000 square feet or more. All Construction Permit applications shall be made, as necessary, to the City of North Charleston's Public Works Department (see the contact information in Chapter 1, Section 1.9). Applications for review and approval under this chapter may be initiated by: (1) petition of all the owners of the property that is the subject of the application; (2) the owners' authorized operators; or (3) Review and Decision-Making Bodies. The remainder of this Manual describes the procedures and application requirements of the Public Works Director.

The Public Works Director will require applicants that need permit coverage from any state or federal agency (such as but not limited to; DHEC-OCRM Coastal Zone Consistency Determinations, 401 Water Quality certifications, and/or Navigable waters permits from the US Army Corps of Engineers) to have such permits in hand prior to City permit issuance.

The Public Works Director has established five (5) categories of applications:

1. Individual Single Family Residential (SFR) structures, that disturb one-half (0.5) acre or more and are not part of a larger common plan, must submit for a Construction Permit and certify that erosion control measures will be in place (See Section 2.2.11);
2. Type I applications include minor construction projects that disturb 5000 square feet or more and less than or equal to one (1) acre (See Section 2.2.12);



3. Type II applications are for construction projects greater than one (1) acre and under five (5) acres (See Section 2.2.13);
4. Type III applications are for projects greater than or equal to five (5) acres (See Section 2.2.14);
5. A Utility Application for linear utility projects (See Section 2.2.15).

Each category has a slightly different list of submittal requirements. In general, the larger the project area and potential impact on the City's stormwater system and waters of the state, the more in-depth the stormwater management plan must be and hence the more information that must be submitted for review.

Utility companies are not exempt from NPDES requirements when applicable and the City of North Charleston must regulate utility projects just as any other type of construction. However, since most utility projects are small, linear, and underground, there is often no long term impact compared with other construction types. Therefore, these projects have been assigned their own application standards reflecting their potential impact on the City's stormwater system.

Applications required in this Manual shall be considered complete only if they are submitted in the required format, include all mandatory information, and are accompanied by the established fee(s). Any application that is determined to be incomplete shall be returned to the applicant along with an explanation of the application's deficiencies. Fees shall not be refunded. No further processing of the application shall occur until the deficiencies are corrected. Once the deficiencies are corrected, the application may be resubmitted without the payment of additional fees, provided that it is resubmitted within six months of the date that the application was returned to the applicant. Applications resubmitted more than six months after the date that the application was returned as incomplete shall require repayment of applicable fees.

Whenever the procedures of the City expressly state that applications are to be submitted after a "pre-submittal meeting", applicants shall be responsible for scheduling and attending such meetings. When a pre-submittal meeting is required, an application shall not be accepted until the pre-submittal meeting has been conducted, and any errors or omissions noted in review of the application for completeness have been addressed by the applicant.

### **2.2.1 Final Approval**

In **all** cases, one (1) complete permit application for a construction project shall be submitted to the City of North Charleston's Public Works Department either via mail or hand delivery (see contact information in Section 1.9) along with required components and fees (Section 2.2.11-15). Failure to provide all of the required information shall be considered an incomplete application and the package will be returned to the applicant. If mailed, the applicant will be notified that further information is needed to complete the package. In some cases, a new complete permit application package will have to be resubmitted.

Once the application is deemed complete, the City's review shall be accomplished and either the approval, denial, review comments, or request for further information transmitted to the



applicant. If a Type III permit is being sought, the review will not begin until after it has been verified that the pre-submittal meeting was held or until the Stormwater Master Plan has been discussed with the Public Works Director. Plan review checklists for the various approval types are provided in Appendix E.

If review comments or request for further information are required or a denial is issued, a transmittal detailing the comments, requests, or reasons for the denial will be sent to the applicant. If the reply from the applicant does not contain all necessary information, another transmittal is sent to the applicant and this process will continue until all information needed by the Public Works Director has been received.

Prior to approval, the applicant will be asked to submit four (4) full size and two (2) half size sets of construction drawings. SCDHEC may request additional information from the applicant for NPDES permit compliance, which may result in changes to the technical report or construction plans. Any such changes shall be provided to the Public Works Director as well. The owner must have a Construction Permit from the City- of North Charleston prior to beginning any construction activities. The Public Works Director reserves the right to deny coverage if an application fails to conform to the provisions of the Stormwater Management Ordinance and this Manual.

## **2.2.2 Site Construction and Project Closeout**

Site construction cannot commence until the Construction Permit is issued to the applicant by the City's Public Works Department. Construction activities must adhere to the provisions agreed to in the permit. Any substantial revisions to the approved permit should be submitted in writing to the Public Works Director along with any subsequent fees for review. Such changes shall not be implemented until approval is given. Substantial revisions for stormwater management issues may include, but are not limited to pipe size and grade alterations that affect hydraulic capacity, changes to easement boundary due to changes in the stormwater system components, or changes to the general grading plan of the site that affect the flow direction, rate, volume, or quality of stormwater runoff.

The owner is required to maintain at least one copy of all approved permits, technical reports, and construction documents, available upon request by the City of North Charleston. The Public Works Director, or his designee, will conduct inspections during the construction phase. Frequency and specific times and dates of these inspections will be done at the discretion of the Public Works Director. More information on inspections is given in Chapter 4. During construction, the owner or designated representative (contractor) must conduct inspections of all temporary erosion and sediment controls on the site in accordance with the submitted and approved maintenance schedule, and if applicable, the NPDES Construction General Permit.

### **2.2.2.1 Permit Transfer**

In certain cases and as requested by an applicant, a Construction Permit may be transferred from one applicant to another. The most obvious example of this is when a developer prepares a piece of property for a new neighborhood by performing grading activities, utility installation, the building of roads, and then turns the property over to a homebuilder(s). In such cases, the



applicant must make the City of North Charleston aware of plans to transfer ownership of the permit and associated stormwater management issues through completion of the transfer of ownership form in Appendix H. A transfer of permit coverage is also allowed for phases within a project. If a permit transfer is not requested using the appropriate form, the current permit holder will continue to be held responsible for stormwater management issues at the site.

#### **2.2.2.2 Project Closeout**

At the conclusion of the construction, development or re-development activities, the owner is responsible for making sure a site is stabilized with established vegetation, paved areas and stormwater conveyances clean of debris and sediment, and that stormwater controls are working properly. The owner shall complete and submit a Project Closeout Application Form which includes a certification statement (see Appendix A). The certification statement includes language to the effect that for projects that include stormwater management systems which will be owned and maintained by the City, the necessary repair or replacement of any system components within the City's drainage easements that fail within a two (2) year period from Project Closeout will be the responsibility of the owner. All closed conveyances proposed for public use and maintenance (pipes, boxes, etc.) shall be inspected with a video system showing the condition of the installed sections within 30 days of final site grading and site stabilization. All video inspections shall be completed in fully dewatered conditions at the expense of the owner/developer. The video files shall be submitted to the City as part of the Project Closeout procedure. Pipes shall be video inspected again at the end of the 2-year warranty period. All video inspections shall be reviewed by a Professional Engineer, and a report documenting the inspection shall be prepared by this Engineer and submitted to the City at the expense of the owner/developer. All video shall comply with the following requirements:

1. Color video submitted on a CD or DVD in a high-resolution digital format compatible with City-approved and available software and equipment.
2. All visual observations will be recorded on a log inspection form incorporating at a minimum the following items:
  - i. Date and time televised;
  - ii. Operator name;
  - iii. Starting and ending manhole (Sta. number, street name, etc.);
  - iv. Pipe diameter (inches), geometry, and material;
  - v. Location of laterals;
  - vi. Location of sags (feet);
  - vii. Location of inflow and infiltration;
  - viii. Location of sags and standing water (feet); and,
  - ix. Location of dry weather flow (feet).
3. The notation of footage (starting at 0.0 feet at the beginning manhole and moving upstream through the pipe) shall be superimposed on the video and be recorded in increments of tenths of feet.
4. All pipe joints shall be inspected by panning 360 degrees at each pipe joint.



Any problems found shall be corrected by the owner/developer. Upon confirming such corrections are complete and the site is ready, the Public Works Department will request release of any remaining bonds from the City. The Public Works Department may require additional items in order to closeout a project.

### **2.2.3 Exemptions**

Per the Stormwater Management Ordinance, the provisions of this section shall not apply to:

1. Individual single family home construction that disturbs less than one-half (0.5) acre and is not part of a larger common plan of development.
2. Land disturbing activities undertaken on forestland for the production and harvesting of timber and timber products and conducted in accordance with best management practices and minimum erosion protection measures established by the South Carolina Forestry Commission pursuant to Section 48-18-70 of the Code of Laws of South Carolina 1976, as amended.
3. Activities undertaken by persons who are otherwise regulated by the provisions of Chapter 20 of Title 48, the South Carolina Mining Act.
4. Land disturbing activities on agricultural land for production of plants and animals useful to man, including but not limited to: forages and sod crops, grains and feed crops, tobacco, cotton, and peanuts; dairy animals and dairy products; poultry and poultry products; livestock, including beef cattle, sheep, swine, horses, ponies, mules, or goats, including the breeding and grazing of these animals; bees; fur animals and aquaculture, except that the construction of an agricultural structure of one or more acres, such as broiler houses, machine sheds, repair shops and other major buildings and which require the issuance of a building permit shall require the submittal and approval of a stormwater management and sediment control plan prior to the start of the land disturbing activity.
5. Linear utility installation activities that are covered under their own DHEC approved utility general permit requiring associated assurance of proper stormwater management.

### **2.2.4 Expiration of Permit**

A Construction Permit will remain valid for up to five (5) years from the date of issuance, provided that the project is in compliance with the Stormwater Management Ordinance and this Manual and is not inactive for a period of twelve (12) consecutive months. Construction activity must be initiated within twelve (12) months of issuance of the City permit. Failure to initiate construction will render the permit invalid at the end of the twelfth month.



### **2.2.5 Responsibility of Owner/Operator**

During any construction operation, the owner/operator shall be responsible for carrying out the proposed work in accordance with the permit, approved plan, specifications, and time schedule, and in compliance with all requirements of the Stormwater Management Ordinance and this Manual.

### **2.2.6 Waivers**

The Public Works Director may grant waivers from the requirements of the Stormwater Management Ordinance and this Manual for individual construction activities if there are exceptional circumstances applicable to the site such that strict adherence to these provisions will result in unnecessary hardship and not fulfill their intent. A written request from the applicant shall contain descriptions, drawings, and any other information that is necessary to evaluate the proposed waiver. A separate written waiver request shall be required if there are subsequent additions, extensions, or modifications which would alter a previously approved waiver. A project may be eligible for a waiver of stormwater management for water quantity if the applicant can demonstrate that:

1. The proposed project will have no significant adverse impact on the receiving natural waterway or downstream properties; or
2. Attenuation of the runoff within the subject basin will alter the release rate such that downstream systems will be adversely impacted by storing the regulated storm event (i.e. it can be shown that the time of concentration of the basins will coincide, leading to an increase of the peak at an already vulnerable point downstream).

The imposition of peak or volume control requirements of stormwater runoff would aggravate downstream flooding. An example of this situation would be when an overall analysis has indicated that imposing restrictions in the upstream watershed of the proposed project would cause the timing of the peak of the routed hydrograph to coincide with the peak flow from another contributing watershed at a certain point downstream.

### **2.2.7 Non-floodplain Variances**

The Public Works Director may, upon written request from the applicant, grant variance and exception to any of the provisions of the Stormwater Management Ordinance or this Manual, provided such variance or exception is in harmony with the general purpose and intent of the Stormwater Management Ordinance and this Manual. A written request for variance must be provided to the Public Works Director stating the specific variance(s) sought and the reason(s) with supporting data for their granting. Any request for variance shall be clearly stated in the Construction Permit application.



## 2.2.8 Encroachment Permits

An Encroachment Permit, which controls the impacts of traffic, storm drainage, and sediment entering a public road right-of-way and drainage improvements within a public drainage easement, must be obtained from the SCDOT and/or the Public Works Department of the City of North Charleston before construction begins. Applicants should be aware of the City of North Charleston requirements which may differ from SCDOT's.

A copy of an Encroachment Permit application(s) to SCDOT must be included in the Construction Permit application package. It is the applicant's responsibility to comply with all SCDOT Encroachment Permit application requirements. Approved encroachment permits are required prior to final approval from the Public Works Director.

## 2.2.9 Easements

The following section provides the required easement widths for various components of the stormwater management system(s). In all cases, there will be an allowance for offset easements, in which the pipe, channel, or other stormwater system component does not necessarily have to be in the middle of the easement width, but may be offset to allow for certain construction needs. Proposed offset easements will be identified and additional width may be required as prescribed by the Public Works Director.

### 2.2.9.1 Storm Drain Pipe

Drainage easements shall provide adequate room for maintenance equipment to operate. Table 2.1 provides required minimum drainage easement widths for some of the more typical situations:

Table 2.1-Storm Drain Pipe Easements

Pipe size (in)	Maximum depth to invert (ft)	Width of drainage easement (ft)
18	3.5	20
24	5.0	20
42	7.0	20
54	7.0	24
72	9.0	30

- Notes:
- (1) For depths greater than shown, add two feet for each additional foot to the invert.
  - (2) For pipe sizes not specifically listed above, the easement width and depth to invert shall be that of the next size up, i.e. the easement width a 36 inch pipe is the same as those for a 42 inch pipe.
  - (3) For larger pipe sizes and/or multiple lines of pipe easement width shall be as determined by the Director of Public Works.



### **2.2.9.2 Ditches/Canals**

(a) *Open channel easements.* For minor ditches which drain into a collector or main ditch or into a piped drainage system, the width of the drainage easement shall be equal to the maximum top width of the ditch plus an additional twenty (20) feet; provided that, the maximum depth of the ditch does not exceed five (5) feet. When the maximum depth of the ditch exceeds five (5) feet, the width of the drainage easement shall be equal to the maximum top width of the ditch plus the maximum depth of the ditch, plus an additional fifteen (15) feet.

For major or main drainage ditches or canals, the width of the drainage easement shall be equal to the maximum top width of the ditch plus an additional twenty-five (25) feet; provided that, the maximum depth of the ditch or canal does not exceed five (5) feet. When the maximum depth of the ditch or canal exceeds five (5) feet, the width of the drainage easement shall be equal to the maximum top width of the ditch plus the maximum depth of the ditch, plus an additional twenty (20) feet.

(b) *Minor swale ditches.* For minor swale ditches along lot lines draining a small area where street drainage is not involved and where the depth of the swale does not exceed one foot, a drainage easement not less than ten (10) feet in width shall be provided. In the case of a residential subdivision, the drainage easement for a swale should be granted to a homeowner's association (HOA).

### **2.2.9.3 Detention ponds**

A minimum access easement of twenty (20) feet (including a minimum of ten (10) feet of riding surface around the pond) shall be provided. In addition, a right-of-way width of at least thirty (30) feet shall be included to connect the pond to a public road. This right-of-way shall contain a minimum twenty (20) foot wide access road. While the City shall not accept responsibility for pond maintenance, unless agreed to in writing, the City may utilize the easement for necessary emergency repairs.

### **2.2.9.4 Other Stormwater Facilities & BMPs**

All other structures used for the control of stormwater runoff (quantity or quality) not otherwise covered above, shall have an easement for access and maintenance that is a minimum of twenty (20) feet beyond the boundary of any such structure. The Public Works Director may request or allow other easement widths on a case-by-case basis given site constraints or special conditions. While the City shall not accept responsibility for stormwater facility maintenance, unless agreed to in writing, the City may utilize the easement for necessary emergency repairs.

### **2.2.9.5 Offsite Easements**

Any required off-site easements should be obtained prior to Construction Permit issuance which would impact upon that area. Any work done without a proper and adequate easement(s) shall be at the owner's own risk. Non-subdivision projects shall provide validation of necessary easements before a Construction Permit will be issued.



## **2.2.10 Stormwater Facility Ownership and Maintenance**

### **2.2.10.1 Ownership**

**Residential:** Ownership of all BMPs (water quantity and quality basins/devices/non-structural practices) in new and re-development projects shall in most cases belong to the owner(s) of the parcel(s) or a homeowners association (HOA) of land under or on which it exists.

**Commercial:** In new and re-development projects, ownership of the entire stormwater system (conveyances, as well as all BMPs, ponds, etc.) shall belong to the owner, or a lessee(s).

For any project, the owner of a portion or the entire stormwater system, as the case may be, shall be clearly designated before a Construction Permit will be issued. Ownership shall also be recorded on the final plat. Ownership shall imply responsibility for maintaining the stormwater system, including all ponds and other BMPs used for controlling runoff quantity and quality. Ownership does not imply that the owner(s) may in any way alter the size, or function of any component of the stormwater system without consent from the City of North Charleston. Owners found altering such components will be required to remove any alterations.

### **2.2.10.2 Maintenance**

Each component of the stormwater management system (pipes, inlets, BMPs) shall have a maintenance plan (activities and associated schedule) as part of the application package for a Construction Permit. The plan shall also cover temporary measures used during construction in addition to the long term maintenance of the system. Suggested maintenance activities and recurrence intervals for water quality BMPs are discussed and referenced in Chapter 3.

In addition, the owner/operator, HOA, or operator as applicable, must enter into a permanent maintenance agreement (Operating Permit) with the City of North Charleston. This Operating Permit is a legal document, recorded in the permanent land records with the County Register of Deeds, in addition to being fully described on the final plat. The Operating Permit is provided in Appendix B. The operating permit must be signed and executed prior to the issuance of a Construction Permit. This permit allows for maintenance to be performed by a third party such as an operator or other contractor. However, the owner must also be listed and is ultimately responsible for adherence to the maintenance requirements. The Public Works Director will provide oversight of these permits to ensure adherence by the owner or other responsible party. The Public Works Director will inspect a system as he deems necessary to ensure maintenance is being performed in accordance with this permit. More detail is provided in Chapter 4 on City inspection and enforcement procedures.

## **2.2.11 Single Family Residential (SFR) Applications**

A Construction Permit shall be required for all individual Single Family Residential (SFR) construction (i.e. not part of a larger common plan of development) that disturbs one-half (0.5) acre or more must complete the SFR application (Appendix A) that contains guidance on selecting, installing, and maintaining erosion prevention and sediment controls on site. This application also requires a certification by the owner/contractor that these measures will be



installed and maintained so as to prevent the discharge of sediment-laden runoff and to prevent, as applicable, that the construction will not cause non-compliance for any adjacent construction projects that may be under another City, State, or Federal permit. The application is considered complete if filled out and signed.

### **2.2.12 Type I – Minor Application**

A Construction Permit shall be required for any new or re-development project (except individual SFR construction that is not part of a larger common plan of development) that disturbs 5000 square feet or more but less than one (1) acre must submit this application type. The project must have a Construction Permit from the City prior to beginning construction activities. Guidance on selecting necessary erosion control measures is provided in Appendix D. A complete application must provide the following:

1. Application Form: This form is contained in Appendix A.
2. Site Narrative: The narrative should describe the site in general, the purposes of the construction activity, and potential problems with adjacent properties and waterbodies receiving stormwater runoff (existing and proposed). Also, if applicable, wetland and waterbody disturbance issues should be discussed along with proof of permit coverage by the US Army Corps of Engineers (USACE) and/or SCDHEC-OCRM, as applicable.
3. Construction Site Plan: A sketch of the project area must accompany the narrative showing new and existing features, and selected BMPs.
4. Fees: No plan review or inspections fees are required at this time but it is anticipated that review/inspection fees will be adopted by the City.

### **2.2.13 Type II – Small/Intermediate Applications**

A Construction Permit shall be required for any project which disturbs an area of one (1) acre or more, but less than five (5) acres **or** projects disturbing less than one (1) acre but which are part of a Larger Common Plan of Development that will disturb more than one (1) acre but less than five (5) acres. Submittal requirements are detailed below. Some small construction sites may be required to comply with conditions for Type II approvals on a case by case basis. The following submittal requirements must be provided as part of a complete application to receive a City permit.

1. Application Form: The form as shown in Appendix A.
2. Site Narrative: A narrative should be submitted with the application which includes, but is not limited to, the following:
  - a. General description of the site,
  - b. Purpose of the construction activity,



- c. Summary table(s) of existing and proposed runoff flows, volumes, and pollutant loads,
  - d. Topographic and soil information,
  - e. Adjacent properties and owners,
  - f. Waterbodies receiving stormwater runoff,
  - g. Water quality and flooding issues, and potential impacts (quality, downstream structures, etc.) and benefits (open space, treatment, maintenance, etc.).
  - h. Anticipated starting and completion dates of the various stages of the construction activities and the expected date of final stabilization.
  - i. If applicable, the narrative should also contain justification for variances, waivers, or other special conditions for the site.
  - j. Also, if applicable, wetland and water body disturbance issues should be discussed along with details on the status of necessary permit applications to the USACOE.
  - k. If a TMDL(S) is in place for the receiving waterbody, the narrative must describe how the project will comply with the TMDL(s)
3. A sketch of the project area to accompany the narrative containing the following, when applicable:
- a. Site location drawing of the proposed project showing project location in relation to roadways, jurisdictional boundaries, streams, rivers, and lakes and the boundary lines of the site to be developed,
  - b. Identification of all areas within the site that will be included in the construction activities,
  - c. Location of temporary and permanent stormwater management controls.

4. Technical Report:

One (1) copy of the technical report should be prepared by a licensed professional engineer as defined by state law and submitted as part of the application package. This report shall consist of maps, and supporting design calculations for the proposed stormwater system and erosion/sediment control measures used during construction, to include, but not be limited to, the following, when applicable:

- a. Pre- and post-development hydrologic analysis that determines the existing stormwater peak flow rates, flow velocities, and pollutant loads for all delineated sub basins/discharge points. The natural conditions prior to any



development will be the standard by which the stormwater plan for a construction project is evaluated. The stormwater plan must demonstrate control of runoff quantity and quality in accordance with design criteria provided in Chapter 3 (flow and volume control, maximum velocities, etc.),

- b. Hydraulic design calculations for all conveyances showing the ability to handle anticipated flows and volumes. Provide calculations showing that the project does not cause or increase any negative impact on downstream structures, and the upstream and downstream stormwater drainage system. The following computations should be included as necessary: hydrographs, routing of hydrographs through system components, pipe and open channel capacity, velocity calculations, and water surface elevations. Calculations and discussion shall be provided for energy dissipation and inlet/outlet protection devices. All system components should have standard details and specifications.
- d. If the project is located in a Special Protection Area(s), a comprehensive evaluation of engineering calculations and analysis should be included that demonstrate that the project will not negatively impact current drainage conditions and/or complies with state and federal conditions on stormwater discharges. More information is provided in Chapter 3;
- e. Erosion and sediment control plan to include:
  - i. A description of the erosion and sediment control facilities selected,
  - ii. Map showing the location of all erosion and sediment control facilities,
  - iii. Design calculations of each measure, including trapping efficiencies. Each measure should also have a standard detail and specification,
  - iv. Explanation/discussion of models used in the design.
- f. Downstream analysis calculations showing the effect of post-development design flows on downstream storm water conveyance systems and channels. More details on this analysis and where it is applicable is covered in Chapter 3;
- g. Watershed delineation maps with consistent sequential notations;
- h. Location map showing topography and waters of the state in relation to proposed project;
- j. Discussion and calculation of any wetlands issues;
- k. Map showing type and classification of all soils expected to be encountered or used at the development site;
- l. Presentation of existing and proposed contours at the development site;



- m. General description of the adjacent property and description of existing structures, buildings, and other fixed improvements located on surrounding properties;
- n. Discussion of site access issues and easements to be obtained and provided to the City.

5. Construction Site Plans:

One complete set of site construction plans are to be included as part of the submittal package. The information required on the construction plans shall include, but is not limited to, the following list:

- a. North arrow and scale,
- b. Property lines, bearings and distances, adjacent landowners' names, and land use conditions,
- c. Legend,
- d. Registered engineer's seal and signature,
- e. Certificate of Authorization seal, as appropriate,
- f. Existing and proposed contours (one foot intervals) and land uses,
- g. Limits of disturbed area,
- h. Delineation of wetlands and/or waters of the state,
- i. Easements,
- j. Stormwater system profiles with existing and proposed ground elevations,
- k. Construction sequence (include implementation of all stormwater and sediment controls in the first phase of construction),
- l. Locations of all temporary and permanent control measures,
- m. Details for all temporary and permanent control measures,
- n. Grassing and stabilization specifications and schedule,
- o. Maintenance requirements (for temporary and permanent controls, grassing, etc.),
- p. Construction entrance/exit,
- q. Tree protection, preservation, and overall landscaping plan with appropriate species selection and screening for ponds and other components subject to the



provisions of the City's Tree Protection Ordinance in Appendix A – Zoning Regulations.

- r. Details and specifications of all necessary construction components,
- s. Location map,
- t. The cover sheet shall contain, at a minimum, the following items:
  - i. Project name,
  - ii. Engineers contact information (name, mailing address, telephone, fax),
  - iii. Contact information (name, mailing, address, telephone, fax) of the owner, operator or designated party,
  - iv. Tax Map System (TMS) Number(s) for the site,
  - v. Vicinity map, and
  - vi. Table of contents.
- u. All drawing elevations shall be based on the NAVD 88 and the property corners shall be projected in the state plane coordinate system.
- v. The following standard notes shall be shown on the plans. This list is not meant to be exhaustive and other notes should be included as necessary:
  - i. If necessary, slopes which exceed eight (8) vertical feet should be stabilized with synthetic or vegetative mats, in addition to hydroseeding. It may be necessary to install temporary slope drains during construction. Temporary berms may be needed until the slope is brought to grade,
  - ii. Stabilization measures must be initiated as soon as practicable in portions of the Site where construction activities have temporarily or permanently ceased, but in no case more than 14 days after the construction activity in that portion of the site has temporarily or permanently ceased,
  - iii. All sediment and erosion control devices shall be routinely inspected every seven days or every fourteen days and after each rainfall occurrence that exceeds one-half inch. A proposed schedule needs to be provided. Damaged or ineffective devices shall be repaired or replaced, as necessary,
  - iv. Provide silt fence and/or other control devices, as may be required, to control soil erosion during utility construction. All disturbed areas shall be cleaned, graded, and stabilized with grassing as soon as practicable after the utility installation,



- v. All erosion control devices shall be properly maintained during all phases of construction until the completion of all construction activities and all disturbed areas have been stabilized. Additional control devices may be required during construction in order to control erosion and/or offsite sedimentation. All temporary control devices shall be removed once construction is complete and the site is stabilized,
- vi. The contractor must take necessary action to minimize the tracking of mud onto the paved roadway from construction areas. The contractor shall daily remove mud/soil from pavement, as may be required,
- vii. Residential subdivisions require erosion control features for infrastructure as well as for individual lot construction. Individual property owners shall follow these plans during construction,
- viii. Temporary diversion berms and/or ditches will be provided as needed during construction to protect work areas from upslope runoff and/or to divert sediment laden water to appropriate traps or stable outlets,
- ix. Litter, construction debris, oils, fuels, and building products with significant potential for impact (such as stockpiles of freshly treated lumber) and construction chemicals (concrete washdown areas, paint brush cleaners, etc.) that could be exposed to stormwater must be prevented from becoming a pollutant source in stormwater discharges,
- x. Provide written proof that all off-site easements have been obtained.

Note: Some items may be included in other components of the permit application package, but should be adequately noted. Size D (24" X 36") Plan sheets/drawings.

- 6. Subdivision projects shall have a complete set of plans and specifications to include, but not be limited to, the following items, as appropriate: lot layout/site plan and staking, acreage, road plan/profiles, storm drainage plan/profile, drainage areas (both on and off-site) with characteristics, sediment and erosion control, utilities (water and sanitary sewer), post-construction stormwater management facilities, and traffic patterns with temporary (construction) and permanent traffic signage. Plans shall provide existing and proposed contours with intervals of not more than one (1) foot. Where possible, and as needed, contour lines should be extended beyond the site boundary lines. While some of these items lend themselves to combining information on a single sheet/drawing, care should be taken to ensure that plans are not overcrowded/cluttered. The lot layout sheet should show a tie distance from the primary entrance of the proposed project to the nearest existing intersection.
- 7. All available or used bench marks shall be shown on the applicable sheet. At least one bench mark shall be available or established on/near (within survey instrument sight distance) the site. The bench mark shall be referenced to North American Vertical Datum (NAVD) 1988.



8. The applicant will provide a tentative construction time schedule for the development. Sediment and erosion control measures will be some of the first work at a site and such implementation will be demonstrated. The schedule will also provide for coordination with the responsibilities of all parties, including those installing utilities.
9. Specifications for all components of construction activities related to grading, utilities, sediment and erosion control, temporary and permanent vegetation, water quality BMPs, etc.
10. Maintenance Schedules and Operating Permits:  
  
When stormwater management facilities and system components are to be maintained by an owner, operator, or other designated party, the City of North Charleston must be given assurance that such activities will be conducted. This is to be established using an Operating Permit that specifies the maintenance activities to be performed after construction and site stabilization. The maintenance schedules for all stormwater system components, and designation of the responsible parties must be included in the permit application. The Operating Permit will be enforced in perpetuity.
11. Stormwater Pollution Prevention Plan (SWPPP):  
  
A SWPPP is a document that provides guidance to owners and contractors and co-permittees/subcontractors on the activities that shall be done during construction to reduce the risk of pollution. Construction projects are considered an industrial category and are required to prepare and implement a SWPPP to be submitted with the permit application package to the City of North Charleston. The stormwater pollution prevention plan requirement applies to both development and redevelopment sites.

## **2.2.14 Type III – Medium/Large Applications**

A Construction Permit shall be required for any project which disturbs an area that is five (5) acres or greater **or** projects disturbing less than five (5) acres but which are part of a Larger Common Plan of Development that will disturb more than five (5) acres. A complete application is accomplished by submitting the items listed for Type II applications (Section 2.2.13, Items 1-11) plus the additional requirements detailed below.

### **2.2.14.1 Pre-submittal Meeting**

The first step for Type III applications is to conduct a pre-submittal meeting. This meeting is intended to coordinate stormwater management needs. Design professionals are urged to see the site to understand existing runoff patterns and identify areas on the site that may require greater attention to meet the intent of the requirements. The City's Public Works Director may waive this requirement on a case by case basis.



### **2.2.14.2 Stormwater Master Plan**

For Type III applications which are located in Special Protection Areas, a Stormwater Master Plan is required to be submitted prior to the submittal of the complete package as detailed below. Special Protection Areas are areas within the City that require some additional stormwater management controls due to existing problems. Such problems can include but are not limited to flooding and State recognized water quality impairments. This Master Plan is to be created to give the design professional the opportunity to propose a site layout and proposed stormwater controls to the City's Public Works Director. The Master Plan should be submitted by hand or mail, and can be incorporated for discussion at the pre-submittal meeting. The Public Works Director may waive the requirement for a Master Plan for some permit applicants on a case by case basis.

The Master Plan can be a preliminary sketch of the site and shall contain the following items, when applicable:

1. Site layout showing buildings, roads, parking areas, utilities, and grassed or landscaped areas.
2. Vicinity map.
3. Pre- and post-development primary runoff patterns and discharge points.
4. Location/distances to Waters of the State and all other existing natural features such as wetlands, ponds, lakes, floodplains, and stream buffers.

In addition, the applicant should be prepared to discuss the following items, when applicable:

1. All modeling methodologies to be used.
2. Methods to show compliance with any adopted Total Maximum Daily Loads (TMDLs) or other waterbody impairments that may limit the allowable pollutant load that can be discharged.
3. Preliminary waiver or variance requests.
4. Others as requested by the Public Works Director.

Upon submittal and discussion of the Master Plan and related concerns, the applicant can create and submit a complete permit application (Section 2.2.13, items 1-11).

### **2.2.15 Utility Applications**

If SCDHEC does not issue a general permit to cover linear utility construction activities, the City of North Charleston requires that companies performing utility installations must obtain a Construction Permit prior to beginning work. This must be done whether the utility installation



is part of another construction project (e.g. phone line extension) or an independent project (e.g. gas force main). A complete application must include the following items:

1. Site Narrative: The narrative should describe the installation to be performed and the measures that will be used for erosion prevention and sediment control. Inclusion of typical design details is preferred, but simple sketches may be used. Details should include at a minimum temporary and final stabilization measures and silt fencing.
2. If a waterbody crossing is necessary, a sketch of the proposed measures. If a USACOE permit is needed, a copy of the permit application should also be included. City approval will not be issued until USACOE approval is obtained.
3. A signed certification agreeing to the conditions of the City approval and NPDES permit if applicable. The certification form is provided on the Application Form (Type I and Linear Utility Project Application) in Appendix A.

The City of North Charleston is aware of the importance of coordinating utility installation, particularly when the installation is part of a larger project. The various parties are encouraged to work together to ensure that these installations do not impact the permit compliance of the larger project.



## CHAPTER 3 - DESIGN REQUIREMENTS

This chapter provides engineers, designers, developers, and others with the necessary information needed to design adequate systems that will control the rate, volume, and pollutant loads released from a new or re-development project where the City's Public Works Director has been authorized by law or agreement to enforce engineering standards. These design requirements have been developed based on common engineering practice and reference State and Federal requirements, engineering publications, and other municipal and academic guidance.

It is the goal of this Chapter to provide a minimum set of design standards that will result in effective stormwater management to mitigate the impact of land development on existing/natural hydrologic and hydraulic processes, as well as attempt to prevent further degradation of the water resources in City of North Charleston through proper planning, design, installation, and maintenance. The design professional shall use all means necessary to develop land in a manner consistent with all City Ordinances and this Manual. Specific methods and applications not covered in this section can and should be discussed with the City's Public Works Director for applicability prior to the submission of site plans and drainage calculations. The following section details the criteria that shall be followed in the absence of designated specific watershed master plan criteria.

### 3.1 General Design Standards

General requirements for all stormwater systems and facilities will include, but not be limited to, the following:

1. Site designers shall minimize the generation of stormwater and maximize pervious areas by:
  - a. Selecting portions of the site where the drainage pattern, topography, and soils are favorable for the intended use.
  - b. Exposing the smallest practical area of land for the least possible time during development. This includes maintaining or creating buffers and preserving natural areas.
  - c. Limiting the drainage area to all BMPs. Specific maximum contributing areas to BMPs are provided in this chapter.
  - d. When feasible, retaining and protecting natural vegetation and saving topsoil, for replacing on graded areas.
  - e. Using temporary plant cover, mulching, hydroseeding, or other stabilization methods to control runoff and protect areas subject to erosion during and after construction.



2. Annual groundwater recharge rates should be maintained to the maximum extent practical by promoting infiltration through the use of structural and non-structural methods.
3. Stormwater runoff generated from development shall be controlled to predevelopment and/or natural rates. The method for computing adequate control shall be based on several design storms. Greater detail is provided in this chapter.
4. Stormwater runoff generated from development shall be treated through the use of structural and/or non-structural practices. It is presumed that sufficient treatment is provided by the proposed BMPs if they are:
  - a. Designed according to the specific performance criteria outlined in this Manual,
  - b. Constructed properly, and
  - c. Maintained regularly.
5. Stormwater discharges to Special Protection Areas with sensitive resources or that have existing flooding or water quality problems [e.g., cold water fisheries, recharge areas, water supply reservoirs, Total Maximum Daily Loads (TMDLs), and 303(d) listings] are subject to additional performance criteria. Section 3.9 contains more specific information and design requirements on the areas that will receive this additional set of protection criteria.
6. All BMPs shall have an enforceable operation and maintenance agreement to ensure the system functions as designed. Chapter 4 contains more detail on these operation and maintenance agreements.
7. Redevelopment, defined as any construction, alteration or improvement equal to or greater than one-half (0.5) acre of land disturbance on sites where existing land use is commercial, industrial, institutional, or multi-family residential, is governed by the same design criteria as new developments.
8. Sediment basins and other BMPs shall be used during construction to remove heavy sediment loads from runoff waters leaving the disturbed area. Design criteria are provided in this chapter.
9. Permanent vegetative cover and the long-term erosion protection structures shall be installed as soon as practical in the development process.
10. If wetlands are suspected to exist on the property, they should be investigated and delineated by a qualified consultant. The US Army Corps of Engineers (USACOE) must make a determination as to whether or not the wetlands fall under their jurisdiction. All efforts should be made to reduce or eliminate impacts such as using a buffer and/or installing a silt fence around wetlands. If the wetlands fall under the jurisdiction of the USACOE, a Section 404 permit is needed before any disturbance of the wetlands is allowed. In addition, the DHEC-OCRM Coastal Zone



Consistency Determination will address any proposed wetland impacts. The City of North Charleston will accept certified delineations from qualified consultants if the USACOE is unable to issue a verification on the jurisdictional determination.

11. Where existing wetlands are intended as a component of an overall stormwater management system, the approved plan for stormwater management shall not be implemented until all necessary federal and state permits have been obtained.
12. All stormwater management and sediment control practices shall be designed, constructed, and maintained with consideration for the proper control of mosquitoes and other vectors. Specific design criteria are provided in this chapter.
13. For the purposes of hydraulic design, capacity of a system to transport stormwater runoff, shall be based on the size of the contributing drainage basin or subwatershed, as outlined below:

a. Minor Drainage Systems: 0 - < 40 Acres

All street drainage, curb and gutters, pipe systems, culverts, ditches and channels which drain less than 40 acres shall be designed to carry flows resulting from a ten (10)-year frequency storm. An exception is roadway cross drains which shall be designed to carry flows resulting from the twenty-five (25) year storm. Minimum allowable pipe diameter shall be 15 inches.

b. Collector Systems: 40 - < 100 Acres

All drainage systems draining at least 40 acres but less than 100 acres shall be designed to carry flows resulting from a twenty-five (25) - year frequency storm.

c. Major Drainage Channels: 100 - < 300 Acres

All drainage systems draining at least 100 acres but less than 300 acres, such as channel improvements, culverts or bridges along these channels, shall be designed to carry a flow resulting from a fifty (50)-year frequency storm. Encroachment upon Major Drainage Channels and the adjacent overflow land shall be avoided to the extent possible.

d. City or FEMA Floodplains: 300 and more Acres

Bridges and culverts being constructed in natural channels, creeks, or rivers draining more than 300 acres, shall be designed to carry a flow resulting from a one-hundred (100)-year frequency storm. Encroachment upon these channels and the adjacent overflow land shall be avoided as much as possible.

The Floodplain provisions for the City of North Charleston can be found by contacting the Building Department.



The area outside a project area (e.g. offsite areas) that drains to a particular design point must be included in determining the appropriate design storm. All hydrological computations shall be based on the contributing watershed, not just site boundaries, the project area or disturbed area.

14. All development sites disturbing more than one (1) acre shall have an analysis performed of the drainage system to ascertain the function of the system during the 100-year storm event (precipitation only) or more specifically, determine that the project will not:
  - a. Increase the likelihood of dwelling flooding and property damage.
  - b. Increase water surface elevations or reduce system capacity in stormwater system and facilities upstream or downstream of the project.
  - c. Impose any new or additional increase in stormwater runoff velocity on adjacent properties, discharge points, or downstream areas.
  - d. Impose any new or additional increase in erosion and pollutant loads that would adversely impact waters of the state.

If a master plan exists for the area/watershed which encompasses the project, criteria set by that plan shall be used for determining the extent of this analysis. Without a master plan, analysis shall extend up to the top of the watershed and down to a water of the state or to a point in which the project comprises 10% of the total contributing area, whichever occurs first. In these cases, the analysis criteria shall include, but is not limited to:

- a. Utilization of existing land use curve numbers for all areas,
- b. Routing the flows using an accepted hydrologic and hydraulic method, and
- c. Providing hydraulic step-backwater calculations using USACE's HEC-2 or HEC-RAS models or equivalent. Other calculations may be required by the Public Works Director based on severity of potential impact and location of the project.

If the downstream analysis determines that the development of a particular site does contribute to flooding, pollution, or erosion problems, then the system design shall be changed or additional controls shall be included.

15. Watersheds that have documented water quantity problems may have more stringent or modified design criteria as determined from City of North Charleston master plan studies or as dictated by State and Federal Regulations. The Public Works Director reserves the right to impose additional design requirements, such as the examples listed below:



- a. Post-development discharge rates from the entire development area not exceeding pre-development discharge rates for storm frequencies greater than the 25-year frequency 24-hour duration storm event,
- b. Post-development discharge volumes from the entire development area not exceeding pre-development discharge volumes for storm frequencies smaller than the 1-year frequency 24-hour duration storm event,
- c. Reduction of peak flow rates below pre-development levels,
- d. Downstream channel, culvert, or property improvements.

### 3.2 Hydrologic Computation Methods

All hydrologic computations shall be completed using volume-based hydrograph methods acceptable to the City’s Public Works Director. The design storm duration for these computations shall be the 24-hour storm event utilizing a SCS Type III distribution with a 0.1-hour duration time increment. Typical hydrologic inputs include, but are not limited to the following:

- Rainfall depth or intensity,
- NRCS soil classification and hydrologic soil group,
- Land use,
- Time of concentration, and
- Initial abstraction/surface storage.

The remainder of this section will provide basic information for the hydrologic calculations. As discussed, the intent of the Manual is not to provide detail on every aspect of hydrologic computations, their limitations, assumptions, appropriateness of use, but rather general guidance on generally accepted standards. This Manual does, however, reference suggested materials as necessary for detailed discussion of related topics.

#### 3.2.1 Inputs

The precipitation depths corresponding to various return periods to be used for projects in City of North Charleston are shown in Table 3.1.

Table 3.1: Design Storm Precipitation Data (in Inches) for North Charleston, S. C.

Area	1-yr	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Charleston County	3.8	4.3	5.5	6.6	8.0	9.2	10.4

Source: SCDHEC 2005

Soil types in the City of North Charleston range from sands to sandy clays. Existing land use and corresponding runoff potential factors should be obtained from the site visit and other



appropriate sources. Appropriate runoff potential factors can be found in several of the references listed in Chapter 5.

### 3.2.2 Stormwater Management Design Methodologies

The City of North Charleston recommended methods and corresponding design circumstances are listed in Table 3.2 and 3.3 below. If other methods are used, approval must first be given by the City’s Public Works Director. Complete source documentation must be submitted for approval.

Table 3.2: Recommended Methodologies Based on Land Disturbance Area

Method	Size Limitations*	Comments
(Modified) Rational Method	0 – < 1 Acres	Acceptable for sizing individual culverts or storm drains that are not part of a pipe network or system. <u>Not to be used for storage design.</u>
“SCS Method” (TR-55)	0 – 2000 Acres	Used for estimating peak flows from urban areas.

\*Size limitations refer to the subwatershed size to the point where a stormwater system component (i.e., culvert, inlet, BMP) is located.

Details of Rational Method and Modified Rational Method can be found in Chow (1988), ASCE (1996), USDA (1996), and Mays (2001). Documentation on the commonly used SCS (or NRCS) Method can be found on the US Department of Agriculture website (<http://www.wcc.nrcs.usda.gov/hydro/hydro-tools-models-tr55.html>). The USGS regression equations for South Carolina can be obtained from the US Geological Survey website (<http://water.usgs.gov/osw/programs/nffpubs.html>). Haan, C. T., Barfield, B. J., and Hayes, J. C. (1995) and USDT (1996, 2001) can also be referenced for greater detail on hydrology calculations and assumptions.



Table 3.3: Recommended Hydrologic Methods for Designing Various Stormwater Management Systems and Controls

Method	Rational Method	SCS Method
Extreme Flood Protection		+
Storage/Sedimentation Facilities		+
Outlet Structures		+
Gutter Flow and Inlets	+	
Storm Drain Pipes	+	+
Culverts	+	+
Small Ditches		+
Open Channels		+
Energy Dissipation		+

Methods for calculating the time of concentration and abstraction are numerous. However, a minimum time of concentration of six (6) minutes shall be used for all hydrologic calculations. See references given above for the suggested methodologies for information on these calculations.

### 3.2.3 Hydrographs

Hydrographs should be used to evaluate entire systems by routing storm events through pipe or storage systems. The use of a hydrograph will provide better insight into system performance than simply using the peak discharge. The City’s Public Works Director will accept computer models commonly used in the industry as well as newer models with appropriate documentation.

## 3.3 Water Quantity Control Standards

Water quantity control is an integral component of overall stormwater management. Quantity control is effectively flood control, reducing potential damages and health risks, but because uncontrolled runoff can cause erosion, it can also be a form of water quality control. The following design criteria are established for water quantity control. All designs of storage facilities utilized for stormwater quantity control and required downstream analyses shall be submitted as part of the engineering calculations when applying to the City of North Charleston.

### 3.3.1 General Water Quantity Criteria

1. Controls shall be designed by a traditional reservoir routing procedure.



2. All ponds shall have an emergency spillway designed to pass the 100-year storm event if the storage capacity is exceeded.
3. All quantity controls that are also used for quality control shall have a forebay or screening vault for removal of debris and coarse sediments.
  - a. Forebays shall be placed upstream of the main pond storage area.
  - b. Unless a separate vault is to be used for the forebay, the forebay shall be separated from the larger detention area by barriers or baffles that may be constructed of earth, stones, riprap, gabions, or geo-textiles. The barrier and/or baffles act as a trap for coarse sediments and minimize their movement into the main pond.
  - c. Maintenance of forebays will be needed more frequently than the main storage area and all designs should consider this need.

### **3.3.2 Detention Ponds/Reservoirs**

1. Ponds with vegetated embankments shall be less than 15-feet in height and shall have side slopes no steeper than 3H:1V. Embankments protected with Erosion Control Blankets or Turf Reinforcement Matting shall be no steeper than 2H:1V. Geotechnical slope stability analysis is required for embankments greater than 10-feet in height and have steeper slopes than those indicated above. Access inside a pond shall be provided with at least one side slope at 3H:1V or flatter.
2. Pond banks shall have one (1) foot of freeboard above the design storm event. In addition, ponds must be able to pass the 100 year storm event without overtopping the banks.
3. The bottom of detention structures shall be graded towards the outlet structure(s) to prevent standing water conditions with a minimum 0.5% bottom slope.
4. The maximum depth of permanent storage facilities with a permanent pool shall be determined by site conditions, design constraints, and environmental needs. The facility should provide a permanent pool of water with a depth sufficient to discourage weed and mosquito growth without creating undue potential for anaerobic bottom conditions. A minimum depth of six (6) is reasonable unless Charleston County Mosquito Control requirements dictate otherwise. Aeration or other means shall be used as necessary to prevent anaerobic conditions.

### **3.3.3 Underground Detention Devices**

1. Underground detention facilities shall be designed using the following criteria:
  - a. Underground detention systems shall be located downstream of other stormwater controls providing treatment of the water quality volume.



- b. The maximum contributing drainage area to be served by a single underground detention vault or tank is five (5) acres.
  - c. All systems shall be designed and located to facilitate maintenance. Systems should be cleaned out (sediment removal) at least once a year, but more frequently if necessary.
  - d. The minimum pipe diameter for underground detention tanks is 24 inches or equivalent.
  - e. Underground detention systems must meet structural requirements for overburden support and traffic loading if appropriate.
  - f. Access must be provided over the inlet pipe and outflow structure. Access openings can consist of a standard frame, grate and solid cover, or preferably a removable panel.
  - g. All underground detention systems should accommodate at least six (6) inches of sediment storage in the volume calculations.
  - h. The feasibility of these devices for a given situation shall be evaluated by a soil scientist, geotechnical engineer, or other individual certified by the State of South Carolina in water table estimation.
  - i. Water table estimation shall be based on first occurrence of two chroma features.
2. Any development that uses a parking area or other feature for detention storage capacity shall clearly identify the limits and depths of the proposed detention pool.
  3. Basin configurations which create stagnant water conditions shall be avoided.
  4. Post-development discharge rates shall not exceed pre-development discharge rates for the 2, 10, and 25-year frequency 24-hour duration storm events. The same hydrologic procedures shall be used in determining both the pre-development and post-development peak flow rates.
  5. Post-development discharge velocities shall be reduced to provide non-erosive flow velocities from structures, channels or other control measures, or equal the pre-development 10-year 24-hour storm event flow velocities, whichever is less.
  6. The volume within any structure used for water quantity control shall be drained from the structure within 72 hours.

### **3.3.4 Infiltration Devices**

1. Infiltration devices shall be required on those sites which do not currently discharge stormwater runoff or have no existing outlet. In such cases, in the post-development condition, devices shall be designed to infiltrate the runoff volume equivalent to the



5-year storm event. For evaluating the 10-year and 25-year storm events, the discharge rate from the site shall be limited to (not exceed) that of a site of equivalent size and slope with a SCS Curve Number equal to 39. As with detention ponds, the response of the system to the 100-year storm event must be analyzed, but only to the extent that no structure flooding or damage results. The following other criteria, based primarily on SC Code of Regulation Section 72-307.C requirements, shall be followed in the design of infiltration systems:

- a. Infiltration device design shall be based on soils characteristics of the first twelve (12) inches below the proposed bottom of the device (not necessarily the first twelve (12) inches below ground surface).
- b. Areas draining to these devices must be stabilized and vegetative filters established prior to runoff entering the system. Infiltration practices shall not be used if a suspended solids filter system does not accompany the device. If vegetation is the intended filter, there shall be, at least a twenty (20) foot length of vegetative filter prior to stormwater runoff entering the infiltration device. Forebays or other engineered devices for sediment removal may be prudent.
- c. Each system shall be designed to prevent clogging by fine material and for ease of maintenance.
- d. The bottom of the infiltration devices shall be at least 0.25 feet above the “zone of seasonal saturation” and infiltration interface.
- e. The infiltration device shall be designed to completely drain of water within 72 hours.
- f. Soils must have adequate permeability to allow water to infiltrate. Infiltration devices are limited to soils having an infiltration rate of at least 0.30 inches per hour. If the infiltration rate is greater than 0.3 but less than 2.0 inches/hour, then an underdrain system must be installed. Initial consideration will be based on a review of the appropriate soil survey, and proposed depths of excavation. The survey may serve as a basis for rejection. On-site soil borings and textural classifications must be accomplished to verify the actual site and seasonal high water table conditions when infiltration is to be utilized.
- g. Infiltration devices greater than three (3) feet deep shall be located at least twenty-five (25) feet from basement walls.
- h. Infiltration devices designed to handle runoff from areas with a high runoff potential shall be a minimum of one hundred fifty (150) feet from any public or private water supply well.
- i. The design of an infiltration device shall have a properly sized overflow or bypass for larger storm events. Measures to provide a non-erosive velocity of flow along its length and at the outfall shall also be included as necessary.



Additional control devices will typically be necessary prior to a release to a watercourse to meet water quality requirements.

- j. The slope of the bottom of the infiltration device shall not exceed five (5) percent. Also, the practice shall not be installed in fill material as piping along the fill/natural ground interface may cause slope failure.
- k. An infiltration device shall not be installed on or atop a slope whose natural or existing angle of incline exceeds twenty (20) percent.
- l. If an underdrain system is required, clean outs will be provided at a minimum, every one hundred (100) feet along the infiltration device to allow for access and maintenance.
- m. In cases where such criteria or limitations make the use of infiltration devices inappropriate, but no discharge currently leaves a given site, runoff control must be provided by some other measure. The Public Works Director shall be contacted for guidance on the appropriate controls to employ or other mutually accepted best management practices.

### **3.3.5 Water Quantity Design/Construction References**

1. Construction shall conform to the latest version of SCDOT's *Standard Specification Manual for Highway Construction*, for publicly maintained systems.
2. Guidance on the design, installation, and maintenance of stormwater quantity facilities can be found in Paine, J., and Akan, A., (2001), ASCE & WEF (1994), and Mays (2001).

### **3.3.6 Accepted Water Quantity Controls**

Detention structural controls are used for providing water quantity control and are typically used downstream of other minor structural controls. These structures are designed to provide channel protection, overbank flood protection, and protection against adverse downstream impacts that are related to the increase in peak flow rates and flow volumes from a land disturbing activity development. Structural detention stormwater controls accepted by City of North Charleston are shown in Table 3.4.



Table 3.4: Accepted Water Quantity Controls

General Structural Control	Description
<b>Dry Detention/Dry Extended Basins</b>	Dry detention basins and dry extended detention basins are surface storage facilities intended to provide temporary storage of stormwater runoff and releasing it at a designed flow rate to reduce downstream water quantity impacts. These structures are designed to completely drain to a dry condition within 72 hours.
<b>Wet Storm Water Detention Basins</b> <ul style="list-style-type: none"> <li>• Wet Pond</li> <li>• Wet Extended Detention Pond</li> <li>• Micropool Extended Detention Pond</li> <li>• Multiple Pond System</li> </ul>	Wet detention basins are constructed stormwater basins that have a permanent pool or micropool of water. Runoff from each rain event is detained above the permanent pool and released at a designed flow rate to reduce downstream water quantity impacts. Permanent pool depths must be $\geq 3$ feet to prevent mosquito breeding.
<b>Multi-purpose Detention Areas</b>	Multi-purpose detention areas are used for one or more specific activities such as parking areas and rooftops. These areas are used to provide temporary storage of runoff. Some of the multi-purpose areas such as infiltration trenches or bio-retention cells may also be used for water quality purposes.
<b>Underground Detention</b>	Underground detention is used as an alternative to surface dry-detention basins. They are used in areas that are space-limited where there is not enough adequate land to provide the required detention volume. Underground storage utilizes tanks, vaults, and buried pipes to supply the required storage volume.
<b>Infiltration Basins</b>	Infiltration basins are used to remove runoff from the flow path into the ground. They are used in areas that currently do not discharge stormwater or create runoff only during large storm events.

### 3.3.7 Standard Water Quantity Design Procedures

This section provides the general procedures for the design of stormwater quantity structures. The following items shall be required for the design of these structures and routing flows through them:

1. Compute the inflow hydrograph for the structure for the 2 and 10-year 24-hour storm events for both the existing and proposed conditions. From this, determine peak flow rates for each storm.
2. Compute a stage-storage relationship for the proposed structure. A stage storage-curve defines the relationship between the depth of water and storage volume within the detention facility.



3. Compute stage-discharge relationship of the outlet control structure(s). A stage-discharge curve defines the flow capacity of a structure at a given stage or elevation.
4. Perform routing calculations for the 2 and 10-year 24-hour storm events. Calculations may be done by hand, or may be done by using a storage routing computer model.
5. Determine the cumulative volume at the 24-hour point released from the facility.
6. Compare the two volumes and two peak discharges. The volume released from the pond after 24 hours should be at or below that for pre-development conditions. The peak discharge rate from the pond should be at or below the peak discharge rate for the pre-development condition for the 2 and 10-year storm events. Check to make sure the discharge hydrograph from the 100-year storm event does not overtop the banks of the facility.
7. Evaluate the control structure outlet flow velocity and provide velocity control and channel stabilization if needed. Drawings and details should be provided for outlet structures and basins.
8. Repeat Steps 1-7 for post-development condition until peak, volume, and velocity criteria are met.
9. Provide all calculations in submittal package in a cohesive, organized, and easy to follow format.

Stage-storage and stage-discharge calculations should be included in the engineering calculations. Common methodologies for stage-storage curves include the double end area method and the pyramid frustum method. Other methods will be accepted upon justification.

Hand calculations are available for routing hydrographs through detention structures, however they are time consuming and inefficient when multiple designs are required to be evaluated. For this Manual, it is assumed that the design professional will be using one of the many computer software packages available to perform storage routing calculations. All models/methodologies used must be approved by the City of North Charleston. A list of accepted models to date includes, but is not necessarily limited to:

- ICPR
- Drain:Edge
- PondPack/Civil Storm
- HEC-HMS
- HYDRAFLOW
- HydroCad
- SWMM



## **3.4 Water Quality Control Standards**

Water quality control is an integral and required component of overall stormwater management systems. New development and redevelopment projects must now include controls that treat or otherwise limit the discharge of pollutants. These requirements have been added due to new state and federal requirements, but also due to the need to improve and preserve the water resources in City of North Charleston. Because this is a requirement of stormwater design, some background information and references are provided in the sections below, followed by the design standards for addressing water quality.

### **3.4.1 Characterization of Urban Storm Water Runoff Quality**

This section provides some background information on the major sources of pollutants commonly found in stormwater flows and those that impact City waterbodies. In Table 3.5, these sources and the pollutants most commonly associated with them are presented. This is followed by a detailed discussion of the most common pollutants found in stormwater discharges.



Table 3.5: Typical Stormwater Pollutants and Sources

Pollutant Source	Pollutants of Concern
<b>Erosion</b>	Sediments and attached soil nutrients (numerous nitrogen and phosphorus forms), organic matter, and other adsorbed pollutants.
<b>Atmospheric Deposition</b>	Hydrocarbons emitted from automobiles, dust, metals, nutrients, and other chemicals released from industrial and commercial activities.
<b>Roadways/Transportation related areas</b>	Hydrocarbons emitted from automobiles, dust, metals,
<b>Construction Sites</b>	Sediment, metals, paint, and wood preservatives.
<b>Manufactured Products (Industrial land uses)</b>	Heavy metals, phenols, and oils from automobiles, Zinc and Cadmium from tire wear.
<b>Lawn and Landscape Maintenance</b>	Fertilizer and pesticides.
<b>Plants and Animals</b>	Plant debris, animal excrement.
<b>Septic Tanks</b>	Coliform bacteria, nitrogen, NO <sub>3</sub> .
<b>Non-Storm Water Connections</b>	Sanitary sewage, industrial wastewater, commercial discharge, and construction activities.
<b>Accidental Spills</b>	Pollutants of concern depend on the nature of the spill.
<b>Animal Waste Management</b>	Coliform bacteria, nitrates, and phosphorus.
<b>Pesticide Applications</b>	Pollutants of concern depend on the pesticide being used and the type of crop or pest being treated.
<b>Land Disturbance Agriculture</b>	Sediment and attached soil nutrients, organic matter, and other adsorbed pollutants.
<b>Fertilizer Applications</b>	Nitrogen and phosphorus.

Source: U.S. Environmental Protection Agency, June 1992.



### 3.4.1.1 Suspended Solids

The most prevalent form of stormwater pollution is the presence of suspended matter that is either eroded by stormwater or washed off paved surfaces by stormwater. Suspended solids increase the turbidity of the receiving water, thereby reducing the penetration of light, resulting in decreased activity and growth of photosynthetic organisms. The increased turbidity also detracts from the aesthetics of natural waters. In addition, the clogging of fish gills has been attributed to the presence of suspended solids. Combined sewer overflows typically contain high suspended solids concentrations. The solids that settle in the receiving water pose long-term threats resulting from their oxygen demand and gradual accumulation of toxic substances (Moffa, 1990), as well as reducing primary production. Sedimentation and other forms of physical separation are often an effective means of removing suspended solids from stormwater.

Sediment is derived from a variety of sources, including erosion from disturbed areas, washoff of sediment deposited on impervious areas, and detachment of sediment due to the increased stream power that comes from increased flow rates and flow durations with urbanization. A significant number of models are available to predict total suspended solids (TSS) contributions from “clean” sediment, but few of the models have parameters specific to urbanized areas. Most of the models were developed to deal with agricultural soils, and their application to urban areas is limited.

Models that do have capabilities that have been used for predicting urban sediment include SWMM, SWAT, and SEDPRO models. For the models to be effectively utilized in sizing BMPs, predictions must be made of time varying quantities as well as the size distribution. Those distributions must be of the aggregated particles, not just the primary particles.

### 3.4.1.2 Oxygen Demanding Matter and Bacteria

Sufficient levels of dissolved oxygen (DO) in the water column are necessary to maintain aquatic life, growth, and reproductive activity, as well as to maintain aerobic conditions. The introduction of stormwater containing oxygen-demanding organic matter can impair the receiving water quality by reducing the DO levels such that it is unable to sustain certain forms of aquatic life and can further cause the water to become foul. Bacteria enter the stormwater drainage systems typically from the runoff of animal feces and organic matter from the catchment surface, possibly even disturbed soil. Bacteria also may enter the stormwater system and ultimately natural waters through leaking sewer systems (lateral connections, manholes, and industrial or commercial drains, etc.) and malfunctioning septic systems, all of which are termed illicit discharges and illegal by the City of North Charleston Stormwater Management Ordinance. Organic matter, usually in the form of vegetation and detritus, is carried through the conveyance system by the stormwater. Pathogenic bacteria and viruses in stormwater discharges pose human health threats. The removal of pathogenic bacteria is achieved primarily through the process of biological decay and physical-chemical disinfection where practiced. Presence of such bacteria is assumed based on the detection of indicator bacteria such as fecal coliforms or E-coli. The reduction of bacteria in waters of the State has been the focus of TMDL efforts by SCHDEC to date.



### 3.4.1.3 Nutrients

Nitrogen and phosphorus are plant nutrients that promote the growth of plants such as algae, and are the second leading stressor of impaired rivers and streams and the leading source of pollution in impaired lakes (US EPA, 1997). Such nutrients contribute to the eutrophication of water bodies which can result in decreased oxygen supply, alteration of aquatic life and decreased recreational value (Novotny, 1985).

Nutrients are typically derived from agricultural runoff as well as runoff from chemicals applied to lawns in urbanized areas, runoff from industrial sites, municipal wastewaters (of more concern for combined sewer overflows), or atmospheric deposition onto impervious surfaces that is later washed into stormwater. Model studies indicate that the increase in nutrient loading due to increased imperviousness will be dramatic. For example, the increase in the Maryland Chesapeake Bay watershed due to increased urbanization is expected to range from 2 to 20 times the current load, depending on whether residential development is highly restricted or unrestricted (Houlahan, 1992). Nutrients can be removed from stormwater prior to discharge through biological uptake such as by plantings in stormwater quality control ponds.

Most models of nutrient loadings that have an extensive data base included have been based on agricultural and forest operations. These have applicability to washoff from fertilized lawns and forested areas but not to the impervious areas. Models of nutrient loading in urban runoff are typically based on washoff type calculations or user-defined loadings and concentrations, all of which require user-defined constants and are relatively simplistic. A relatively new model called IDEAL, has additional treatment procedures for nutrient loads and removal using isothermic relationships that define adsorbed to dissolved nutrient ratios.

### 3.4.2 Accepted Water Quality BMPs

In selecting a BMP(s), it is most important to know what pollutants need to be removed, how to remove them, and what degree of removal is needed to meet water quality goals. There are many other project-specific considerations, however, with the proper planning, installation, and maintenance, BMPs are expected to reduce pollutant loads to receiving waters, reduce erosion, provide health and safety benefits, and be cost effective.

The varieties of water quality BMPs are numerous and are typically considered either structural or non-structural. The City of North Charleston's current approved list of stormwater quality BMPs, listed in Table 3.7, are based on literature reviews and experience. Some references to BMP selection, effectiveness, and design can be found in SCDHEC (2005), Agricultural Resource Council (2001), Schueler (1987), and Water Environment Foundation (WEF) & American Society of Civil Engineers (ASCE) (1998). Guidance on applying BMPs into Low Impact Development (LID) approaches can be found in Prince George City (1999 a and b).



Table 3.6. Average Pollutant Concentrations for Various Land Uses (mg/l)

Land Use	Pollutant Concentration (mg/l)											
	BOD	COD	TSS	TDS	TP	DP	TKN	NO <sub>2</sub> / NO <sub>3</sub>	Pb	Cu	Zn	Cd
<b>Forest/ Rural Open</b>	3	27	51	415	0.11	0.03	0.94	0.80	0.000	0.000	0.000	0.000
<b>Urban</b>	3	27	51	415	0.11	0.03	0.94	0.80	0.014	0.000	0.040	0.001
<b>Agricultural/ Pasture</b>	3	53	145	415	0.37	0.09	1.92	4.06	0.000	0.000	0.000	0.000
<b>Low Density Residential</b>	38	124	70	144	0.52	0.27	3.32	1.83	0.057	0.026	0.161	0.004
<b>Medium Density Residential</b>	38	124	70	144	0.52	0.27	3.32	1.83	0.180	0.047	0.176	0.004
<b>High Density Residential</b>	14	79	97	189	0.24	0.08	1.17	2.12	0.041	0.033	0.218	0.003
<b>Commercial</b>	21	80	77	294	0.33	0.17	1.74	1.23	0.049	0.037	0.156	0.003
<b>Industrial</b>	24	85	149	202	0.32	0.11	2.08	1.89	0.072	0.058	0.671	0.005
<b>Highways</b>	24	103	141	294	0.43	0.22	1.82	0.83	0.049	0.037	0.156	0.003
<b>Water/ Wetlands</b>	4	6	6	12	0.08	0.04	0.79	0.59	0.011	0.007	0.003	0.001

Adapted from NURP (1983), Horner et. al (1994), and Cave et. Al. (1994)

- |                                 |  |
|---------------------------------|--|
| BOD = Biochemical Oxygen Demand | TKN = Total Kjeldahl Nitrogen                          |
| COD = Chemical Oxygen Demand    | NO <sub>2</sub> /NO <sub>3</sub> = Nitrates / Nitrites |
| TSS = Total Suspended Solids    | Pb = Lead  |
| TDS = Total Dissolved Solids    | Cu = Copper  |
| TP = Total Phosphorus           | Zn = Zinc  |
| DP = Dissolved Phosphorus       | Cd = Cadmium   |

Fecal coliform (FC) concentrations were not provided in the table above due to the large variability. Guidance from SCHDEC and NURP (1983) should be sought when estimating existing and post-development bacteria loads and the reduction requirements.



Table 3.7: Accepted Water Quality Controls

General Structural Control	Description
<b>Dry Ponds</b>	Dry stormwater ponds are constructed stormwater basins that do not have a permanent pool. The bottom of the pool must be sloped toward the outfall to prevent mosquito breeding areas.
<b>Wet Ponds</b>	Wet stormwater ponds are constructed stormwater basins that have a permanent pool or micropool of water. Runoff from each rain event is detained and treated in the pool, and released at a designed rate.
<b>Storm Water Wetlands</b>	Stormwater wetlands are natural or constructed systems used for stormwater management. Stormwater wetlands consist of a combination of shallow marsh areas, open water and semi-wet areas above the permanent water surface.
<b>Bioretention Areas</b>	Bioretention areas are shallow stormwater basins or landscaped areas that utilize engineered soils and vegetation to capture and treat stormwater runoff. Runoff may be returned to the conveyance system or partially exfiltrate into the soil.
<b>Sand Filters</b>	Sand filters are multi-chamber structures designed to treat stormwater runoff through filtration, using a sand bed as its primary filter media. Filtered runoff may be returned to the conveyance system or partially exfiltrated into the soil.
<b>Infiltration Trenches</b>	An infiltration trench is an excavated trench filled with stone aggregate used to capture and allow infiltration of stormwater runoff into the surrounding soils from the bottom and sides of the trench.
<b>Enhanced Grassed Swales</b>	Enhanced swales are vegetated open channels that are explicitly designed and constructed to capture and treat stormwater runoff within dry or wet cells formed by check dams or other structures.
<b>Engineered Devices</b> <ul style="list-style-type: none"> <li>• Vortex Separator</li> <li>• Baffles</li> <li>• Cartridges</li> <li>• Skimmers</li> <li>• Bioretention</li> <li>• Gravity Oil-Grit Separator</li> <li>• Filter Material</li> <li>• Inlet inserts</li> </ul>	Pre-fabricated controls use the movement of stormwater runoff through a specially designed structure to remove target pollutants. They are typically used on smaller commercial sites and urban hotspots. There are numerous commercial vendors of these structures, but there is limited data on the performance of these structures. Until further research is done and substantial removal efficiencies are published, these structures may require monitoring. Some of the popular vendors/products include, but are not limited to, Crystal Stream, Vortech, Aquashield, Filterra, Stormceptor, Stormfilter, CDS, BaySaver, and Downstream Defender <sup>1</sup> . This is by no means a complete list and the City's Public Works Director will evaluate any such device if included in designs, provided evidence is submitted as to their effectiveness. Such evidence must include applicability and proof of third-party testing on trapping efficiencies.

<sup>1</sup> This list is not intended as preference for these devices nor to exclude others.

Some structural BMPs have limited applications and are recommended to be used in conjunction with other BMPs. Limited application controls may be used within a system of water quality controls and are very effective pre-treatment structures for the controls listed in Table 3.7.



Limited application structural controls should be designed and used only in development situations where regular maintenance is guaranteed. Some popular limited stormwater controls are shown in Table 3.8.

Table 3.8: Limited Structural Controls

Limited Structural Control	Description
<p><b>Vegetated Filters</b></p> <ul style="list-style-type: none"> <li>• Filter Strip</li> <li>• Grassed Channels and Swales</li> </ul>	<p>Both filter strips and grassed channels provide filtering of stormwater runoff as it flows across the vegetation. However, by themselves these controls do not consistently obtain adequate sediment and pollutant removal. Both filter strips and vegetated channels shall be used as pretreatment measures or part of a treatment system approach.</p>
<p><b>Submerged Gravel Wetland Systems</b></p>	<p>Submerged gravel wetlands use wetland plants in a submerged gravel or crushed rock media to remove stormwater runoff pollutants. These systems should only be used in mid- to high- density environments where other structural controls will be utilized.</p>
<p><b>Small Sand Filters</b></p> <ul style="list-style-type: none"> <li>• Surface Sand Filter</li> <li>• Perimeter Sand Filter</li> </ul>	<p>Sand filters are multi-chamber structures designed to treat stormwater runoff through filtration, using a sand bed as its primary filter media. Filtered runoff may be returned to the conveyance system or partially exfiltrated into the soil.</p>
<p><b>Porous Pavement / Paver Systems</b></p>	<p>Porous paver systems consist of open void paver units laid on gravel subgrade to promote stormwater infiltration. Porous pavers provide water quality and quantity benefits.</p>

Regardless of the type of control, maintenance schedules should be included for each BMP proposed.

Listed below are some non-structural BMPs that should be considered for use in larger construction activities and re-development projects.

1. **Buffers:** an area along a shoreline, wetland, or stream where development is restricted or prohibited. The primary function of the buffer is to physically protect and separate a stream, lake, or wetland from future disturbance or encroachment.



2. Disconnected roof drains/impervious areas: directing stormwater runoff from rooftops towards pervious areas where it is allowed to filter through vegetation and other landscaped material and infiltrate into the soil.
3. Grass/Porous pavements: allows for the reduction of paved areas by implementing areas that are infrequently used, providing water quality benefits through increased infiltration. Should be avoided in high traffic areas
4. Cluster development: concentrate development away from environmentally sensitive areas such as streams, wetlands, mature wooded areas, and steep slopes.
5. Literature for owners, and Homeowners Associations (HOAs) to educate and train themselves on the impact they can have on water quality and the activities necessary to maintain structural controls. These efforts are particularly critical in Low Impact Development (LID) designs.

### **3.4.3 Water Quality Design Standards**

#### **3.4.3.1 General Standards**

The following design criteria are established for water quality control and must be incorporated in one or more BMPs for a given subbasin unless a specific quality waiver is granted by the City's Public Works Director. Incorporation of these requirements shall constitute adequate control of the discharge of pollutants.

1. All sites which disturb one (1) acre or greater shall include best management practices (BMPs) to address water quality, along with an Operation and Maintenance Agreement that guarantees maintenance of all BMPs in perpetuity.
  - a. All permanent water quality ponds having a permanent pool shall be designed to store and release a water quality volume (WQV) defined as the first one-half (1/2") inch of runoff (First Flush) over a 24 hour period. The "first flush" volume should be determined from the contributing watershed area (impervious and pervious) that drains to the water quality pond (s).
  - b. Permanent water quality ponds, not having a permanent pool, shall be designed to store and release the first 1-inch (1") of runoff from the contributing watershed area over a minimum period of 24-hours.
  - c. For areas not draining to a pond, it should be demonstrated how permanent water quality requirements will be addressed.
2. The WQV requirement may be waived if treatment is instead provided by engineered devices. Applicability of such waivers will be based on submitted information showing that the device(s) has a design pollutant removal efficiency equivalent to a "dry" pond with a WQV of 1-inch.



3. BMPs used strictly for water quality that will be capturing one (1) or more acres shall have a pretreatment device as part of the BMP or treatment system, such as a forebay or vault, to remove debris and coarser sediments.
4. Projects that discharge either directly or indirectly into an impaired waterbody as determined by the existence of an adopted TMDL by SCDHEC or through SCDHEC's listing of the waterbody on the latest 303(d) list shall be required to reduce pollutant loads so as to meet applicable water quality standards. More background information is covered in Section 3.8 – Special Protection Areas. This will require the installation and implementation of measures (structural or non-structural BMPs) which are expected to adequately reduce pollutant loads to levels required by the TMDL (currently expressed as % reductions) or to prevent further impairment. A list of approved water quality devices was provided in the previous section.

If the site disturbs less than 25 acres, an evaluation of the BMPs chosen to control the release of pollutants must be provided. Such evaluations may reference published values on BMP effectiveness. For projects that disturb 25 acres or more, a quantitative and qualitative analysis shall be provided and include, at a minimum, calculations that show:

- a sites pollutant load for all pollutants of concern (see Table 3.5),
  - the trapping effectiveness of the chosen BMPs, and
  - that the runoff discharged through the last water quality BMP has a water quality level equal to or better than the in-stream standard or as required by an applicable TMDL.
5. All BMPs must have a maintenance plan. Suggested schedules and routine activities are provided in the BMP Manual (SCDHEC 2005).
  6. The City's Public Works Director reserves the right to require specific effluent limits for any pollutant from a site if necessary to ensure the water quality standards and other state and federal water quality regulations are met.

### **3.4.3.2 Typical Water Quality Design Procedures**

1. Determine an appropriate, accepted BMP(s) needed for the site, considering the land use, pollutants of concern (Table 3.5), soils, maintenance requirements, and location in relation to waters of the State and any impairments that may exist.
2. If the receiving water of the project is impaired or has an adopted TMDL, the applicant must show that water quality standards are being met and designated uses are not impacted. This proof must be quantitative and qualitative for sites which disturb greater than 25 acres (see Section 3.4.3.1.6). The appropriate steps include:
  - a. Calculate the estimated load for the pollutant(s) of concern. The IDEAL model may be used for all water quality calculations. Another, less preferred option is



the Schuler Simple Method (Schueler 1987). This method is based on an extensive database obtained in Washington, D.C. for the National Urban Runoff Program (NURP). The Simple Method estimates pollutant loads from urban development by the following equation:

$$L = 0.227(Q P_j R_v C A) \quad \text{Equation 1}$$

Where:

- L** = Pollutant load in pounds per desired time interval,
- Q** = Runoff depth,  
½-inch for wet ponds, some wetlands,  
1-inch for all other BMPs,
- P<sub>j</sub>** = Fraction of rainfall events over the time intervals that produce runoff  
P<sub>j</sub> = 1 for a single event  
P<sub>j</sub> = 0.9 for larger time intervals (months, years),
- R<sub>v</sub>** = Volumetric runoff coefficient expressing the fraction of rainfall converted to runoff (See Equation 2),
- C** = Event mean pollutant concentration in mg/l (See Table 3.6),
- A** = Total area of site in acres (areas < 640 acres are recommended for this method).

The most important factor affecting the volumetric runoff coefficient (**R<sub>v</sub>**) is the imperviousness of the watershed, **I**, in percent. An empirical relationship was developed that relates **R<sub>v</sub>** and **I** as:

$$R_v = 0.05 + 0.09(I) \quad \text{Equation 2}$$

The rainfall depth, **P**, was chosen such that a large percentage of storm events will be captured, with larger events only partially captured or bypassed. Greater than 85% of the average annual rainfall amount in the City of North Charleston occurs from storm events with a total depth equal to or greater than 1-inch. The 1-inch of runoff from pervious areas is the result of approximately 4.5-inches of total rainfall, but it only takes a rainfall of 1.2 inches on impervious surfaces.

Other loading modules, such as in SEDPRO and SEDCAD for eroded particles or common buildup and washoff equations may be used.

- b. Select appropriate BMPs from Tables 3.7 and the BMP Uses tables in Appendix D. The use of an engineered device would require documentation to demonstrate its equivalency in meeting water quality criteria.



- c. Compute BMP effectiveness for removing pollutants of concern, showing at a minimum that the concentration of the pollutants of concern from the last BMP meets applicable water quality standards.
3. If the BMP is to capture runoff from one (1) or more acres, design a forebay or vault. Guidance on this aspect can be found in SCDHEC (2005) and ARC (2001).
4. Calculate the water quality volume using the following equation.

$$WQV = \frac{Q * DA}{12} \qquad \text{Equation 3}$$

Where:

- WQV** = water quality volume (acre-feet)
- Q** = runoff depth inches (one-half inch (1/2”) for permanent pool (“wet”) structures, one inch (1”) for dry structures, one and one-half inches (1-1/2”) if project is within 1,000 feet of a shellfish bed)
- DA** = drainage area to water quality BMP (acres). Runoff from the entire site must be captured in a water quality BMP, unless otherwise allowed by the City’s Public Works Director.

5. Compute the inflow hydrograph for the structure for one inch (1”) or one-half inch (1/2”), 24-hour storm event, as necessary, for the proposed condition. Note – this is the one inch (1”) **runoff** event.
6. Unless already known from the quantity calculations detailed in section 3.3.2, compute stage-storage and stage-discharge relationships of the outlet control structure(s).
7. Perform routing calculations for the one inch (1”) or one-half inch (1/2”), 24-hour storm event through the BMP. These may be done by hand, or may be done by using a storage routing computer model.
8. Determine if the entire volume from the one inch (1”) or one-half inch (1/2”), 24-hour storm event was released before the 24-hour point. If it does, the outlet is too large. Resize outlet structure.
9. Repeat steps 4-8 until entire volume is not released prior to 24-hours. This procedure is commonly accomplished using a low-flow orifice and the two-year discharge level is not reached.
10. For engineered devices, alternative calculations other than detailed here should be provided. SCDHEC has accepted some such devices as providing adequate treatment as compared to capturing and detaining the one inch (1”) storm event.
11. Provide all calculations in the submittal package in a cohesive, organized, and easy to follow format.



## **3.5 Erosion Prevention and Sediment Control Standards**

City of North Charleston requires that an erosion prevention and sediment control (EPSC) plan be submitted and approved for construction activities that result in land disturbance of equal to or greater than one (1) acre (Type II or III Application). This plan shall describe the practices and controls that will be used during and after construction to meet the following goals:

1. Minimization of the extent and duration of disturbed soil exposure,
2. Prompt stabilization of disturbed areas,
3. Protection of off-site and downstream locations, drainage systems and natural waterways from the impacts of erosion and sedimentation,
4. Limitation of the exit velocities of the flow leaving the site to non-erosive or pre-development conditions, and
5. Design and implementation of an ongoing inspection and maintenance plan.

### **3.5.1 Accepted EPSC BMPs**

The various types of EPSC BMPs that are acceptable for use in the City of North Charleston are presented below. These generally fall into three categories: erosion prevention measures, temporary sediment controls, and runoff control and conveyance measures. Runoff from sites should contain controls that fall into at least one of these categories.

#### **3.5.1.1 Erosion Prevention Measures**

Erosion prevention measures shall be used during and after construction site preparation to avert the discharge of runoff highly concentrated with sediment and other associated pollutants. One or more measures are typically needed on a given site. Measures that fall into this category along with their preferred application are provided in Table 3.9. Details on each of these measures are not discussed in this Manual. Guidance documents that should be referenced as necessary include: SCDHEC (2003), Haan, C. T., Barfield, B. J., and Hayes, J. C. (1995) and Shwab, Glenn O. and Richard K. Frevert (1985). Other practices, such as engineered devices, will be allowed as long as sufficient evidence is presented as to their effectiveness. Standard details can be found in Appendix I.



Table 3.9 Erosion Prevention BMP Suggested Uses

BMP	Slope Protection	Waterway Protection	Surface Protection	Enclosed Drainage	Large Flat Areas	Borrow Areas	Adjacent Properties
Erosion Prevention Measures	X	X	X	X	X	X	X
Surface Roughening	X		X				
Bench Terracing	X		X				
Temporary Seeding	X		X		X	X	X
Mulching	X				X	X	
Erosion Control Blankets (ECB) and Turf Reinforcement Mats (TRM)	X	X	X			X	
Final Stabilization	X		X		X		X
Topsoiling			X		X		
Permanent Seeding and Planting of Grasses	X		X		X		X
Permanent Ground Cover Plants	X		X				X
Sodding	X		X		X		X
Riprap or Aggregate	X	X	X				
Outlet Protection		X		X			X
Dust Control					X	X	X
Polyacrylamide (PAMs)	X		X	X	X	X	X

### 3.5.1.2 Temporary Sediment Control Measures

The City of North Charleston emphasizes preventative measures as the main control to protect against erosion, both during and following construction. However, there are typically instances where erosion prevention measures alone do not provide sufficient control. For these situations, temporary sediment controls shall be implemented to control the migration of eroded sediment off site. The sediment control measures are typically only applicable as practices for use during construction. One or more of the measures should be utilized as appropriate during the project's construction phase. Table 3.10 contains a list of some of the suggested controls of this type along with their intended use. Details on these and others measures are located in Appendix I. Additional information can be found in Haan, Barfield, and Hayes (1995) and the SCDHEC BMP Handbook. Other practices, such as engineered devices, will be allowed as long as sufficient evidence is presented as to their effectiveness.



Table 3.10 Temporary Sediment Control BMP Suggested Uses

BMP	Slope Protection	Waterway Protection	Surface Protection	Enclosed Drainage	Large Flat Areas	Borrow Areas	Adjacent Properties
Temporary Sediment Control Structures	X	X	X	X	X	X	X
Storage Volumes and Maintenance Schedules		X		X			X
Temporary Sediment Basin		X	X	X			X
Multipurpose Basin		X	X	X			X
Temporary Sediment Trap		X	X				X
Silt Fence	X	X					X
Rock Ditch Check			X				X
Stabilized Construction Entrance					X		X
Storm Drain Inlet Protection		X		X			X
Vegetated Filter Strips		X					X
Rock Sediment Dike		X	X				X

### 3.5.1.3 Runoff Control and Conveyance Measures

This category of EPSC BMPs should be used as necessary during and following construction. Suggested varieties and their corresponding uses are provided in Table 3.11.

Table 3.11 Runoff Control and Conveyance Measure BMP Suggested Uses

BMP	Slope Protection	Waterway Protection	Surface Protection	Enclosed Drainage	Large Flat Areas	Borrow Areas	Adjacent Properties
Pipe Slope Drains	X		X				
Temporary Stream Crossing		X	X				X
Runoff Conveyance Measures	X					X	X
Construction De-watering		X		X	X	X	
Level Spreader			X		X		X
Subsurface Drains			X		X		



### **3.5.1.4 Temporary Vegetation/Seeding**

#### **Description**

The purpose of temporary seeding is to reduce erosion and sedimentation by stabilizing disturbed areas that would otherwise lay bare for long periods of time before they are worked or stabilized. Temporary seeding is also used where permanent vegetation growth is not necessary or appropriate.

#### **When and Where to Use**

Temporary seeding is used on exposed soil surfaces such as denuded areas, soil stockpiles, dikes, dams, banks of sediment basins, banks of sediment traps and temporary road banks. Temporary seeding prevents and limits costly maintenance operations on sediment control devices. Cleanout requirements for sediment basins, sediment traps and silt fence is reduced if the drainage area is seeded when grading and construction operations are not taking place.

Temporary stabilization is required within fourteen (14) days after construction activity is complete unless construction activity is going to resume within 21 days. Cover seeded areas with an appropriate mulch to provide protection from the weather. When the temporary vegetation does not grow quickly or thick enough to prevent erosion, re-seed as soon as possible. Keep seeded areas adequately moist. Irrigate the seeded areas if normal rainfall is not adequate for germination and growth of seedlings. Water seeded areas at controlled rates that are less than the rate at which the soil can absorb water to prevent runoff. Runoff of irrigation water wastes water and can cause erosion.

#### **Plant Selection**

Plant seed selection should be based on the type of soil and the season of the year in which the planting is to be done. Tables 3.12 and 3.13 should be used if you plan to use conventional tillage methods (plowing, seedbed preparation, hydroseeding, etc). If you need a fast growing crop to nurse your permanent species, then use the mix rate. Failure to carefully follow agronomic recommendations often results in an inadequate stand of temporary vegetation that provides little or no erosion control.

#### **Tillage**

If the area has been recently plowed, no tillage is required other than raking or surface roughening to break any crust that has formed and to leave a textured surface. If the soil is compacted less than 6-inches, it should be disked for optimal germination.

#### **Soil Testing**

Information on soil testing is available from the Clemson University Home and Garden Information Center at (888) 656-9988 or at <http://hgic.clemson.edu>.



## **Lime**

Lime is not required for temporary seeding unless a soil test shows that the soil pH is below 5.0. It may be desirable to apply lime during the temporary seeding operation to benefit the long-term permanent seeding. Apply a minimum of 1.5 tons of Lime/acre (70 pounds per 1000 square feet) if it is to be used.

## **Fertilizer**

A minimum of 500 pounds per acre of 10-10-10 fertilizer (11.5 pounds per 1000 square feet) or equivalent should be applied during temporary seeding unless a soil test indicates a different requirement. Fertilizer and lime (if used) should be incorporated into the top 4-6 inches of the soil by disking or other means where conditions allow.

## **Seeding**

The surface of the soil should be loosened just before broadcasting the seed. Seed should be applied evenly by the most convenient method available for the type of seed to be used and the location of the temporary seeding. Typical application methods include but are not limited to cyclone seeders, rotary spreaders, drop spreaders, broadcast spreaders, hand spreaders, cultipacker seeder, and hydro-seeders. Cover applied seed by raking or dragging a chain, and then lightly firming the area with a roller or cultipacker.

## **Mulching**

Mulch should be used in seeded areas to retain soil moisture and reduce erosion during establishment of vegetation. The most commonly accepted mulch used in conjunction with temporary seeding is small grain straw. This straw should be dry and free from mold damage and noxious weeds. The straw may need to be anchored with netting or emulsions to prevent it from being blown or washed away. The straw mulch may be applied by hand or machine at the rate of 1.5 - 2 tons per acre (90 pounds per 1000 square feet). Frequent inspections are necessary to check that conditions for growth are good.

## **Irrigation**

Seeded areas should be kept adequately moist. Irrigate the seeded area if normal rainfall is not adequate for the germination and growth of seedlings. Water seeded areas at controlled rates that are less than the rate at which the soil can absorb water to prevent runoff. Runoff of irrigation water wastes water and can cause erosion.

## **Re-seeding**

Areas where the plants do not grow quickly, thick enough, or adequately to prevent erosion should be re-seeded with temporary grasses as soon as such areas are identified.



**Table 3.12 Temporary Vegetation Schedule**

Species	Rates (lbs/acre)	Optimum Dates to Plant	Remarks
Browntop Millet (Alone)	40	April 20 - August 15	Quick, Dense Cover
Browntop Millet (Mix)*	10	April 20 - August 15	Quick, Dense Cover
Rye Grain (Alone)	56	February - March, August 15 - November 20	Quick Cover
Rye Grain (Mix)*	10	February - March, August 15 - November 20	Quick Cover
Rye Grass (Alone)	50	August 10 - October 10	Competitive, Dense
Rye Grass (Mix)	8	August 10 - October 10	Competitive, Dense

\* For details on mixes consult the Clemson University Home and Garden Information Center at (888) 656-9988 or at <http://hgic.clemson.edu>.

**Table 3.13 Temporary Vegetation for Steep Slopes/Cut Slopes**

Species	Rates (lbs/acre)	Optimum Dates to Plant	Remarks
Weeping Lovegrass (Alone)	4	April - July 20	Quick cover, deep roots, likes dry sites, seldom used alone, clumps
Weeping Lovegrass (Mix)	2	April - July 20	Quick cover, deep roots, likes dry sites, seldom used alone, clumps

\* For details on mixes consult Clemson University Home and Garden Information Center at (888) 656-9988 or at <http://hgic.clemson.edu>.

### 3.5.1.5 Permanent Vegetation/Seeding

#### Plant Selection

Plant seed selection should be based on the type of soil, the season of the year in which the planting is to be done, and the needs and desires of the permanent land user. Tables 3.14 and 3.15 should be used to select the desired species to be planted. Failure to carefully follow agronomic recommendations often results in an inadequate stand of permanent vegetation that provides little or no erosion control. The rates in Tables 3.14 and 3.15 are based on purity and germination standards required for certification.

The following notes apply to Tables 3.14 and 3.15.



1. In mixtures with temporary cover, the full seeding rate of permanent cover shall be used.

Mix means 2 or more long term species plus short term species. For dates other than optimum, contact the Clemson University Home and Garden Information Center at (888) 656-9988 or at <http://hgic.clemson.edu>.

2. A legume, such as a clover, crown vetch, and sericea should be used where it is possible.
3. The appropriate inoculants should be used.

### **Topsoil**

If the surface soil of the seedbed is not adequate for plant growth, topsoil should be applied.

### **Tillage**

If the area has been recently plowed, no tillage is required other than raking or surface roughening to break any crust that has formed and to leave a textured surface. If the soil is compacted less than 6-inches, it should be disked for optimal germination. If the soil is compacted more than 6-inches, it should be sub-soiled and disked.

### **Soil Testing**

Information on soil testing is available from the Clemson University Home and Garden Information Center at (888) 656-9988 or at <http://hgic.clemson.edu>.

### **Lime**

Unless a specific soil test indicates otherwise, apply 1½ tons of ground course textured agricultural limestone per acre (70 pounds per 1000 square feet).

### **Fertilizer**

A minimum of 1000 pounds per acre of a complete 10-10-10 fertilizer (23 pounds per 1000 square feet) or equivalent should be applied during permanent seeding of grasses unless a soil test indicates a different requirement. Fertilizer and lime (if used) should be incorporated into the top 4-6 inches of the soil by disking or other means where conditions allow. Do not mix the lime and the fertilizer prior to the field application.

### **Seeding**

The surface of the soil should be loosened just before broadcasting the seed. Seed should be evenly applied by the most convenient method available for the type of seed to be applied and



the location of the temporary seeding. Typical application methods include but are not limited to cyclone seeders, rotary spreaders, drop spreaders, broadcast spreaders, hand spreaders, cultipacker seeder, and hydro-seeders. Cover applied seed by raking or dragging a chain or brush mat, and then lightly firming the area with a roller or cultipacker. Do not roll seed that is applied with a hydro-seeder and hydro-mulch.

### **Mulching**

All permanent seeded areas should be covered with mulch immediately upon completion of the seeding application to retain soil moisture and reduce erosion during establishment of vegetation. The mulch should be applied evenly in such a manner that it provides a minimum of 75% coverage. Typical mulch applications include straw, wood chips, bark, wood fiber, and hydro-mulches. The most commonly accepted mulch used in conjunction with permanent seeding is small grain straw. This straw should be dry and free from mold damage and noxious weeds. The straw may need to be anchored with netting or asphalt emulsions to prevent it from being blown or washed away. The straw mulch may be applied by hand or machine at the rate of 2 tons per acre (90 pounds per 1000 square feet). Frequent inspections are necessary to check that conditions for growth are good.

### **Irrigation**

Permanent seeded areas should be kept adequately moist, especially late in the specific growing season. Irrigate the seeded area if normal rainfall is not adequate for the germination and growth of seedlings. Water seeded areas at controlled rates that are less than the rate at which the soil can absorb water to prevent runoff. Runoff of irrigation water wastes water and can cause erosion.

### **Re-seeding**

Inspect permanently seeded areas for failure, make necessary repairs and re-seed or overseed within the same growing season if possible. If the grass cover is sparse or patchy, re-evaluate the choice of grass and quantities of lime and fertilizer applied. If the permanent seeding has less than 40% cover, have the soil tested to determine any acidity or nutrient deficiency problems.

Final stabilization by permanent seeding of the site requires that it be covered by a 70% coverage rate.

### **Post-Stabilization**

Once areas are stabilized they can be converted to native species or for establishing on non-critical, level sites. Table 3.16 lists some native species of City of North Charleston that can be used.



**Table 3.14 Permanent Vegetation Schedule**

Species	Rates (lbs/acre)	Optimum Dates to Plant	Remarks
Bermuda Grass (Hulled) (Alone)	8-12	April - July 15	Quick cover, Sod forming, partial winter kill
Bermuda Grass (Hulled) (Mix)*	4-6	April - July 15	Quick cover, Sod forming, partial winter kill
Fescue, Tall (KY31) Alone	40	August 15 - October	Seldom seeded alone, not for dry or wet sites
Fescue, Tall (KY31) Mix*	20	August 15 - October	Seldom seeded alone, not for dry or wet sites
Sericea Lespedeza (Scarified) Alone or Mix*, (Inoculate with EL Inoculant)	40	April - June	Good for slopes, cuts, and fills that require low maintenance
Ladino Clover (Mix* only), (Inoculate with AB Inoculant)	2	August 20 - October	Naturally adds nitrogen
Annual Rye Grass	15	August 15- February	Good for suppressing weeds. Do not use Italian Rye Grass.
Centipede	10	March 1 – April 15	Requires low maintenance and fewer cuts.

\* For details on mixes consult the Clemson University Home and Garden Information Center at (888) 656-9988 or at <http://hgic.clemson.edu>.

**Table 3.15 Permanent Vegetation Schedule for Steep Slopes/Cut Slopes**

Species	Rates (lbs/acre)	Optimum Dates to Plant	Remarks
Weeping Lovegrass (Alone)	4	April – July 20	Quick cover, deep roots, likes dry sites, seldom used alone, clumps
Weeping Lovegrass (Mix)*	2	April – July 20	Quick cover, deep roots, likes dry sites, seldom used alone, clumps
Crownvetch (Mix*) (Inoculate with Type M Inoculant)	8-10	March - April	2 years to establish, no mowing, green all year, 20” maximum height

\* For details on mixes consult the Clemson University Home and Garden Information Center at (888) 656-9988 or at <http://hgic.clemson.edu>.



## 3.5.2 EPSC Design Standards

### 3.5.2.1 General Standards

1. EPSC plans shall be developed to achieve an eighty (80) percent design sediment removal efficiency goal. Simply applied, when a site is completely denuded of vegetation, the structural and nonstructural EPSC measures shall be designed to trap 80 percent of the total suspended solids (TSS) or 0.5 ML/L peak settleable solids concentration (SSC), whichever is less, that are generated by the site. The design storm event associated with this level of control is the 10-year, 24-hour SCS Type III storm event. Calculations using models, such as SEDPRO or SEDCAD, or SCDHEC design aids shall be provided to show adherence to this criteria.
2. SCS procedures should be used to determine runoff amounts. It is important to note that when a BMP is designed for the 10-year, 24-hour storm event, the BMP will have a greater trapping efficiency for more frequent events such as the 2-year 24-hour storm event.
3. A sediment basin is required when ten (10) or more acres of disturbed land area drain to a single outlet point. Such basins shall be designed to have an 80 percent trapping efficiency for TSS for the 10-year, 24-hour storm event to pre-development conditions, and successfully pass the 50-year, 24-hour storm event. Sediment basins shall be limited to controlling runoff for 100 acres. Sediment traps shall not have more than 5 acres draining to them.

Activities that disturb between one (1) and ten (10) acres of land area that do not drain to a single outlet point may incorporate practices other than a sediment basin to achieve an equivalent removal efficiency.

4. Silt fencing shall be placed at the toe of all fill slopes and soil berms and below disturbed areas where the size of the area is no more than  $\frac{1}{4}$ -acre per one hundred (100) feet of silt fence length. The maximum slope length behind the fence is 100 feet and the maximum gradient behind the fence is 2H:1V.
5. The following nonstructural site management practices shall be utilized on the plans where applicable:
  - a. Minimize site disturbance to preserve and maintain existing vegetative cover,
  - b. Limit the number of temporary access points to the site for land disturbing activities,
  - c. Protect off-site and downstream locations, drainage systems and natural waterways from the impacts of erosion and sedimentation,
  - d. Phase and sequence construction activities to minimize the extent and duration of disturbed soil exposure, and



- e. Implement an ongoing inspection and maintenance plan. Suggested maintenance schedules are given in SCDHEC (2005).
6. Sediment storage volumes shall be calculated for all sediment controls to determine the required clean-out frequencies and maintenance schedules. The Universal Soil Loss Equation (USLE) and subsequent modifications or other acceptable methods that determine sediment yield may be used to predict the required sediment storage volumes for specific sediment control structures.
7. To encourage the development and testing of innovative alternative EPSC BMPs, alternative management practices that are not included in the Manual may be allowed upon review and approval by the City's Public Works Director. To use an alternative BMP, the design professional shall submit substantial evidence that the proposed measure will perform at least equivalent to currently approved BMPs contained in the Manual. Evidence may include, but is not limited to:
  - a. Supporting hydraulic and trapping efficiency calculations.
  - b. Peer review by a panel of licensed professional engineers.
  - c. Research results as reported in professional journals.
  - d. Manufacturer's literature.
8. Detailed EPSC plans shall comply to the maximum extent practicable with the following specific standards and review criteria:
  - a. Sediment tracking control shall be implemented using stabilized construction entrances that are to be located and utilized at all points of ingress/egress on a construction site. The transfer of soil, mud, and dust onto roads shall be prevented.
  - b. Crossings of waterways during construction should be minimized and must be approved by the City's Public Works Director and possibly the U. S. Army Corps of Engineers (USACOE). Encroachment into stream buffers, riparian areas and wetlands should be avoided when possible.
  - c. Topsoil shall be stockpiled and preserved from erosion or dispersal both during and after site grading operations when applicable.
  - d. Where construction or land disturbance activity will or has temporarily ceased on any portion of a site, temporary site stabilization measures shall be required as soon as practicable, but no later than seven (7) calendar days after the activity has ceased. Hydroseeding as often as possible is encouraged. Stabilization of disturbed areas is one of the best approaches for erosion prevention and sediment control.



- e. All slopes must be stabilized through grassing, hydroseeding, synthetic or vegetative matting, diversion berms, temporary slope drains, etc. and must be performed within two (2) working days after the necessary grading (temporary or permanent) has been achieved.
  - f. Final stabilization of the site shall be required within fourteen (14) calendar days of construction completion. Final stabilization is defined as having a uniform vegetative cover with a density of seventy (70) % established on all unpaved areas and areas not covered by permanent structures.
  - g. Temporary structural controls installed during construction shall be designed to accomplish maximum stabilization and control of erosion and sedimentation, and shall be installed, maintained, and removed according to the specifications set forth in the Manual and project specifics developed as part of the permit application/engineering calculations. All temporary structural controls shall be designed to control the peak runoff resulting from the ten (10) year storm event.
  - h. All permanent structural controls, including drainage facilities such as channels, storm sewer inlets, and detention basins, shall be cleaned out as part of the project closeout process.
  - i. Linear projects (utility lines, road construction) over, under, or along a water body shall include measures and controls which adequately protect the water body from undue impact. Such work should be coordinated with the installation of erosion prevention and sediment control measures so that disruption is minimized. Every effort should be made to install utilities during the initial construction phases. Trench sharing is encouraged to the extent practicable.
9. The grading plan should include the following general measures at a minimum:
- a. The finished cut and fill slopes to be vegetated should not be steeper than 3H:1V. The finished grades of cut and fill slopes to be vegetated with vines and/or groundcovers should not be steeper than 1H:1V.
  - b. Cuts or fills should not be so close to property lines as to endanger adjoining property without adequately protecting such properties against erosion, sedimentation, slippage, settlement, subsidence, or other damages.
  - c. Subsurface drainage should be provided in areas having a high water table to intercept seepage that would affect slope stability, bearing strength or create undesirable wetness.
  - d. No fill shall be placed where it can slide or wash onto another property.
  - e. Fill shall not be placed adjacent to channel banks where it can create bank failure, reduce the capacity of the stream, or result in downstream sediment deposition.



- f. All borrow and disposal areas should be included as part of the grading plan.
  - g. Adequate channels and floodways should be provided to safely convey increased runoff from the developed area to an adequate outlet without causing significant channel degradation, or increased off-site flooding.
  - h. The site should be graded to direct flows to appropriate controls.
10. EPSC plan shall have the following information contained in a cohesive, organized, and easy to follow format:
- a. Location of all erosion and sediment control structures on construction documents;
  - b. Delineation of all sensitive features (wetlands, streams, ponds, existing stormwater structures, etc.) and potential sediment sources;
  - c. Installation sequencing and maintenance schedules for all EPSC BMPs during and after construction;
  - d. Provisions to preserve topsoil and limit the amount of total disturbed area;
  - e. Details of site grading;
  - f. Design details and computations for all EPSC structures;
  - g. Protection of all storm drain inlets and outlets;
  - h. For sites which disturb greater than five (5) acres, a list or calculation of the trapping efficiency for all EPSC BMPs, as applicable;
  - i. For sites which disturb greater than five (5) acres, calculations of required sediment storage volumes for all EPSC BMPs, as applicable;
  - j. Explanation of any computer models or software used with highlights of and/or notes on the output data;
  - k. Locate temporary and permanent soil disposal areas, haul roads, and construction staging areas to minimize erosion, sediment transport, and disturbance to existing vegetation;
  - l. All necessary certifications by the person responsible for the activity. This includes the NOI application signatures and maintenance agreement/operating permit. Proper preparation of the EPSC Plan and the SWPPP, if necessary, by a registered engineer.



### 3.5.2.2 Typical EPSC Design Procedures

The design procedures will vary depending on the EPSC BMP. Many of the BMPs listed in Tables 3.9 – 3.16 do not need to be “designed” using calculations, such as surface roughening or dust control. Others require the use of equations or design aids to properly design. SCDHEC has two handbooks, the BMP Handbook (SCDHEC 2005) and the Stormwater Management and Sediment Control Handbook (SCDHEC 2003) that provide the procedures and equations needed to design some of the EPSC BMPs listed in Tables 3.9 – 3.15. Example problems are given for most types. As with the design of any BMP, engineering judgment will be needed on most applications. Proper design must be complemented with proper installation and routine maintenance in order for BMPs to be effective and to adhere to the provisions of this section.

## 3.6 Stormwater Drainage System Design Standards

This section provides the design requirements for various storm sewer drainage/collection system components including: design storms, velocities; and, pipe and inlet sizes. Storm drainage systems shall include all storm drainage structures and pipes that convey runoff under roadways. These systems are commonly referred to as lateral closed systems. These standards are required for all publicly maintained systems and are recommended for private systems.

### 1. Storm Drain Pipes:

- a. Storm drainage lines shall be staked at each box or at intervals that would be sufficient to check alignment and grade of the construction with the approved plans. The use of lasers to augment control is encouraged.
- b. The minimum size storm drainage pipe allowable shall be fifteen (15) inches in diameter.
- c. The minimum allowable slope for storm drainage pipe shall be one-half of one (1) percent [0.005 ft/ft] or a minimum flow velocity of three (3) feet per second at all flow levels. Maximum allowable slope for storm drainage pipe is twenty (20) percent. Maximum allowable flow velocity shall be ten (10) feet per second.
- d. Drainage system installation must be such that stormwater discharge is not concentrated on adjacent property owners and that the velocity is less than erosive limits for the site soils. At pipe outfalls, this normally requires the use of a rip-rap apron, placed on filter fabric and lightly grouted, for a minimum distance equal to or greater than six (6) pipe diameters. Level spreaders and three dimensional soil stabilization matting may also be used upon engineering review and approval.
- e. Type and class of storm drainage pipe, as well as the construction of pipe culverts, shall be in accordance with Sections 714 and 715 of the SCDOT



specifications. All storm drainage pipes under pavement in roadways shall be RCP with o-ring joints and a minimum Class III. Backfill shall consist of suitable material and compaction requirements per SCDOT Specifications.

- f. A minimum of one (1) foot of cover shall be provided for all storm drainage pipes under unpaved roads or any other situation in which no roadway or other structure is to cover the pipe. For RCP pipe under any paved surface, the absolute minimum cover is nine (9) inches (excluding base course and pavement section), providing the pipe's design meets loading requirements. Minimum covers as listed in SCDOT's 714 standard drawings is highly recommended. Contact the City's Public Works Director for minimum depths in other situations (e.g. other pipe types). RCP Class IV or Class V may be requested by the City's Public Works Director in special conditions (e.g. deep installation, excessive surface loads, etc).
- g. Storm drainage pipe shall be placed to minimize length running under pavement. Where it is necessary for a pipe to cross the roadway, it preferably shall be placed at a ninety (90) degree angle, and in no case at less than forty-five (45) degrees. All cross lines in the roadway shall be compacted in 8" loose lifts to 95% Standard Proctor maximum density. Subgrade and base course compaction shall be per SCDOT Standard.
- h. Any "open" storm drainage cross line pipe shall extend out to the toe of the roadway embankment; in no case will the end of the pipe be within the five foot roadway shoulder.
- i. Storm drainage pipe discharging into a drainage channel shall intersect the channel in a manner such that the interior angles measured from their centerlines of flow, is greater than, or at most equal to ninety (90) degrees. Rip-rap, or other suitable protection, is required from the outlet point to the bottom of the channel and on the opposite channel bank to prevent scour and erosion.
- j. Storm drainage pipe discharging into a wet pond or lake shall have the discharge invert above the permanent pool elevation and rip-rap or other energy dissipation structures shall be placed from the outlet point to pool level. Submerged systems shall be avoided and will only be permissible based upon justification and prior approval from the Public Works Director.
- k. A maintenance access point shall be available at a minimum distance of 200 feet for all drainage lines. In addition, manholes shall be placed at all intersections, grade changes, alignment changes, a pipe size or a pipe geometry change.
- l. The 100-year, 24-hour storm event shall be used to check all drainage designs for local flooding, and possible flood hazards at adjacent structures and/or property.



- m. Hydraulic grade line and head loss calculations for determining water surface elevations shall be performed for all systems connections. Where water quality devices are used, headwater depths shall be at such an elevation to allow for the appropriate function of the device.
- n. Calculations should be performed for the appropriate design storm event (see Section 3.2 above).
- o. For storm drainage systems with less than five (5) connections, Manning's Equation shall be acceptable for sizing the capacity of drain pipes for non-submerged conditions where the free water surface elevation is below the crown of the pipes. The Saint-Venant equations (full dynamic wave), which are used in many common engineering programs, shall be employed in larger design situations. When the Saint-Venant equation is used the energy grade line should not be more than one (1) foot over the top of the pipe unless pipe joints are designed to for the access pressure.
- p. Storm drain profile plots shall be included in the set of construction plans.
- q. Storm drainage systems shall be designed to convey stormwater runoff by gravity flow unless otherwise approved.
- r. For very flat flow lines, flow velocities shall increase progressively throughout the system. Upper reaches of the pipe system may have flatter slopes than the lower end of the system.
- s. It shall be unlawful for any person to uncover any component of the public stormwater system or connection branches thereof, for any purpose or to make connection therewith, unless and except with the approval and inspection of the Department of Public Works.
- t. In opening trenches in any street or public way, the paving or base material shall be removed in a manner directed by the Department of Public Works. The sides of the trench shall be sheeted or braced in accordance with current OSHA standards. The earth removed from the trench shall be placed so as not to obstruct the gutters and so as to cause the least obstruction to public travel. Gas and water pipes shall be protected from impact, the trench enclosed and lighted at night, and every precaution taken to prevent injury to person or property during the progress of the work.
- u. Notice shall be provided to the Engineering Division at least two (2) working days prior to the installation of a public storm drain. No material shall be used or work covered until inspected and approved by the Engineering Division. At the end of all projects in which pipes were installed, the entire closed system (pipes, boxes, etc.) shall be video inspected and sent to the Engineering Division as part of the closeout procedure. Pipes shall be video inspected again at the end of the 2-year warranty period. See Chapter 2 for video specifications.



## 2. Culverts:

- a. Proper consideration of inlet and outlet control shall be given in the design of culverts and outlets.
- b. The pipe, appurtenant entrance and outlet structure should properly account for water, bed-load, and floating debris at all stages of flow.
- c. There should be no unnecessary or excessive cause of property damage.
- d. The outlet should be designed to resist undermining and washout.
- e. Culvert design shall include all cross drainage facilities that transport stormwater runoff under roadways. Culvert selection techniques can range from solving empirical formulas, to using nomographs and charts, to comprehensive mathematical analysis for specific hydraulic conditions. The models used for these calculations are listed below. Other widely accepted models may be used, but must be approved by the City's Public Works Director. Designs shall be based upon SCDOT requirements where applicable.
- f. Culverts under roadways shall be designed using the fifty (50) year storm event, regardless of contributing area. Ponding on the upstream end of the culvert is acceptable as long as the roadway is not overtopped during the precipitation event. Ponding or backwater effects shall not impact any new or existing structures and recede after the storm event in a time period acceptable to the Public Works Department.
- g. Additional hydraulic capacity shall be required, as necessary, to prevent backwater effects that may adversely impact upstream properties or structures.
- h. Acceptable models for designing culverts include, but are not limited to:
  - ICPR
  - HY8
  - Pond Pack
  - HEC-RAS
  - Flow Master
  - HydroCad
- i. A complete study of culverts and design considerations can be found in USDOT 2001a.
- j. Culvert installation should follow the standards outlined in SCDOT Standard Specifications, Section 714.

## 3. Headwalls and Outlets:



All exposed ends of pipes shall be protected by a flared end section (limited to pipes 36" or less in diameter) or one of the following type headwalls:

- a. A concrete or brick plastered headwall with non-shrink grout is preferred; it is required on culverts located in major defined drainage channels. An acceptable design detail is provided in the DHEC BMP handbook.
- b. A rip-rap headwall is acceptable for pipes 24" or less in a number of situations; if used, it should conform to the standard details provided in the DHEC BMP Handbook. Note that this technique requires the use of both filter fabric and grout.
- c. Storm drainage or pond outfalls must be carried to an existing drainage outfall such as a pipe, ditch, etc.
- d. If feasible, provided a 20-foot minimum buffer between the property line and the end of all pipes or energy dissipation measures installed.
- e. No new point discharge onto adjacent property, where there was not an existing point discharge, is allowed without the property owner's written permission. Discharge points created with new development shall connect to an existing drainage system, whether natural or man-made. The new outlet may not cause flooding or in any way degrade the existing drainage system and proof of such shall be provided. In some cases, conveyance must be constructed from the new development to a point of discharge into the existing system and shall be done at the owner's expense. In these cases, the owner is responsible for obtaining all necessary easements and agreements to construct such drainage improvements.
- f. Outlets will not be allowed to discharge on fill slopes.

#### **4. Energy Dissipation:**

- a. All outlets should be sufficiently stabilized. Calculations shall be provided justifying the design and material used (e.g. riprap aprons geometry and diameter).
- b. If riprap aprons are used, filter fabric is to be installed beneath all riprap.
- c. Level spreaders, plunge pools, etc. shall be properly designed and installed at the proposed outlet(s).

#### **5. Catch basins, yard inlets, manholes, and junction boxes.**

- a. Materials and construction shall be as specified in Section 719 of the SCDOT specifications.



- b. When the depth of a catch basin or junction box exceeds four and one-half (4.5) feet, rungs/steps shall be provided for ascent and descent. (Steps are to be ASTM-C-478, or equivalent.)
- c. The box top shall be a minimum of three (3) feet by three (3) feet. Sides shall be plastered with grout.
- d. All inlet and outlet pipes shall not protrude more than four (4) inches into the box, and where possible should be cut flush with the inside surface walls.
- e. All roadway catch basins shall be a standard SCDOT type approved by the Public Works Director based on the application.
- f. Maximum roadway catch basin inlet capacity for an inlet shall be determined based on the following:

For inlets at sag, capacity shall be based on weir flow (unsubmerged). The depth flow shall be limited to the curb depth, but may be further limited by the allowed spread, detailed below. In sag conditions, a 15% factor of safety shall be used to account for debris/clogging. For inlet on grade, theoretical capacity shall be considered in the design the longitudinal and cross slopes, and gutter depression. The length of the gutter opening must be such that the gutter efficiency is 80% of the theoretical capacity. Several equations and nomographs are available in the literature for determining the theoretical capacity. Maximum flow depth shall be limited to the depth of curb.

- g. SCDOT inlets shall be designed to accommodate a projected flow such that ponded water dissipates within 24 hours and does not cause flooding to adjacent buildings or other structures. As long as these criteria are met, the depth of ponded water is allowed to exceed the top of the manhole lid by no more than 6 inches for the appropriate design storm.
- h. Catch basins will be located outside curve radii. If this is not possible, the catch basin shall be set back an extra foot and the face of the catch basin shall be parallel to a chord joining the two points on the curve radius located by projecting lines from the sides of the catch basin box.
- i. Catch basins shall contain a minimum drop of 0.1 feet from invert in to invert out.
- j. Within a catch basin, the elevation at the crown of any inlet pipe shall be equal to or greater than the crown of the outlet pipe.
- k. Catch basins shall be field staked to ensure proper catch basin inlet alignment with the street gutter line.
- l. Area around all catch basins shall be backfilled in eight (8) inch loose lifts, compacted to 95% Standard Proctor maximum density.



- m. Inlet protection shall be provided at all inlets into the stormwater system during construction and until project closure procedures have been completed or notification from the City's Public Works Director has been given stating that an acceptable level of stabilization has been achieved. Guidance on design, installation and maintenance of inlet protection can be found in SCDOT (2005).
- n. Inlet spacing shall be based partly on the maximum spread of water into the road way. For the appropriate design storm, at least one full travel lane width must be available during the rain event for all roads. Inlets up-gradient of a road intersection, sag inlets, or the last inlet for a given system must be designed with sufficient capacity to handle the entire flow, such that there is no flow through/bypass.
- o. Maximum depth in which the water may pond above or around an inlet must not threaten surrounding permanent structures or facilities including vehicular or pedestrian traffic.
- p. Inlets placed in roadway gutter lines must be spaced to prevent flow from entering road intersections and to not exceed a maximum spread of 6-feet, or one-half of a travel lane, whichever is greater, and based on maximum inlet capacity.
- q. In depth design procedures for inlet and storm sewer design may be referenced in AASHTO (1999), USDT (2001b), Mays, L., (2001), and Yen (2001). Culvert design guidance is found in USDT (2001a).
- r. Catch basins that are proposed in series shall include the last catch basin prior to discharge to a ditch/pond with a minimum of a 12" sump. The location of the catch basin shall be such that access can be provided by Public Works personnel for maintenance purposes
- s. All manhole lids and catch basins shall contain the City of North Charleston water quality logo. Contact the Public Works Department for information on how to obtain logos.

### **3.7 Open Channel Hydraulics**

Open channels shall include all permanent storm drainage channels including swales, culverts, and diversions. These storm drainage systems shall be designed based upon the following criteria:

- 1. All open channels shall be uniform and shall be stabilized to prevent erosion in a manner approved by the City's Public Works Director. A number of acceptable techniques are shown in the current version of the SCDHEC (2005).
- 2. The design of open channels shall be based on Manning's Formula where backwater effects from obstructions and/or tailwater is not present. Flow velocities for the 10-



year storm event must be less than five (5) ft/sec (two and one-half (2.5) ft/sec in bare sandy soils) or the channel surfaces must be adequately lined, e.g., rip-rap, concrete.

3. The minimum channel grade shall be 0.005 ft/ft, unless supporting calculations show that there will be no pools or standing water areas formed in the channels at smaller slopes.
4. Design conditions can be assumed to be steady, uniform flow.
5. Except for roadside ditches, the side slopes of grassed lined channels without Erosion Control Blankets or Turf Reinforcement Matting shall be no steeper than 3H to 1V.
6. Channels may be designed with multiple stage levels with a low flow section to carry the 2-year storm event and a high flow section to carry storms of larger frequencies.
7. City of North Charleston allows vegetated channels. Guidance on the design of these type channels can be found in Haan et. al. (1995) or by using computer software that is capable of calculating channel stability and capacity.
8. Additional hydraulic capacity shall be required as necessary to prevent backwater effects that may adversely impact upstream property or structures.
9. Acceptable models for designing open channels include, but are not limited to:
  - ICPR
  - HY8
  - Pond Pack
  - HEC-RAS
  - Flow Master
  - HydroCAD



Table 3.16 Maximum Permissible Velocities for Vegetated Channels

Cover	Permissible Velocity (ft./sec.)*					
	Erosion Resistant Soils % Slope			Easily Eroded Soils % Slope		
	0-5	5-10	> 10	0-5	5-10	> 10
Bermuda Grass	8	7	6	6	5	4
Buffalo Grass						
Blue Gamma						
Centipede Grass						
Tall Fescue	7	6	5	5	4	3
Kentucky Bluegrass						
Red Canary Grass						
Grass-legume Mixture						
Lespedeza Sericea	5	4	NR	4	3	NR
Weeping Lovegrass						
Kudzu						
Alfalfa						
Small Grains	3.5	NR	NR	2.5	NR	NR
Temporary Vegetation						

\* Allow velocities over 5 ft/sec only where good cover and maintenance will be provided. If poor vegetation exists due to shade, climate, soils or other factors, the permissible velocity shall be reduced by 50 percent.

NR = Not Recommended

Sources: Elementary Soil and Water Engineering, Shwab et. al. and Hann et. al. (1995)

General guidance on open channel design can be found in USDT (1996, 2001).

### 3.8 Special Protection Areas

In an effort to address some of the most critical water resource problems that exist in the City, Special Protection Areas have been established. Those wishing to develop or redevelop lands within these protected areas will be required to comply with the minimum standards listed in the preceding sections as well as a more stringent set of design criteria detailed below. These generally focus on either a water quantity (reduce or prevent frequent and/or extreme flooding) or a water quality problem (prevent or reduce degradation of riverine, estuarine, coastal ecosystems or maintain a designated use(s)). At such times that maps are made available to the public, the City's Public Works Director will inform permit applicants on whether or not a proposed project is required to comply with additional design criteria listed in the following sections. The maps are not included in the manual due to expected changes in the designated areas, particularly those associated with TMDLs.



### 3.8.1 Water Quantity Issues

Flooding problem areas exist in many locations around the City to the point that stormwater controls have become overwhelmed, or where controls were never adequately designed or installed to control runoff. The ability to maintain a system is also suspected to be contributing to some of the frequent flooding. In an effort to relieve existing flooding problems, the following list of design criteria will be required in designated areas. The requirement in conjunction with the enforcement of other design criteria listed in the sections above, are required to provide the necessary controls.

1. The post-development, peak discharge rates is restricted to half ( $\frac{1}{2}$ ) the pre-development rates for the 2 and 10-year storm event or to the downstream system capacity, whichever is less.
2. The post-development runoff volumes for the 2-year frequency 24-hour duration storm events above the predevelopment level shall be stored for a period of 24-hours on average before release.

Additional criteria may be established on a case by case basis.

### 3.8.2 Water Quality Issues

In conjunction with the NPDES permitting program, SCDHEC, through delegated responsibility from EPA, must identify and mitigate impaired waterbodies. Impaired waterbodies are identified through a monitoring program, the results of which are compared against water quality standards developed to protect designated uses of individual waterbodies. Impaired waterbodies are those that do not meet these standards and cannot be used for their designated purposes, such as fishing, swimming, recreation, and/or support of aquatic life. In accordance with Section 303 of the Clean Water Act, states must release a bi-annual report of the impaired waterbodies. Waters listed on the 303(d) list will eventually have a TMDL developed, which represents the daily amount of a particular pollutant that a waterbody can receive and still meet the water quality standard for its designated use(s). A list of impaired waterbodies and adopted TMDLs can be found at <http://www.scdhec.net/environment/water/tmdl/index.htm>.



## CHAPTER 4 INSPECTIONS & ENFORCEMENT

This chapter establishes inspection and enforcement guidelines to be followed by the City.

### 4.1 Stormwater Management Inspections

The City will inspect applicable construction sites from initial land clearing to final stabilization. The purpose of these inspections will be to check for compliance with the City stormwater management plan approved by the Stormwater Division. Maintenance inspections will also be performed on stormwater management systems and facilities throughout their useful life. For each system or facility installed or retrofitted during an approved construction project, the applicant must have submitted a maintenance schedule or plan. City inspectors will be checking for adherence to this plan and any necessary changes that may arise after installation. City inspections are not to be construed as a relaxation of the requirements on owners/operators to conduct self-inspection in accordance with any applicable local, state or federal stormwater requirements

#### 4.1.1 Inspector Duties/Responsibilities

North Charleston's Stormwater Management Inspectors shall inspect and enforce the requirements of the City Stormwater Management Ordinance. The job duties/responsibilities of a City Stormwater Inspector shall include, but not be limited to, the following:

1. Conduct and document during construction site inspections to ensure compliance with the approved City permit or stormwater management plan. Frequency of inspections will be determined by City staff on an as needed basis.
2. Ensure that the approved City permit or stormwater management plan, the SWPPP, and the construction plans are on the project site and are properly being followed and implemented.
3. Conduct post-construction inspections to ensure that permanent maintenance is being performed in accordance with the maintenance schedules for the various stormwater management facilities in the City permit or approved stormwater management plan.
4. Provide the owner/operator of the project a written report within seven (7) days after every during construction or post-construction site inspection.
5. Issue enforcement orders, as necessary, to the owner/operator when any portion of the work does not comply with the approved City permit and/or stormwater management plan or work is occurring without appropriate permitting. The enforcement process and types of orders is detailed in Section 4.3.



6. Perform a final inspection upon the completion of the stormwater system to determine if the system is constructed in accordance with the approved City permit and/or, stormwater management plan.
7. Take immediate action if the owner/operator fails to comply with the approved City permit or the approved stormwater management plan and an imminent hazard exists as a result. The inspector should address the situation and notify any applicable local, state and federal agencies.
8. Maintain accurate and comprehensive project inspection files ensuring all relevant information is entered in the files to be maintained in the Public Works Department.

#### **4.1.2 Inspection Process and Procedures**

As per the City's Stormwater Ordinance, the Public Works Director or an authorized representative/designee (inspector) may enter upon all properties for regular inspections, periodic investigations, enforcement and to effectuate the provisions of the Ordinance. Upon refusal by any owner/operator or property owner to permit an inspector to enter upon the property or continue an inspection, the inspector shall terminate the inspection or confine the inspection to portions of the property to which no objection is raised.

Upon completion of a during construction site inspection, the City inspector should, at a minimum, include the following in his inspection report to be provided to the owner/operator:

1. Date and location of the site inspection.
2. Whether the approved City permit or stormwater management plan, SWPPP, and construction plans have been properly implemented and maintained.
3. Identification of any approved plan or BMP deficiencies.
4. Any corrective actions needed.

Upon completion of a post-construction maintenance inspection, the City inspector should, at a minimum, include the following in this inspection report to be provided to the owner/operator:

1. Date and location of the site inspection.
2. Whether the activities identified in the approved maintenance schedule have been properly implemented and completed.
3. Identification of any maintenance deficiencies.
4. Any corrective actions needed.



## 4.2 Permittee Inspection Responsibilities

In accordance with any applicable local, state and federal stormwater requirements including, but not limited to, the NPDES Construction General Permit (CGP), owner/operators are responsible for conducting during construction and post-construction site inspections. Records of such inspections should be kept for a minimum of five (5) years and must be made available to the City of North Charleston upon request.

## 4.3 Enforcement

If the City determines that a project is in non-compliance with the City's Stormwater Management Ordinance, then the City may direct conformity by proceeding with the appropriate enforcement action. The types of enforcement tools available to the City include a Correction Order, Notice of Violation (NOV), Stop Work Order and/or Civil/Criminal Penalties. The enforcement mechanism to be utilized will depend on the circumstances as described in the following sections.

### 4.3.1 Correction Orders

The Public Works Director shall issue a Correction Order for first offenses of non-compliance with the City Ordinance, the City permit or the approved stormwater management plan. The purpose of the Correction Order is to give notice of the deficiencies, identify expected corrective results and provide a reasonable timeframe to the contractor prior to the City taking further action to get a problem resolved. Correction Orders shall be submitted in writing, but a verbal notice may be given if the deficiency needs immediate correction to prevent offsite or downstream impacts. The Director of Public Works shall issue Correction Orders within five (5) working days of an inspection. All Correction Orders, verbal or written, shall be noted in the project file.

Correction Orders may be issued in such cases, but not be limited to, when there is:

1. Failure to comply with the approved stormwater design plans to include failure to have properly installed and/or maintained BMP measures.
2. Failure to properly maintain permanent stormwater management structures.
3. Failure to notify the Public Works Director before beginning work on a phase of an approved project.
4. Failure to call for a final site inspection.

A Correction Order should at a minimum include, but not be limited to, the following:

1. Nature of the violation(s).
2. Proposed penalty.



3. Required corrective actions.
4. The time period for correcting the violation(s).

#### **4.3.2 Notices of Violation (NOV)**

If a Correction Order has been previously issued and there is either subsequent non-compliance issues or failure to complete the items on the Correction Order within a specified time period, then a Notice of Violation may be issued. In addition, for violations that do not involve a safety issue or an imminent threat of serious damage to the environment and/or public or private property, a Notice of Violation may be issued for, but are not limited to, the following:

1. If construction activities have been initiated and no BMP measures are in place, or are not working to prevent sediment from leaving the site.
2. Failure to have work inspected and approved before restarting construction activities after a stoppage of work.

A Notice of Violation (NOV) should at a minimum include, but not be limited to, the following:

1. Nature of the violation(s).
2. Proposed penalty.
3. Notification that a Stop Work Order may be issued or that permits for the site may be suspended or revoked if there is continued non-compliance.
4. Required corrective actions.
5. The time period for correcting the violation(s).

#### **4.3.3 Stop Work Order**

A Stop Work Order may be issued for, but are not limited to, the following:

1. Construction activities are occurring without City permits and/or an approved stormwater plan.
2. Past enforcement actions taken by the City (Correction Orders, Notice of Violations) to remedy a situation(s) have not been properly addressed with appropriate and prompt action to the satisfaction of the Public Works Director.
3. Non-compliance with the plans has resulted in a health or safety issue.
4. Offsite sedimentation resulting from non-compliance with the approved stormwater plan has eliminated or severely degraded a use in a downstream waterbody or that such degradation is imminent.



5. Offsite sedimentation resulting from non-compliance with the approved stormwater plan has caused severe damage to adjacent land.

A Stop Work Order may allow or require correction of violations, but no other construction activities may occur. The Stop Work Order shall state that failure to comply may result in the suspension or revocation of any remaining permits issued for the site and/or civil penalties being issued.

#### **4.3.4 Civil Penalties**

The Public Works Director may issue a Civil Penalty if a Notice of Violation and/or Stop Work Order has not been complied with or there has not been substantial progress in complying with the Notice of Violation and/or Stop Work Order. In addition, a Civil Penalty may be issued when there are repeated, recurring violations at the same site or when there are repeated, recurring violations by the same responsible party. Violations may subject the owner/operator to Civil Penalties in accordance with the Stormwater Management Ordinance, Division 6. Each separate day of a violation constitutes a new and separate violation.

#### **4.3.5 Criminal Penalties**

In addition to any applicable civil penalties, any person who negligently, willfully, or intentionally violates any provision of the Stormwater Management Ordinance shall be guilty of a misdemeanor and shall be punished within the jurisdictional limits of the magistrate's court. The Public Works Director may issue a uniform summons citation for a violation of the Stormwater Management Ordinance in accordance with Division 6. Each day of a violation shall constitute a new and separate violation.



## CHAPTER 5 REFERENCES

This chapter lists the various references used in the manual and if available, websites where they can be retrieved.

ASCE, (1996). *Hydrology Handbook*. ASCE Manuals and Reports of Engineering Practice No. 28.

ASCE & WEF, (1994). *Design and Construction of Urban Stormwater Management Systems*. ASCE Manuals and Reports of Engineering Practice No. 77, WEF Manual of Practice No. FD-20.

American Association of State Highway and Transportation Officials, (1999). "Model Drainage Manual."

Atlanta Regional Commission, (2001) "Georgia Stormwater Management Manual- Volume 1: Stormwater Policy Guidebook, 1<sup>st</sup> Edition.

Atlanta Regional Commission, (2001) "Georgia Stormwater Management Manual- Volume 2: Technical Handbook, 1<sup>st</sup> Edition.

Chow, V.T., Maidment, D., and Mays L., (1988). *Applied Hydrology*. McGraw-Hill, NY.

Haan, C. T., Barfield, B. J., and Hayes, J. C., (1995). *Design Hydrology and Sedimentology for Small Catchments*. Academic Press, San Diego, Ca.

FEMA, (1998). *Federal Guidelines for Dam Safety*. Interagency Committee on Dam Safety, [http://www.fema.gov/fima/damsafe/eap\\_toc.shtm](http://www.fema.gov/fima/damsafe/eap_toc.shtm).

Mays, L., (2001). "Hydrology for Drainage System Design and Analysis," in L. W. Mays, ed., *Storm Water Collection Systems Design Handbook*. McGraw-Hill, NY, p. 1-1 – 1-53.

Paine, J., and Akan, A., (2001). "Design of Detention Systems," in L. W. Mays, ed., *Storm water Collection Systems Design Handbook*. McGraw-Hill, NY, p. 7-1 – 7-66.

Prince George's County, (1999a). "Low-Impact Development Design Strategies - An Integrated Design Approach." Department of Environmental Resources, Programs and Planning Division, Prince George's County, Maryland.

Prince George's County, (1999b). "Low-Impact Development Hydraulic Analysis." Department of Environmental Resources, Programs and Planning Division, Prince George's County, Maryland.

South Carolina Department of Health and Environmental Control, (2005). "Storm Water Management BMP Handbook." Prepared by the Bureau of Water and OCRM.



South Carolina Department of Health and Environmental Control, (2003). "Stormwater Management and Sediment Control Handbook for Land Disturbance Activities." Prepared by the Bureau of Water and OCRM.

Schueler, T. R. (1987). "Controlling Urban Runoff: A Practical Manual for Planning and Designing Urban BMPs," Metropolitan Washington Council of Governments.

Shwab, Glenn O. and Richard K. Frevert, (1985). *Elementary Soil and Water Engineering*. John Wiley & Sons, New York, New York.

U.S. Environmental Protection Agency, June 1992.

United States Department of Agriculture, (1986). "Urban Hydrology for Small Watersheds." *Technical Release No. 55*, 2<sup>nd</sup> Edition, Natural Resources Conservation Service, Conservation Engineering Division, Washington D.C.

United States Department of Transportation, (1996). "Highway Hydrology – Hydraulic Design Series # 2." Federal Highway Administration, Publication # FHWA-SA-96-067.

United States Department of Transportation, (2001). "Introduction to Highway Hydrology – Hydraulic Design Series # 4." Federal Highway Administration, Publication # FHWA NHI 01-019.

United States Department of Transportation, (2001a). "Hydraulic Design of Highway Culverts – Hydraulic Design Series # 5." Federal Highway Administration, Publication # FHWA-NHI-01-020.

United States Department of Transportation, (2001b). "Urban Drainage Design Manual – Hydraulic Engineering Circular # 22." Federal Highway Administration, Publication # FHWA-NHI-01-021.

WEF & ASCE, (1998). *Urban Runoff Quality Management*, WEF Manual of Practice No. 23, ASCE Manual and Report on Engineering Practice No. 87.

Yen, B., (2001). "Hydraulics of Sewer Systems," in L. W. Mays, ed., *Storm Water Collection Systems Design Handbook*. McGraw-Hill, NY, p. 6-1 – 6-113.



# **APPENDIX A**

## **APPLICATION FORMS**



**SINGLE FAMILY RESIDENTIAL (SFR) Application  
For Construction Activities Disturbing One-Half (0.5) Acre or More  
City of North Charleston**

**Erosion Protection & Sediment Control (EPSC) Certification**

**Applicant Information**

OWNER: \_\_\_\_\_  
 ADDRESS: \_\_\_\_\_  
 CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP CODE: \_\_\_\_\_  
 PHONE: \_\_\_\_\_ FAX: \_\_\_\_\_ E-MAIL: \_\_\_\_\_  
 SIGNATURE: \_\_\_\_\_ DATE: \_\_\_\_\_

**Property Information**

PARCEL/TMS #(S): \_\_\_\_\_ LOT NUMBER(S): \_\_\_\_\_  
 DEVELOPMENT NAME/PHASE: \_\_\_\_\_  
 CITY: \_\_\_\_\_ ZIP CODE: \_\_\_\_\_  
 TOTAL ACRES: \_\_\_\_\_ DISTURBED ACRES: \_\_\_\_\_  
 LOTS APPLIED FOR: \_\_\_\_\_

**Contractor Information (if applicable)**

COMPANY: \_\_\_\_\_  
 LICENSE #: \_\_\_\_\_  
 CITY: \_\_\_\_\_ STATE: \_\_\_\_\_ ZIP CODE: \_\_\_\_\_  
 PHONE: \_\_\_\_\_ FAX: \_\_\_\_\_ E-MAIL: \_\_\_\_\_  
 SIGNATURE: \_\_\_\_\_ DATE: \_\_\_\_\_

**1. Is your site part of a larger common plan of development?**  Yes  No

If yes, you must sign the certification below. If no, proceed to item 2.

**I certify by my signature below that:**

I certify under penalty of law that I understand and will implement the City's construction activity management requirements specified in the City Construction Permit issued to the owner of the larger common plan of development. I will ensure that the control measures are maintained. I further certify that City of North Charleston inspectors may enter the property as necessary to ensure compliance with all related requirements.

SIGNATURE: \_\_\_\_\_ DATE: \_\_\_\_\_

**2. If not part of a larger common plan of development you must sign the certification below.**

I certify under penalty of law that I understand and will implement the City's construction activity management requirements specified in the attached document. I will ensure that the control measures are maintained. I further certify that City of North Charleston inspectors may enter the property as necessary to ensure compliance with all related requirements.

SIGNATURE: \_\_\_\_\_ DATE: \_\_\_\_\_

## **Construction Activity Management Requirements for Single Family Residential (SFR) Structures Disturbing One-Half (0.5) Acre or More**

1. The lot shall have protection around the entire boundary with allowances for no more than two entrance/exits. This protection may be silt fencing or earthen or man-made berms or dikes. These measures shall be installed within 24-hours of land disturbance and maintained until the project is stabilized as detailed below. The following guideline should be followed:
  - The maximum length from the crest of a hill to the fence is 100 feet. When the distance from a crest to the property boundary is greater than 100 feet, an intermediate row of silt fence shall be used or another control measure shall be employed.
  - The maximum slope steepness (normal [perpendicular] to fence line) is 2H:1V. When exceeded, slope drains shall be employed.
  - A maximum of ¼ acre drainage per 100 linear feet of silt fence should be used. When this is exceeded, an intermediate row of silt fence shall be used or another control measure shall be employed.
  - Sediment accumulated along the fence shall be removed when it reaches 1/3 the height of the fence.
  - Proper construction of these measures can be found from SC DHEC's BMP Manual, or from the Public Works Department. Manufacturers recommended installation and maintenance procedures shall be followed if applicable.
2. Nearby stormwater inlets, manholes, etc. in the street or on this or adjacent property shall be protected through the use of sediment tubes, check dams, or inlet protection devices. These measures will be maintained throughout the construction process until the site is stabilized as detailed below.
3. Construction entrances shall be provided at all entrances/exits (maximum of 2). The entrance shall contain washed stone that is at least 6-inches deep, 20-feet wide, and 75-feet long. The stone shall be maintained throughout the construction process until the site is stabilized as detailed below. Sediment tracked onto streets shall be removed weekly. More information on the installation and maintenance of the construction entrances can be obtained from the Public Works Department.
4. All control measures shall be inspected every 7 calendar days or every 14 days and within 24-hours after each rainfall event that produces ½-inches or more of precipitation.
5. Construction debris and other waste shall be contained in a dumpster or covered with plastic. Covers that prevent exposure to precipitation shall also be used for stockpiles of soil. Chemicals, paints, solvents and other materials shall be stored such that exposure risk to precipitation and stormwater runoff is low. Concrete wash water shall be disposed in an area of soil away from surface waters where soil can act as a filter or evaporate the water. Remaining cement shall be disposed of in a dumpster or otherwise removed from the site. Be aware that this water can kill vegetation. De-watering water shall be disposed of in a pervious area. Discharge of sediment from dewatering operations shall be prevented from entering into storm sewers and surface waters.

6. Areas not used during construction should be vegetated with sod or grass seed. Existing/natural vegetation should be preserved as much as possible. Grass specifications are available from the Public Works Department.
7. A site is considered stabilized once the entire area other the buildings, driveways, and walkways, has a vegetative cover with a density of 70%. Seeding should be accompanied or replaced with erosion control mats as necessary to achieve this density.
8. After final stabilization is achieved, all control measures shall be removed from the site.





## Types II and III Application City of North Charleston

Applicable for construction projects that disturb one acre or more **or** projects disturbing less than one (1) acre but are part of a Larger Common Plan of Development that will disturb more than one (1) acre

Date: \_\_\_/\_\_\_/\_\_\_\_\_

Project/ Site Name: \_\_\_\_\_

### I. Project Information

Project Owner/ Operator (Company or person): \_\_\_\_\_

Contact Person: \_\_\_\_\_ Company EIN: \_\_\_ - \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Phone: (Day) \_\_\_ - \_\_\_ - \_\_\_\_\_ (Mobile) \_\_\_ - \_\_\_ - \_\_\_\_\_ (Fax) \_\_\_ - \_\_\_ - \_\_\_\_\_

Email address: \_\_\_\_\_

Person Financially Responsible: \_\_\_\_\_

(If different than above, a person must be named in both spaces)

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Phone: (Day) \_\_\_ - \_\_\_ - \_\_\_\_\_ (Mobile) \_\_\_ - \_\_\_ - \_\_\_\_\_ (Fax) \_\_\_ - \_\_\_ - \_\_\_\_\_

Email address: \_\_\_\_\_

Agent or Contact Person (if applicable): \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Phone: (Day) \_\_\_ - \_\_\_ - \_\_\_\_\_ (Mobile) \_\_\_ - \_\_\_ - \_\_\_\_\_ (Fax) \_\_\_ - \_\_\_ - \_\_\_\_\_

Email address: \_\_\_\_\_

Engineer, Technical Representative or Firm: \_\_\_\_\_

(If different from Agent)

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Phone: (Day) \_\_\_ - \_\_\_ - \_\_\_\_\_ (Mobile) \_\_\_ - \_\_\_ - \_\_\_\_\_ (Fax) \_\_\_ - \_\_\_ - \_\_\_\_\_

Email address: \_\_\_\_\_

### II. Property Information

A. Site Location (street address, nearest intersection, etc.): \_\_\_\_\_

City/ Town (if in limits): \_\_\_\_\_ Latitude: \_\_\_° \_\_\_' \_\_\_" N Longitude: - \_\_\_° \_\_\_' \_\_\_" W

Tax map # (list all): \_\_\_\_\_

B. Property Owner (if different from section I above): \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Phone: (Day) \_\_\_ - \_\_\_ - \_\_\_\_\_

### III. Site Information

A. Disturbed area (to the nearest tenth of an acre): \_\_\_\_\_ Total area: \_\_\_\_\_

Impervious area: \_\_\_\_\_

B. Is this project part of a Larger Common Plan for Development or Sale (LCP)?  Yes  No

If yes, what is the previous state permit no.? \_\_\_ - \_\_\_ - \_\_\_ - \_\_\_ Previous NPDES number: SCR10 \_\_\_\_\_

LCP/ Overall Development Name: \_\_\_\_\_

C. Start Date (MM/DD/YYYY): \_\_\_/\_\_\_/\_\_\_\_\_ Completion Date: \_\_\_/\_\_\_/\_\_\_\_\_ (estimated)

September 1, 2008

**D. Type of Activity (check all that apply):**

- Commercial                       Residential: Single-family                       Linear (Roads, utility lines, etc.)
- Institutional                       Residential: Multi-family                       Site Preparation (No new impervious)
- Re-development                       Other: \_\_\_\_\_

**E.** Are there any flooding problems downstream of or adjacent to this site?  Yes  No

**F.** Are any portions of the site located in a designated floodplain?  Yes  No

If yes, what are the FIRM Numbers? \_\_\_\_\_

**IV. Waterbody Information**

**A.** Nearest receiving waterbody(s): \_\_\_\_\_ Distance to this waterbody (feet): \_\_\_\_\_

Next/Nearest named receiving waterbody(s): \_\_\_\_\_

**B. Wetlands/ Waters of the State**

	On the site?	If yes, delineated/ identified?	Impacts?	Amount of impacts
1. Waters of the U.S./ State	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	_____ Ac _____ Feet
2. Other (List): _____	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	<input type="checkbox"/> Yes <input type="checkbox"/> No	_____ Ac _____ Feet

2. If yes for delineation in item B.1, has documentation of the delineation from the USACOE been provided?

- Yes  No  N/A

3. If yes for impacts in item B.1, has a USACOE permit been applied for or obtained for those impacts?

- Yes  No  N/A                      If yes, list the permit/ application number. \_\_\_\_\_

**C. Special Protection Areas**

List the nearest DHEC water quality monitoring station(s) [WQMS(s)] to which stormwater (SW) discharges will drain: \_\_\_\_\_ Waterbody(s): \_\_\_\_\_

1. Is this WQMS listed on the most current 303(d) List for Impaired Waters?  Yes  No

a. If yes for (3.1), list the impairment(s). \_\_\_\_\_

b. If yes for (3.1), will construction SW discharges from your site contain the pollutant(s) of impairment?  Yes  No

c. If yes for (b), will use of the proposed BMPs ensure that the site's discharges will not contribute to or cause further water quality standard violations?  Yes  No

2. Has a TMDL(s) been developed?  Yes  No

a. If yes for (3.2), list the waterbody: \_\_\_\_\_ list the impairment(s): \_\_\_\_\_

b. Has the standard been attained for the impairment(s)?  Yes  No

c. If no for (b), will construction SW discharges from your site contain the pollutant of impairment?  Yes  No

d. If yes for (c), are your discharges consistent with the assumptions and requirements of the TMDL(s)?  Yes  No

e. If no for (d), will use of selected BMPs ensure that the site's discharges will not contribute to or cause further water quality standard violations?  Yes  No

**V. Preparer/Operator Information**

**A.** Plan Preparer: \_\_\_\_\_ S.C. Registration #: \_\_\_\_\_

Company/ Firm: \_\_\_\_\_ S.C. COA #: \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_

Phone: (Day) \_\_\_\_\_ - \_\_\_\_\_ - \_\_\_\_\_ (Mobile) \_\_\_\_\_ - \_\_\_\_\_ - \_\_\_\_\_ (Fax) \_\_\_\_\_ - \_\_\_\_\_ - \_\_\_\_\_

Email address: \_\_\_\_\_

**B.** Operator of Day-to-Day Site Activities (Company or person): \_\_\_\_\_

Site Contact (if ODSA is company): \_\_\_\_\_

Mailing Address: \_\_\_\_\_

City: \_\_\_\_\_ State: \_\_\_\_\_ Zip: \_\_\_\_\_



**City of North Charleston, South Carolina  
Public Works Department**

Phone: (Day) \_\_\_\_\_ (Mobile) \_\_\_\_\_ (Fax) \_\_\_\_\_

**VI. Signatures and Certifications**

- A. One copy of the stormwater plan, all specifications and supporting calculations, forms, and reports are herewith submitted and made a part of this application. I have placed my signature and seal on the design documents submitted signifying that I accept responsibility for the design of the system. Further, I certify to the best of my knowledge and belief that the design is consistent with the requirements of the City of North Charleston Stormwater Management Ordinance and the Permitting Standards and Procedures Manual. (This should be the person identified in Section V.A.)  
Please check one.

\_\_\_\_\_  
**Printed name of Plan Preparer**

\_\_\_\_\_  
**Signature of Plan Preparer**

\_\_\_\_\_  
**SC Registration #**

- B. I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I hereby certify that all construction and associated activity pertaining to this site shall be accomplished pursuant to and in keeping with the terms and conditions of the approved plans. I also certify that a responsible person will be assigned to the project for day-to-day control. I hereby grant authorization to the City of North Charleston's Public Works Department the right of access to the site at all times for the purpose of on site inspections during the course of construction and to perform maintenance inspections following the completion of the land-disturbing activity.

\_\_\_\_\_  
**Printed name of Owner/Operator**

\_\_\_\_\_  
**Signature of Project Owner/ Operator**

\_\_\_\_\_  
**Title/ Position**

- C. Designer Certification-One copy of the plans, all specifications and supporting calculations, forms, and reports are herewith submitted and made a part of this application. Three (3) full size sets and two (2) half-size sets of plans, all specifications and supporting calculations, forms, and reports shall be submitted upon approval. I have placed my signature and seal on the design documents submitted signifying that I accept responsibility for the design of the system. Further, I certify to the best of my knowledge and believe that the design is consistent with the City of North Charleston Stormwater Management Ordinance and the Permitting Standards and Procedures Manual.

\_\_\_\_\_  
**Signature**

\_\_\_\_\_  
**S.C. Registration Number**



## Instructions

### Completing the Application:

You must type or print legibly. You must include the original, signed application form, required fees, one copy of the stormwater plan, and one copy of all other supporting documentation with the initial submittal. Additionally, the checklist must be completed and attached; list how and where each item on the checklist was addressed (e.g., page 4 of the calculations).

### Who Must Submit an Application:

Any construction project disturbing one (1) acre or more unless exempted in the Ordinance and/or Manual.

### Projects located in the City of North Charleston submit to:

City of North Charleston  
Department of Public Works  
1021 Aragon Street  
North Charleston, S.C. 29405  
(843) 745-1026  
Fax: (843) 745-1099

Submit one (1) complete set of construction drawings with the application. Once the plans have been approved, submit four (4) full size copies and two (2) half-size plans.

**Project/ Site Name:** The Project/ Site Name should be a unique or distinguishing name (e.g., not Proposed Subdivision). The Department should be notified in writing if the Project/ Site Name changes.

**County:** If the project is in multiple counties, list all counties and indicate in which county the majority of the project will be.

### I. Project Information

- The official or legal name of the Project Owner/ Operator should be listed. If the Project Owner/ Operator is a company, then a Permit Contact person should be listed. This can be someone other than the person that has signatory authority for the company. All correspondence regarding this permit application will be sent to Permit Contact at the address listed.
- The Company EIN is the Employer Identification Number as established by the U.S. Internal Revenue Service.
- The Project Owner/ Operator is responsible for all portions of the site until a Project Closeout or Transfer of Ownership form is submitted.

### II. Property Information

- A. List a city/town only if the site is within the city/ town limits. See the following website for assistance in obtaining latitude/ longitude coordinates: [http://www.epa.gov/tri/report/siting\\_tool/index.htm](http://www.epa.gov/tri/report/siting_tool/index.htm). Latitude (from 32° to 35°) and longitude (78° to 83°) should be for the center of the site to the nearest 15". Minutes (') should be from 0 to 59, and seconds (") should be 0, 15, 30, or 45.
- B. If the Project Owner/ Operator does not own the project site, then list the official or legal name of the current Property Owner of the site. Permit coverage will be issued to the Project Owner/ Operator (Section I), not the Property Owner, unless same entity.

### III. Site Information

- A. The total and disturbed areas should be rounded to the nearest tenth of an acre. For subdivisions, if the exact build-out is not known, the disturbed area can be estimated using the following equation:  
Disturbed area = 2(Maximum Footprint of House)(# of lots) + Road/ Right-of-Way areas + Other easements/ disturbance. Please note that the City must be notified if the actual disturbed area is greater than the disturbed area listed on the application.
- B. If master stormwater calculations have been prepared and/ or submitted for an entire site, then all phases and parcels at that site would be considered part of a LCP. If this project is the first phase of an LCP, then this item should be answered yes and the LCP/ Overall Development name should be listed. This LCP/ Overall Development name should also be listed on all applications for future projects that are part of this LCP, including subsequent phases. If the project is part of an LCP, then list the previous state permit number and previous NPDES coverage number (not SCR100000).



**City of North Charleston, South Carolina  
Public Works Department**

- C. List the estimated start and completion dates of the construction activity.
- D. Institutional includes schools and other publicly owned projects, except linear projects. Site Preparation includes clearing, grubbing, and grading only; no new impervious areas should be proposed if this activity type is checked.
- E. If yes, then the extent of the flooding problems and the effect of this project on those problems must be explained in the project narrative.
- F. If any of the property is located inside an urbanized area or MS4, then list the entity. See the following website for information about MS4's: <http://www.scdhec.gov/water/html/swnms4page.html>. Urbanized area boundary maps are available at <http://cfpub.epa.gov/npdes/stormwater/urbanmapresult.cfm?state=SC>.

**IV. Waterbody Information**

- A. The nearest receiving waterbody is the nearest waters of the State to which the site's stormwater will discharge. If this waterbody is unnamed, then provide a description that references the nearest, named waterbody (e.g., tributary to Grove Creek). If the site's stormwater discharges to multiple waterbodies, then list all such waterbodies and attach additional sheets, if necessary.
- B. Complete the "On the Site?" column for items a-c. If yes is selected for that column, then the next 3 columns must be completed. If there are other waters of the U.S./ State (WoS) on the site not listed in items a and b (e.g., stream, river, lake, pond), then list those in item c. Delineation means identification by U.S. Army Corps of Engineers (USACOE) or wetlands consultant. If there are WoS within 100' of the disturbed area that were not delineated/identified, then explain this in the narrative; this includes WoS that are not on the project site but are within 100' of the disturbed area. If construction activities will occur in and/ or will impact WoS, then select yes for "Impacts?" and list the amount of impacts to WoS. Provide an additional, separate plan sheet that shows all WoS on the site and the impacted areas. If there are proposed impacts to WoS, please contact USACOE (866-329-8187) and S.C. DHEC Water Quality Certification, Standards & Wetlands Programs Section (803-898-4300) to determine additional requirements before submitting this NOI. In the **SCCZ**, also contact S.C. DHEC Page 7 OCRM Wetlands Section (843-953-0200). Please note that it is the Project Owner/ Operator's responsibility to ensure that all WoS are shown and identified in the SWPPP. USACOE is U.S. Army Corps of Engineers. If there are impacts to waters of the U.S./ State (should be listed in item IV.B), then list all permits and certifications that have been applied for or obtained for those impacts. Describe the activity(s), whether the impact is permanent or temporary, and any other relevant information. Provide a copy of all permits and certifications for and correspondence with USACOE and DHEC for the impacts. Make sure to include all plats referenced in the permits or correspondence.
- C1. If there are flooding problems, the extent of the flooding problems and the effect of this project on those problems must be explained in the Project Narrative.
- C2. If the site falls within a designated flood plain, list the zone and FIRM number.
- C3. Maps showing WQMS locations are available at the following website for each watershed: <http://www.scdhec.gov/environment/water/tmdl/index.htm> - 303d. List the nearest DHEC WQMS(s) and corresponding waterbody(ies).
  - 3.1 See the following website for the most current 303(d) List for Impaired Waters and related information: <http://www.scdhec.gov/environment/water/tmdl/index.htm#303d>. To search this document to determine whether a WQMS is listed, select "Edit" from the top toolbar. Then, select "Find". Enter the WQMS exactly as listed on the map and hit enter. If none of the WQMS(s) are found, then select no for item 3.1 and proceed to item 3.2. If any of the WQMS(s) are found within the document, then select yes and proceed to item 3.1.a.
    - a. List the cause(s) of the impairment (see last column labeled "CAUSE") for the WQMS(s) and proceed to item b.
    - b. DHEC has determined that construction SW discharges are expected to contain pollutants causing the following impairments: TURBIDITY, BIO (Macroinvertebrate), TP (Total Phosphorus), and TN (Total Nitrogen). You should carefully evaluate whether the site's constructions SW discharges will contain any pollutants causing other impairments, not explicitly listed above. You should also consider previous land uses at the site in answering this question. For example, if the previous land use was a copper processing facility and the impairment at the nearest WQMS is copper, then you should carefully evaluate whether the site's construction SW discharges would contain copper. If this question is answered yes and the disturbed area is less than 25 acres, then provide an evaluation of the site's proposed Best Management Practices (BMPs) as described in section 3.4.C.2(c) of the CGP. If this question is answered yes and the disturbed area is greater than or equal to 25 acres, then provide a written qualitative and quantitative assessment of the site's proposed BMPs as described in section 3.4.C.2(c) of the CGP. **See item 22 on the checklist.**
    - c. If the answer to this question is no, then the site is not eligible for coverage under the CGP.



**City of North Charleston, South Carolina  
Public Works Department**

- 3.2 See the following website for a list of all WQMS with Approved S.C. Total Maximum Daily Loads (TMDLs): [http://www.scdhec.gov/environment/water/tmdl/docs/tmdl\\_2008sites.pdf](http://www.scdhec.gov/environment/water/tmdl/docs/tmdl_2008sites.pdf). To search this document to determine whether a WQMS is listed, select “Edit” from the top toolbar. Then, select “Find”. Enter the WQMS exactly as listed on the map and hit enter. If none of the WQMS(s) are found, then select “No” for item 3.2 and proceed to item V. If any of the WQMS(s) are found within the document, then select yes and proceed to item (a). The same document will be used for item 3.1a.
- List the cause(s) of the impairment (see 7th column labeled “CAUSE”) and proceed to item b. If the WQMS(s) is impaired for more than one parameter, then the WQMS will be listed multiple times on successive rows. The same document will be used to answer item b.
  - See the 8th column labeled “USE SUPPORT” to determine if the standard has been attained for each impairment for each WQMS. “FULLY SUPPORTED” means the standard has been attained for the impairment listed in the “CAUSE” column. “NOT SUPPORTED” means that the standard has NOT been attained for that impairment. If the standard has NOT been attained for all impairments for all WQMS(s), then select no and proceed to item c. If the standard has been attained for all impairments for all WQMS(s); select yes and proceed to item d.
  - DHEC has determined that construction SW discharges are expected to contain pollutants causing the following impairments: TURBIDITY, BIO (Macroinvertebrate), TP (Total Phosphorus), and TN (Total Nitrogen). You should carefully evaluate whether the site’s constructions SW discharges will contain any pollutants causing other impairments, not explicitly listed above. You should also consider previous land uses at the site in answering this question.
  - Check the TMDL to make sure the site meets the assumptions and requirements. If the site cannot meet the appropriate TMDL, BMPs must be used.
  - If the answer to this question is no, then the site is not eligible for coverage under the CGP.

**V. Preparer/Operator Information**

- Enter the name and registration number of the stormwater plan preparer. S.C. COA is the company’s S.C. Certificate of Authorization. Enter N/A for S.C. COA if the firm does not have a COA or the preparer is an individual. If an email address is entered, the Director may contact the plan preparer via email.
- Enter the name of the operator or day-to-day site operations contact and pertinent information.

**VI. Certifications**

- The same registered professional must sign and seal the application, drawings, calculations, and supporting documentation.
- A person with signatory authority for the Project Owner/ Operator must sign the application. The plan preparer cannot sign the application for the Project Owner/ Operator. The plans, all reports, including monthly reports, and any information requested by the Department must be signed by a person with signatory authority for the Project Owner/ Operator or a duly authorized representative.
  - Corporation: A responsible corporate officer (e.g., president, vice-president, certain managers)
  - Partnership or Sole Proprietorship: A general partner or the proprietor, respectively
  - Municipality, State, Federal or Other Public Agency: Principal executive officer or ranking elected official

**Office Mechanics and Filing**

This form and supporting documentation will be kept in the Public Works Department files (hard copy or digitized copy).



**CITY OF NORTH CHARLESTON, SOUTH CAROLINA**  
**Department of Public Works**  
**Engineering Division**

**Project Close-Out Application Form**

- A. Name of Project: \_\_\_\_\_
- B. Engineering Division Permit Number \_\_\_\_\_
- C. NPDES Permit Coverage Number (if applicable): SCR10 \_\_\_\_\_
- D. Owner Name: \_\_\_\_\_  
 Address: \_\_\_\_\_  
 City: \_\_\_\_\_, State: \_\_\_\_\_  
 Zip: \_\_\_\_\_  
 Phone: \_\_\_\_ - \_\_\_\_ - \_\_\_\_ Mobile: \_\_\_\_ - \_\_\_\_ - \_\_\_\_ Fax: \_\_\_\_ - \_\_\_\_ - \_\_\_\_  
 Email Address (optional): \_\_\_\_\_
- E. Property Info:  Check Box if same as above  
 Address: \_\_\_\_\_  
 City: \_\_\_\_\_, South Carolina  
 Zip: \_\_\_\_\_  
 Tax Map Number(s): \_\_\_\_\_
- F. Previous Owner Name: \_\_\_\_\_  
 Address: \_\_\_\_\_  
 City: \_\_\_\_\_, State: \_\_\_\_\_  
 Zip: \_\_\_\_\_  
 Phone: \_\_\_\_ - \_\_\_\_ - \_\_\_\_ Mobile: \_\_\_\_ - \_\_\_\_ - \_\_\_\_ Fax: \_\_\_\_ - \_\_\_\_ - \_\_\_\_  
 Email Address (optional): \_\_\_\_\_
- G. Engineer, Technical Representative or Firm: \_\_\_\_\_  
 Address: \_\_\_\_\_  
 City: \_\_\_\_\_, State: \_\_\_\_\_  
 Zip: \_\_\_\_\_  
 Phone: \_\_\_\_ - \_\_\_\_ - \_\_\_\_ Mobile: \_\_\_\_ - \_\_\_\_ - \_\_\_\_ Fax: \_\_\_\_ - \_\_\_\_ - \_\_\_\_  
 Email Address (optional): \_\_\_\_\_
- H. Project Closeout Information: Date construction completed (MM/DD/YYYY): \_\_/\_\_/\_\_\_\_
- a. Is the entire site sufficiently stabilized? YES  NO
  - b. Are all stormwater facilities working properly and ready for long-term functioning? YES  NO
  - c. For stormwater systems that will be publicly owned and maintained, has a video of the conveyance system been provided to North Charleston Public Works Department? YES  NO
- I. Record/As-Built Information:
- a. Is a PDF or digital copy of the site plan, showing the as-built stormwater management system, attached to this form? YES  NO

Owner's Certification:

I hereby certify that all construction, development, and/or re-development has been completed in accordance with the City requirements and the City-approved project application and all information is truthful to the best of my knowledge. I realize that I am now responsible for the long-term maintenance of all stormwater management facilities, until a transfer of ownership has been approved by the Public Works Department in accordance with the Stormwater Management Ordinance. If a portion or all of the stormwater management system on this site will be publicly owned and maintained, I am providing a warranty by my signature that I will repair and/or replace those system components within the City's drainage easement(s) that fail within two (2) years from the date below.

\_\_\_\_\_  
 Owner's Printed Name

\_\_\_\_\_  
 Owner's Signature

\_\_\_\_\_  
 Date



## **APPENDIX B**

# **OPERATING PERMIT FOR MAINTENANCE**



**OPERATING PERMIT FOR PERMANENT MAINTENANCE  
OF STORMWATER FACILITIES**

I hereby certify that I will perform the duties as the owner(s) of the Stormwater Management Best Management Practices (BMPs) listed below that includes the listed maintenance activities and others not listed to ensure the systems' proper long-term functioning. I further certify that if ownership is transferred that I will ensure the continued maintenance of these facilities through the proper transfer of ownership responsibilities.

**Property Information**

**PARCEL/TMS #(S):** \_\_\_\_\_  
(Obtain from Registrar of Deeds office)

**NAME & TYPE OF BMP(S):** \_\_\_\_\_  
\_\_\_\_\_

**LOCATION OF BMP(S):** \_\_\_\_\_  
\_\_\_\_\_

**PROPERTY DEED RECORDED DATE:** \_\_\_\_\_

**TITLE OF SITE PLAN:** \_\_\_\_\_  
(Should exactly match the title given on application for a construction permit)

**PROJECT ENGINEERING FIRM:** \_\_\_\_\_

**PROJECT CONSTRUCTION FIRM:** \_\_\_\_\_

**NUMBER & DATE OF CONSTRUCTION PERMIT:** \_\_\_\_\_

**Property Owner(s)**

**OWNER #1:** \_\_\_\_\_  
**ADDRESS:** \_\_\_\_\_  
**CITY:** \_\_\_\_\_ **STATE:** \_\_\_\_\_ **ZIP CODE :** \_\_\_\_\_  
**PHONE:** \_\_\_\_\_ **FAX:** \_\_\_\_\_ **E-MAIL:** \_\_\_\_\_

**SIGNATURE:** \_\_\_\_\_ **DATE:** \_\_\_\_\_

**OWNER #2:** \_\_\_\_\_  
**ADDRESS:** \_\_\_\_\_  
**CITY:** \_\_\_\_\_ **STATE:** \_\_\_\_\_ **ZIP CODE :** \_\_\_\_\_  
**PHONE:** \_\_\_\_\_ **FAX:** \_\_\_\_\_ **E-MAIL:** \_\_\_\_\_

**SIGNATURE:** \_\_\_\_\_ **DATE:** \_\_\_\_\_

## Responsibilities

1. **Regular Inspections:** Inspections shall be performed at least twice a year and more regularly as listed below or as specified by a manufacturer. Inspection reports shall be generated and kept on file for at least 2 years. Reports are to be made available to the City of North Charleston upon request. If generated by a third party, it shall remain the owner's (or owners') responsibility to maintain the reports.
2. **Routine Maintenance:** Some maintenance activities are needed on a routine basis, as listed below. The activities listed should be performed on a monthly basis or more frequently if needed or unless specified below or by a manufacturer.
  - a. **Vegetation Management:** if applicable, grass should be mowed bimonthly or more frequently if needed.
  - b. **Inlet and Outlet Structures:** any blockage of inlets and outlets structures should be removed. Inlet and outlet protection should be repaired or replaced as needed.
  - c. **Debris and Litter:** trash and other debris that collects in the BMP should be removed.
3. **Sediment Removal:** BMPs will trap sediments and other settleable material over time and this material should be removed once the storage capacity has been reduced by 33%. Removal of the sediment shall occur no less frequently than once every year or as specified by the manufacturer. If a forebay exists, any trash, sediment, or other debris should be completely removed as discovered through routine maintenance activities or inspections.
4. **Slope Stabilization/Structural Integrity:** Slope erosion, sink holes, or other structural issues should be repaired as soon as discovered through routine maintenance activities or inspections.

### Additional Responsibilities

List any additional routine or long-term activities to be performed on the BMP(s). This area may also be used to replace the list of maintenance activities listed above or to list manufacturer requirements.

---

---

---

---

---

---

---

---

---


---

**Note:** The City of North Charleston reserves the right to alter the maintenance schedule and activity as necessary to ensure the proper functioning of the BMP.



# **APPENDIX C**

## **PERMITTING PROCESS FLOWCHART**

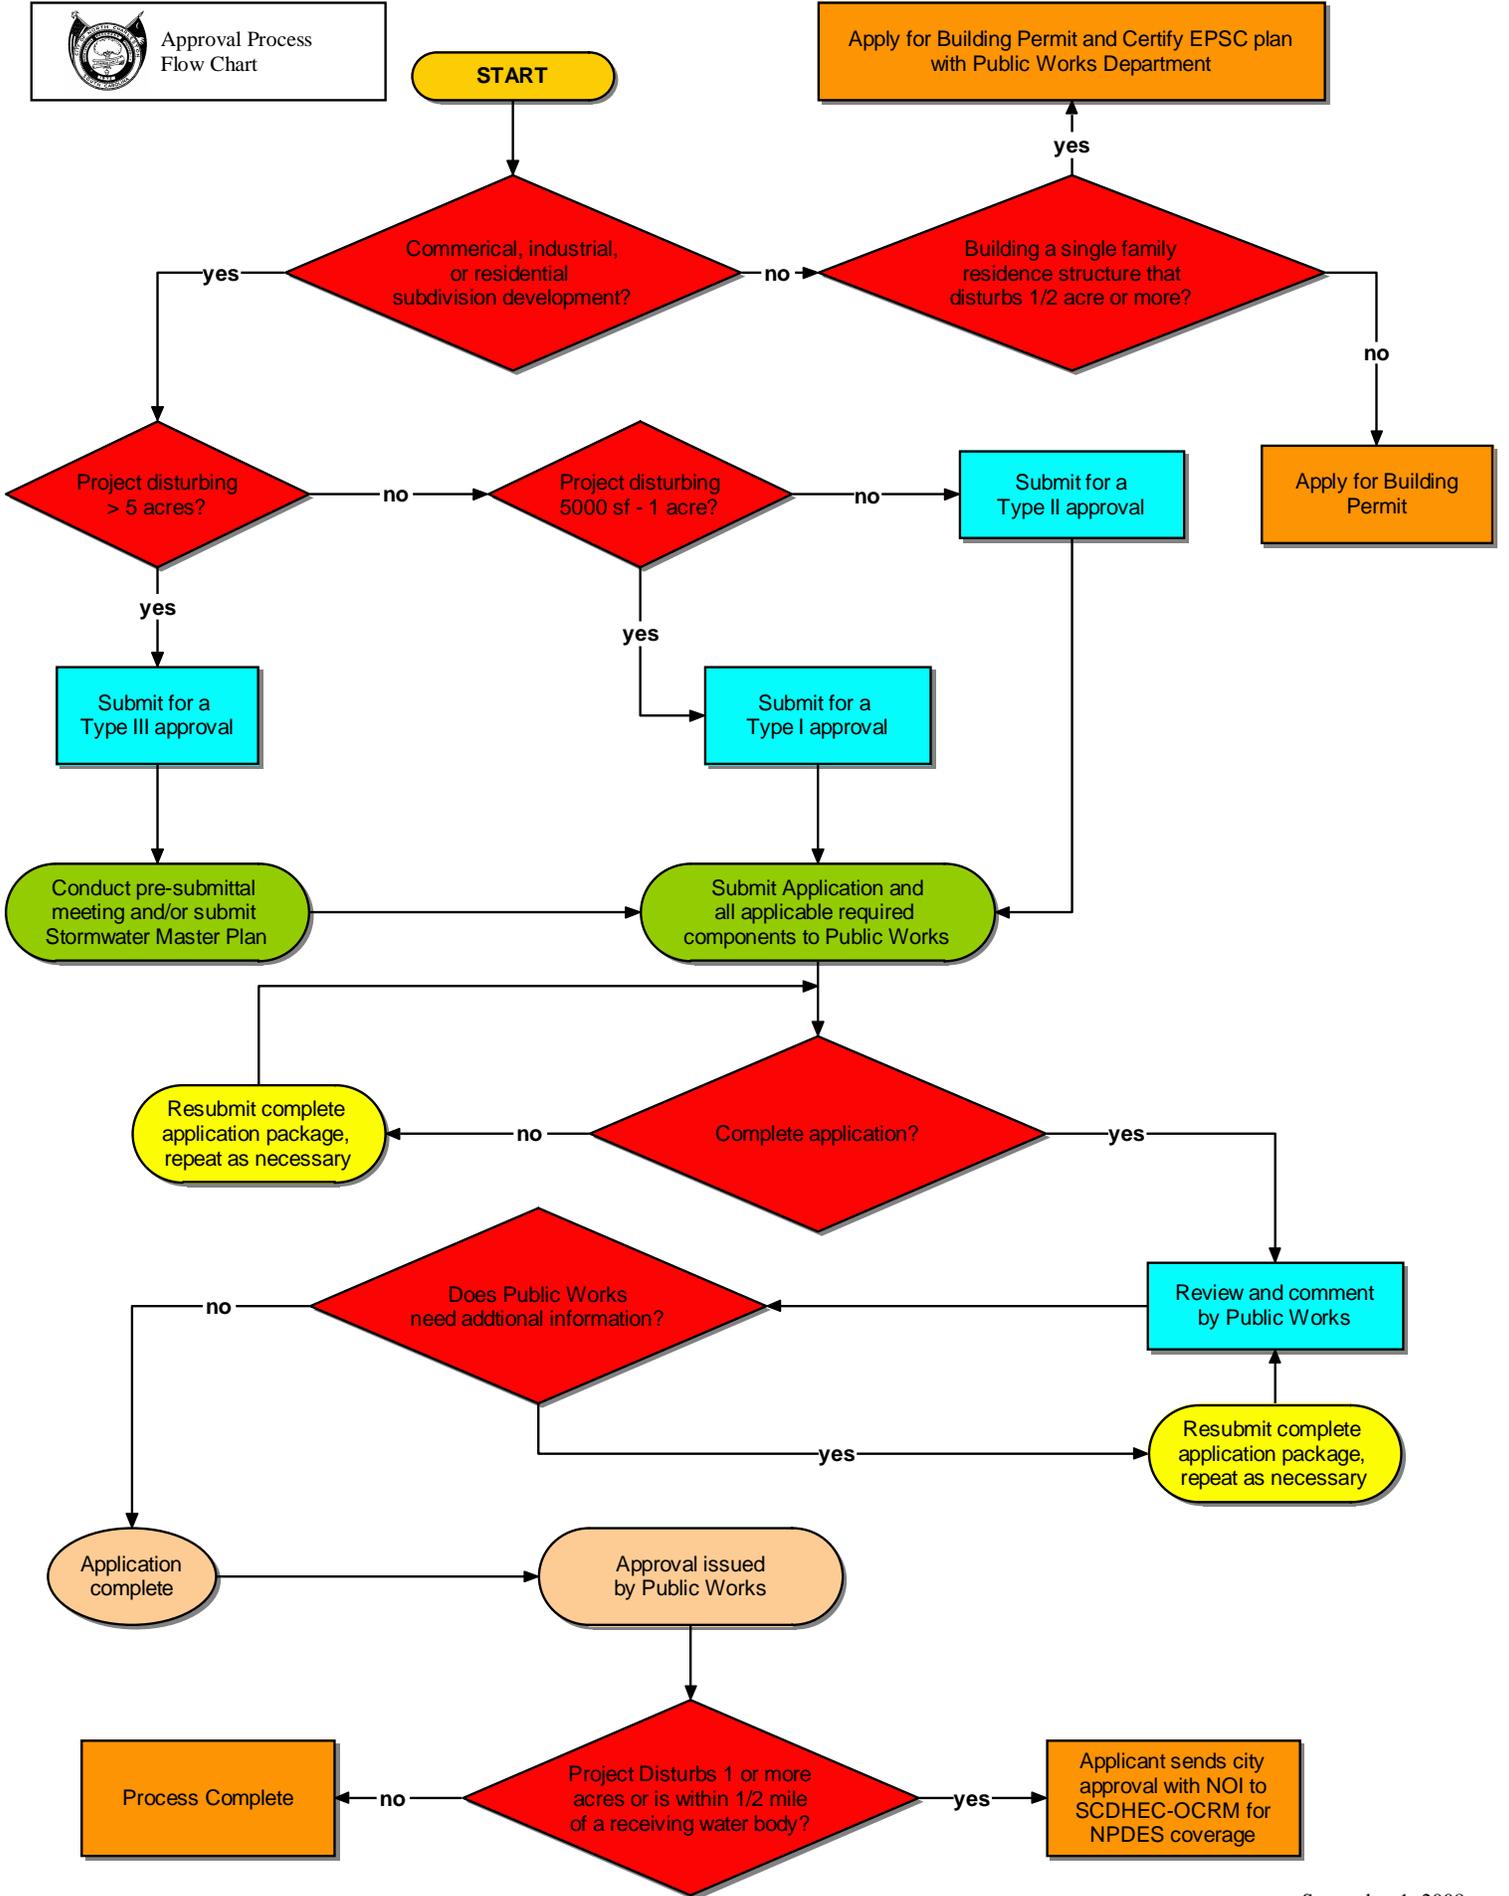



# **APPENDIX D**

## **TABLES OF BMP SUGGESTED USES**

## EROSION PREVENTION BMP SUGGESTED USES

BMP	Slope Protection	Waterway Protection	Surface Protection	Enclosed Drainage	Large Flat Areas	Borrow Areas	Adjacent Properties
<b>Erosion Prevention Measures</b>	X	X	X	X	X	X	X
Surface Roughening	X		X				
Bench Terracing	X		X				
Temporary Seeding	X		X		X	X	X
Mulching	X				X	X	
Erosion Control Blankets and Turf Reinforcement Mats	X	X	X			X	
Final Stabilization	X		X		X		X
Topsoiling			X		X		
Permanent Seeding and Planting of Grasses	X		X		X		X
Permanent Ground Cover Plants	X		X				X
Sodding	X		X		X		X
Riprap or Aggregate	X	X	X				
Outlet Protection		X		X			X
Dust Control					X	X	X
Polyacrylamide (PAMs)	X		X	X	X	X	X

## TEMPORARY SEDIMENT CONTROL BMP SUGGESTED USES

BMP	Slope Protection	Waterway Protection	Surface Protection	Enclosed Drainage	Large Flat Areas	Borrow Areas	Adjacent Properties
Temporary Sediment Control Structures	X	X	X	X	X	X	X
Storage Volumes and Maintenance Schedules		X		X			X
Temporary Sediment Basin		X	X	X			X
Multipurpose Basin		X	X	.X			X
Temporary Sediment Trap		X	X				X
Silt Fence	X	X					X
Rock Ditch Check			X				X
Stabilized Construction Entrance					X		X
Storm Drain Inlet Protection		X		X			X
Vegetated Filter Strips		X					X
Rock Sediment Dike		X	X				X

## RUNOFF CONTROL AND CONVEYANCE BMP SUGGESTED USES

BMP	Slope Protection	Waterway Protection	Surface Protection	Enclosed Drainage	Large Flat Areas	Borrow Areas	Adjacent Properties
Pipe Slope Drains	X		X				
Temporary Stream Crossing		X	X				X
Runoff Conveyance Measures	X					X	X
Construction De-watering		X		X	X	X	
Level Spreader			X		X		X
Subsurface Drains			X		X		

## STRUCTURAL STORMWATER QUALITY BMP SUGGESTED USES

BMP	Land Requirement	Single Family	Multi Family	Low Density Commercial	High Density Commercial	Low Density Industrial	High Density Industrial
Wet Storm Water Ponds	MODERATE - HIGH	X	X	X	X	X	X
Wet Extended Pond	MODERATE - HIGH	X	X	X	X	X	X
Micropool Extended Pond	MODERATE - HIGH	X	X	X		X	
Shallow Wetland	MODERATE - HIGH	X	X	X		X	
Extended Detention Shallow Wetland	MODERATE - HIGH	X	X	X		X	
Pond/Wetland System	MODERATE - HIGH	X	X	X		X	
Pocket Wetland	MODERATE	X	X		X		X
Bioretention Areas	MODERATE	X	X	X	X	X	X
Sand Filtration Facilities	LOW			X	X	X	X
Infiltration Trenches	MODERATE	X	X	X	X	X	X
Enhanced Dry Swales	HIGH	X	X	X		X	
Pre-Fabricated Control Devices	LOW		X	X	X	X	X

## STRUCTURAL STORMWATER QUALITY BMP CHARACTERISTICS

BMP	Maintenance Burden	Costs	Aesthetically Pleasing	Provide Habitat	Drainage Area (Acres)	Soils
Wet Storm Water Pond	LOW	LOW	X	X	10 MIN 25 PREFERRED	HSG A SOILS MAY REQUIRE POND LINER
Wet Extended Pond with Aquatic Bench	LOW	LOW	X	X	10 MIN 25 PREFERRED	HSG B SOILS MAY REQUIRE INFILTRATION TESTING
Micropool Extended Pond	MODERATE	LOW	X	X	10 MIN	
Shallow Wetland	MODERATE	MODERATE	X	X	20 MIN	HSG A AND B SOILS MAY REQUIRE LINER
Extended Detention Shallow Wetland	MODERATE	MODERATE	X	X	20 MIN	
Pond/Wetland System	MODERATE	MODERATE	X	X	20 MIN	
Pocket Wetland	HIGH	MODERATE	X	X	5 MIN	
Bioretention Areas	LOW	MODERATE	X	X	5 MAX	CLAY OR SILTY SOILS MAY REQUIRE PRETREATMENT
Sand Filtration Facilities	HIGH	HIGH			5 MAX 2 PREFERRED	INFILTRATION RATE > 0.5 IN/HR
Infiltration Trenches	HIGH	HIGH			5 MAX	PERMEABLE SOIL
Enhanced Dry Swales	LOW	MODERATE			5 MAX	
Pre-Fabricated Control Devices	HIGH	HIGH	X (HIDDEN)		VARIES	NO REQUIREMENT

## STRUCTURAL STORMWATER QUALITY BMP SUGGESTED USES

BMP	Water Quality	Channel Protection	Flood Protection	TSS Removal	Nutrient Removal	Metal Removal	Bacterial Removal
Wet Stormwater Pond	X	X	X	HIGH	MODERATE	MODERATE	MODERATE
Wet Extended Pond with Aquatic Bench	X	X	X	HIGH	HIGH	MODERATE	MODERATE
Micropool Extended Pond	X	X	X	HIGH	MODERATE	MODERATE	NO DATA
Shallow Wetland	X	X	X	HIGH	HIGH	MODERATE	HIGH
Extended Detention Shallow Wetland	X	X	X	HIGH	HIGH	MODERATE	HIGH
Pond/Wetland System	X	X	X	HIGH	HIGH	MODERATE	HIGH
Pocket Wetland	X	X		HIGH	HIGH	MODERATE	HIGH
Bioretention Areas	X			HIGH	MODERATE	MODERATE	NO DATA
Sand Filtration Facilities	X			HIGH	MODERATE	MODERATE	MODERATE
Infiltration Trenches	X			HIGH	MODERATE	HIGH	HIGH
Enhanced Dry Swales	X			HIGH	MODERATE	MODERATE	LOW
Pre-Fabricated Control Devices	X			HIGH	LOW-HIGH	LOW-HIGH	LOW-HIGH

## STRUCTURAL STORMWATER QUALITY BMP TRAPPING EFFICIENCY

BMP	Pollutant Removal Efficiency %					
	Monitoring	TSS	TP	TN	Nitrate Nitrogen	Other
<b>Surface Sand Filters</b>	Yes	85	55	35	Neg	Bacteria 40-80 Metals 35-90
<b>Perimeter Sand Filters</b>	Yes	80	65	45	Neg	Hydrocarbons 80
<b>Organic Sand Filter</b>	Yes	95	40	35	Neg	Hydrocarbons 80 Soluble P Neg Metals 85
<b>Gravel Filter</b>	Yes	80	80	65	75	Hydrocarbons 85 Metals 50-75
<b>Dry Enhanced Swales</b>	Yes	90	65	50	80	Metals 80-90
<b>Wet Enhanced Swales</b>	Yes	80	20	40	50	Metals 40-70
<b>Plain Drainage Channel</b>	Yes	30	10	0	0	Bacteria Neg
<b>Vegetated Drainage Channel</b>	Yes	65	25	15	Neg	Hydrocarbons 65 Metals 20-50 Bacteria Neg
<b>Vegetated Filter Strip</b>	Yes	70	10	30	0	Metals 40-50

Should be used as a general guide to expected effectiveness and not for design purposes.



# **APPENDIX E**

## **PLAN REVIEW CHECKLIST**



## **CITY OF NORTH CHARLESTON CHECKLIST FOR DESIGN OF NEW AND RE-DEVELOPMENT PROJECTS**

This checklist will be used by the City of North Charleston Plan Reviewers or others employed by the Public Works Director, in reviewing proposed construction activities. This checklist shows the components that must be provided by the applicant per the project types (SFR, Type I and Linear Utility, and Type II and III).

The submitted information typically includes three parts: the application, the technical engineering calculations and discussions, and the construction documents (plans, details, specs, SWPPP).

### **I. APPLICATION FORM**

**Application Types: ALL**

- All application items should be complete and answered sufficiently.
- Signatory authority (original signatures) should be provided where requested.
- Any fees to be returned to applicant.

### **II. TECHNICAL REPORT/ENGINEERING CALCULATIONS**

#### **1. REPORT COMPOSITION:**

**Application Types: II and III**

- Table of Contents.
- A summary table to include at least the following:
  - a. all hydrologic results (design storms and distribution type, peak discharges, pre- and post-development, CN, Tc, PRF),
  - b. results of hydraulic calculations (road overtopping, velocities, 100-yr event analysis) calculations and methodologies,
  - c. methodology/models used,
  - d. tidal considerations,
  - e. some documentation showing that peak stages are below minimum finished floor elevation and that during the 100 year storm event ponds pass this event without overtopping (including the 1 foot freeboard) and the system would not result in an increased frequency of dwelling flooding, property damage or public access &/or utility interruption, and
  - f. results of water quality calculations.
- Report should be put together in a manner that facilitates review.
- Report prepared by licensed professional.
- Two copies to be submitted.

#### **2. MAP(S):**

**Application Types: ALL**

- Include north arrow and scale on all maps.
- Outlined project location.
- Labeled road names.
- Nearest waterbodies, discharge points, and waters of the state.
- Location of any nearby protected areas (waters, wetlands, etc.)
- Topographic information showing runoff patterns/overland flow paths.
- Soil types.



- 100-year floodplain contours.
- Wetlands.
- Simple sketches will suffice for SFR, Utility, and Type I applications.

### **3. PROJECT NARRATIVE:**

**Application Types: ALL**

- A description of the site in general, purposes of the construction activity, any issues with adjacent properties and owners, waterbodies receiving stormwater runoff, any issues with site soils, existing water quality and flooding issues, anticipated impacts (quality, downstream structures, etc.) and benefits (open space, treatment, maintenance, etc.), and reasons for waiver request.
- A summary table of existing and proposed runoff flows, volumes, and pollutant loads.
- A discussion of issues relating to other State and Federal permits needed or regulations to be followed.
- A summary of the maintenance of the stormwater system and arrangements for post-construction maintenance responsibility. Maintenance agreements and/or operating permits must be provided in the application or otherwise addressed.
- This narrative should be much more detailed for larger (Types II and III) projects.
- Simple narratives will suffice for SFR, Utility, and Type I applications.

### **4. HYDROLOGIC ANALYSIS:**

**Application Types: II and III**

- Proper delineation of the site shown on maps or construction plans (24" x 36" sheets).
- Pre- and post- development hydrologic analysis calculations for the 2-, 10-, and 100- year storm events, as necessary, at each outfall point. Analysis should be performed at the same points and with the same drainage area for both pre- and post-development conditions and correspond to the delineation. Hydrograph calculations should be provided as needed.
- Analysis performed using SCS methodology (Rational method not acceptable for Types II and III applications) or other if acceptable to Public Works.
- Use rainfall data from Chapter 3.

### **5. DETENTION ANALYSIS/DESIGN:**

**Application Types: II and III**

#### **Analysis**

- Pond routing using a volume based hydrograph for the 2-, 10-, and 100-year SCS 24-hour rainfall event (Drain:Edge, ICPR, HEC-1, SedCAD, HYDRAFLOW, etc. perform full pond routings: TR55 does not perform a full pond routing; rational method cannot be used).
- Hydrologic and hydraulic calculations necessary to determine the impact of hydrograph timing modifications of the proposed land disturbing activity, with and without the pond (results of analysis will determine the need to modify the pond design or eliminate the pond requirement-see note in item 10).
- Inputs and outputs from analysis program.
- Summary table of the peak inflows, peak outflows, and maximum water surface elevations (WSE) for the 2, 10, and 100-year storm events for each pond.
- Stage-storage-discharge relationship for the outlet structure of each detention structure.
- If a rating curve for the outlet structure must be generated externally from the analysis program (Drain:Edge, HEC-1, HydroCAD), data and equations used to rate the outlet structure.



### Design

- Detail of outlet structure and cross-section of the dam, including elevations and dimensions that correspond to the calculations.
- Orifice constructability considered (do not specify orifice diameters with increments of less than 1/4").
- Pond banks shall have one (1) foot of freeboard above the design storm event. In addition, ponds must be able to pass the 100 year storm event without overtopping the banks.
- The volume within any structure used for water quantity control shall be drained from the structure within 72 hours.
- Bottom of all detention and retention ponds graded to have a slope of not less than 0.5% and side slopes no steeper than 3:1 unless adequately protected.
- If the pond is to be used for sediment control during construction, outlet structure should be sufficiently protected.
- Permanent maintenance access to all permanent detention structures (easements may be needed for structures surrounded by lots).
- Infiltration and underground detention systems designed in accordance with Chapter 3.
- Emergency spillways should not be built on fill slopes.
- If a pond is to be used to meet water quality requirements and it is capturing runoff from 1 or more acres, a forebay, designed in accordance with this manual, is required.
- Installation of a trash rack or other debris-screening device is recommended on all pond risers.

### 6. HYDRAULIC DESIGN:

**Application Types: II and III**

- Design calculations for all conveyances, inlets, and outlets based on the contributing area, allowable velocities, and upstream and downstream conditions.
- Upstream and downstream analysis showing the project will not impact new and existing structures or reduce downstream system capacity.
- Check to make sure the proper design storms were used at the appropriate design points.

### 7. WATER QUALITY REQUIREMENTS:

**Application Types: II and III**

- All sites which disturb one (1) acre or greater shall include best management practices (BMPs) to address water quality, along with an Operation and Maintenance Agreement that guarantees maintenance of all BMPs in perpetuity.
- All permanent water quality ponds having a permanent pool shall be designed to store and release a water quality volume (WQV) defined as the first one-half (1/2") inch of runoff (First Flush) over a 24 hour period. The "first flush" volume should be determined from the contributing watershed area (impervious and pervious) that drains to the water quality pond (s).
- Permanent water quality ponds, not having a permanent pool, shall be designed to store and release the first 1-inch (1") of runoff from the contributing watershed area over a minimum period of 24-hours.
- For areas not draining to a pond, it should be demonstrated how permanent water quality requirements will be addressed.
- Other non-traditional stormwater controls such as Bioretention areas and constructed wetlands may be used if adequate removal efficiencies can be demonstrated.
- Pre-fabricated or proprietary treatment devices are approved on a case-by-case basis if adequate removal efficiency can be demonstrated. Provide pollutant removal efficiency



data, preferably from a third-party testing company. Type of system to be used should be based on the ability to remove the pollutants of concern in that area/situation (i.e. bacteria, hydrocarbons, etc.).

- Waters of the U.S./State shall not be used for permanent water quality control. (Alternative means of treatment must be used if an existing pond is to be used for water quantity control).

**8. INLET PROTECTION:**

**Application Types: II and III**

- Provided at all inlets (no hay bales).
- Steel or wooden posts and buried fabric shown for filter fabric inlet protection.
- Inlet protection details provided for pre-paving and after roadways have been paved.

**9. DISCHARGE POINTS:**

**Application Types: II and III**

- The post-development discharges rates should be less than pre-development discharges for each discharge point for the 2-, 10, and 25-year storm events. If not, then a detention waiver should be requested.
- Storm drainage or pond outfalls are carried to an existing drainage outfall such as a pipe, ditch, easement, etc.
- No new point discharges onto adjacent property where there was not a point discharge previously without providing the adjacent property owner's written permission.
- Level spreaders, plunge pools, etc. provided when the proposed outlet is near the property line.
- If feasible, provided a 20-foot minimum buffer between the property line and the end of all pipes or energy dissipation measures installed.
- Outlets do not discharge on fill slopes.
- Discharge pipes greater than 24" require headwall with wings.
- Headwalls required in major drainage channels.
- All outlets stabilized.
- Riprap aprons sized appropriately.
- Riprap detail shows apron dimensions and stone sizes.
- Filter fabric installed beneath all riprap.

**10. SLOPE AND/OR CHANNEL STABILIZATION:**

**Application Types: II and III**

- All slopes designed and stabilized properly.
- All channels and diversion ditches must be able to handle the 10-year storm event with non-erosive velocities during construction and post-construction.
- Rock check dams provided in temporary diversion.
- Installation detail for erosion control blanket (ECB) or turn reinforcement matting (TRM) if ECBs or TRMs to be used.
- Slope drains provided where concentrated flows discharge onto a fill slope.
- For all slopes steeper than 1.5:1, identification of stabilization practice (e.g., ECB, TRM).  
Note: Measures, in addition to grassing or hydroseeding, include synthetic or vegetative matting, diversion berms, temporary slope drains, etc.  
Note: If retaining walls or fill slopes are to be constructed at the downstream property line, a 10' buffer is recommended for construction and maintenance.



**11. UTILITY/LINEAR LINES:**

**Application Types: II, III, and Utility**

- Limits of disturbance include areas disturbed for water, sewer, gas, and electric line installation.
- Check for coverage by SCDHEC on utility company and for coordination with permit holder.

**12. SEDIMENTOLOGY:**

**Application Types: III**

- BMPs should be properly placed (silt fence, inlet protection, construction entrance, rip-rap at outfalls, check dams etc.).
- For projects that disturb five (5) or more acres, trapping efficiency calculations must be included which demonstrate that all sediment basins/ traps or other BMPs are capable of achieving a sediment trapping efficiency of 80 percent for suspended solids. The efficiency shall be calculated for disturbed conditions for the 10-year 24-hour design event.
- Sediment basins provide storage for the 10-year, 24-hour storm event for disturbed conditions if 10 acres or more drain to a common point (stream, lake, property line, etc.).
- Sediment traps only used for drainage areas of less than 5 acres.
- Trapping efficiency calculations should be complete, specifying methods, assumptions, and results.
- Sediment basins and traps designed for total area draining to them.
- Drainage area map should outline the area draining to each basin/trap.
- Copies of any figures used to determine  $V_{15}$  and trapping efficiencies. The Design Aids in SCDHEC (2003) can be used for these calculations.
- Silt fence only used in areas with drainage areas of less than  $\frac{1}{4}$  acre per 100 LF of fence and not used in areas with concentrated flows.
- Clean-out stake, marked at  $\frac{1}{2}$  the designed sediment storage depth, provided in all sediment basins/ sediment traps.
- Tree cutting shall be subject to the provisions of the City's Tree Protection Ordinance in Appendix A – Zoning Regulations.
- Construction schedule with timeline for each activity.

Note: SCDHEC (2003) and SCDHEC (2005) provide information on the design of these and other devices.

Note: The Design Aids in SCDHEC (2003) cannot be used to determine trapping efficiencies for structures in series. If the flow for the 10-year, 24-hour storm for construction conditions overtops the structure or the structure's spillway, then the Design Aids cannot be used. If multiple soil types are in the area draining to the structure, then the soil type with the smallest  $D_{15}$  for the appropriate depth should be used to determine the settling velocity,  $V_{15}$ ; an average  $D_{15}$  should not be used.

**13. WATERS-OF-THE-STATE, INCLUDING WETLANDS:**

**Application Types: ALL**

- Delineation of all waters of the State (WoS) located on the site, including wetlands, shown and labeled on plans.
- If impacts to WoS, outlined areas of impacts and labeled that no work can begin in this area until all necessary USACE permits and SCDHEC 401 certifications have been obtained.
- Double row of silt fence provided in all areas where a 50' undisturbed buffer cannot be maintained between the disturbed area and the WoS.



- Minimum 10' maintenance buffer provided between last row of silt fence and WoS; or, if buffer not provided, then statement from P.E. on plans indicating how silt fence will be installed and maintained without impacts to WoS.

Note: If there are proposed impacts to WoS, then applicant must contact the UCACE (866-329-8187) and/or S.C. DHEC Water Quality Certification, Standards & Wetlands Programs Section (803-898-4300) to determine additional requirements before submitting this application.

Note: If WoS are to be impacted, work cannot be performed in these designated areas until all necessary permits have been acquired.

Note: If USACE permit is required for construction of a permanent stormwater management structure, City final approval cannot be granted until all applicable State and Federal permits have been obtained. A preliminary approval is issued instead.

Note: A 50-foot buffer between a sediment trap/basin and waters of the State and wetland areas is recommended.

#### **14. SPECIAL PROTECTION AREAS:**

**Application Types: II and III**

- List the nearest S.C.DHEC Water Quality Monitoring Station (WQMS) that the site's stormwater discharges drain to and the waterbody on which it is located.
- Qualitative and quantitative assessment (described in Section 3.4C of SCR100000), if nearest WQMS is listed on the most recent 303(d) List of Impaired Waters and if site's stormwater construction discharges contain the pollutant of impairment and if the site disturbs 25 or more acres.
- Evaluation of selected BMPs if nearest WQMS listed on the most recent 303(d) List of Impaired Waters and if site's stormwater construction discharges contain the pollutant of impairment and if site disturbs less than 25 acres.
- If an Approved TMDL has been developed for the nearest WQMS and if the site's stormwater construction discharges contain the pollutant of impairment, show that measures and controls on the SWPPP met assumptions and requirements of TMDL (may need to contact DHEC Watershed Manager for assistance).

#### **15. POST-CONSTRUCTION MAINTENANCE PLAN:**

**Application Types: ALL**

- Signed agreement from a responsible party accepting ownership and maintenance of the stormwater management structures (Operating Permit).
- Description of maintenance plan to be used.
- Schedule of maintenance procedures, including time to replacement.
- Detailed or manufacturer-specific maintenance items for proprietary control devices (oil-water separators, etc.), underground detention structures, and non-traditional stormwater controls (constructed wetlands, bioretention, etc.).
- Typical maintenance items to be addressed:
  - o Grass to be mowed.
  - o Trees to be removed.
  - o Trash to be removed from within and around the pond outlet structure and outlet pipes to be cleaned, inspected, and repaired, sediment accumulation to be removed from pond(s).
  - o Energy dissipator to be cleaned and repaired.
  - o Pond bottom to be regraded to provide proper drainage towards the outlet discharge point and/or energy dissipator to be cleaned and repaired.



- Emergency spillway, if applicable, to be inspected and erosion repaired on side slopes, if present.
- The Public Works Director must be notified in writing of any changes in maintenance responsibility for the stormwater devices at the site (include this statement in agreement).
- Specific maintenance items particular to more complex structures.

**16. ACCESS:**

**Application Types: ALL**

- Project layout has considered access for maintenance and inspection during and after construction.

**17. DETENTION WAIVER:**

**Application Types: II and III**

- A letter requesting a stormwater waiver must meet one of the following criteria and be signed by a Professional Engineer.
  - A project may be eligible for a waiver of stormwater management for both quantitative and qualitative control if the applicant can demonstrate that the proposed project will return the disturbed area to a pre-development runoff condition and the pre-development land use is unchanged at the conclusion of the project.
  - A project may be eligible for a waiver of stormwater management for water quantity control if the applicant can demonstrate that:
    - The proposed project will have no significant adverse impact on the receiving natural waterway or downstream properties; or
    - The imposition of peak control requirements for rates of stormwater runoff would aggravate downstream flooding.

**III CONSTRUCTION PLANS**

**Application Types: II and III**

- Two complete full size sets of plans and one complete set of drainage calculations for review.

**1. GENERAL ITEMS:**

- All sheets 24" x 36".
- Engineer stamp and signature on every sheet.
- Engineering Firm's Certificate of Authorization seal on Grading plan.
- Correct Scale and North Arrow.
- Existing and proposed contours are to be tied to a NAVD 88 datum, no **assumed** elevations (1' interval is the minimum).
- Lot Layout.
- Property lines, adjacent landowners' names, and land use conditions (locate houses, driveways, etc. onsite/offsite), critical or protected area.
- Legend.
- Existing and proposed contours for entire disturbed area and off-site areas.
- Limits of disturbed area.
- Delineation of waters of the state, including wetlands with letter from US Army Corps of Engineers, if applicable.
- Easements and any offsite easements that will be used.
- Road profiles with existing and proposed ground elevations.



- Construction sequence (include implementation of all stormwater and sediment controls in the first phase of construction).
- Locations of all temporary and permanent control measures.
- Details for all temporary and permanent control measures.
- Grassing and stabilization specifications.
- Construction entrance/exit.
- Location map.
- Individual lot erosion control plan (applicable to subdivisions).
- Revision block utilized.

## 2. STORMWATER/DRAINAGE SHEETS

- 24" x 36" sheet.
- Provide drainage area map for existing and proposed conditions, including pathways, outlining delineated sub basins, sub basin characteristics (watershed identifier, Curve Number, Tc, Area length, Slope), and the areas draining to all BMPs on site. Off-site drainage areas should be included.
- Labeling should be consistent with Technical report.
- Indicate high and low points for the site.
- Catch basin locations should be outside intersection curve radii, uphill of intersection.
- Easements for storm drainage.
- A minimum of 10-foot wide riding surface around entire pond within a minimum 20-foot easement for maintenance, install gravel if needed (e.g. clay soils).
- 20-foot wide minimum access road to pond within a minimum 30-foot right-of-way, dedicated with pond.
- Discharge pipes greater than 24-inch require headwall with wing walls.
- Label all storm drainage structures.
- Water surface elevation in pond/BMPs for all necessary storm events.
- Cut/Fill volumes for the site.
- Utility crossings (water, sewer, storm drainage) to have one foot of cover minimum.
- 15-inch minimum pipe size (no decreases in pipe size in the downstream direction).
- 0.5% minimum pipe slope.
- 20% maximum pipe slope.
- Minimum fall across boxes of 0.1-feet.
- Crown elevation of inlet pipes equal or greater than crown elevation of outlet pipe.
- Pre-cast storm drainage structures with knock out panels can be no greater than 6' in depth. Pre-cast pipe openings preferred. Knockout panel box not used in depths which exceed six feet deep. Deeper boxes shall be hand-built or use approved pre-cast. Steps required for boxes greater than 4 feet deep. Minimum inside box measurements are 3'x3'.
- Label calculated design flows on each pipe.
- Hydraulic grade lines on profiles of storm pipe.
- Existing and proposed grade on profiles of storm pipe.
- Catch basins field staked to ensure proper alignment with the street and gutter.

## 3. DETAILS

- Curb (rolled, barrier, expulsion).
- Typical road cross section(s).
- Silt fence.
- Inlet protection.
- Lot to lot sediment and erosion control.



- Headwalls.
- Rip-rap apron.
- Construction entrance.
- Swale/ditch.
- Typical detail for all BMPs (sediment traps, ponds, water quality devices, etc.).
- Catch basins, manholes, junctions, etc.

**4. STANDARD NOTES:**

- Notes as required by State and Federal agencies and any additional notes for compliance with City of North Charleston requirements.



# **APPENDIX F**

## **INSPECTION CHECKLIST**



### City of North Charleston Construction Site Inspector Checklist

Permit No.: \_\_\_\_\_ Date of Inspection: \_\_\_\_\_

Project Name: \_\_\_\_\_ County: \_\_\_\_\_

Project Description (check one):  Residential  Commercial  Other

**Below are the items that City inspectors will address during each site inspection.**

1. Are contractor's maintenance logs available?  Yes  No
2. Are contractor's set of plans available on-site?  Yes  No
3. What is the current status of construction?  
 Beginning  Middle  Nearing Completion  Complete
4. Have areas been clear cut ( Yes  No), and if so, what is the approximate area of tree cutting? \_\_\_\_\_
5. Are there any waterbody impacts (sediment, oil, grease, etc)?  Yes  No
6. Are there any roadway impacts (sediments, damaged asphalt, etc.)?  Yes  No
7. Have any adjacent properties been negatively impacted?  Yes  No
8. If so, what is the extent of the impacts? \_\_\_\_\_
9. Are there any air/dust impacts?  Yes  No
10. Are all tree protections in place and maintained?  Yes  No
11. Enter any additional comments on tree protection. \_\_\_\_\_
12. Are all channels stabilized?  Yes  No
13. Enter any additional comments on stabilized channels. \_\_\_\_\_
14. Is there any evidence of channel erosion?  Yes  No
15. Enter any additional comments on channel erosion. \_\_\_\_\_
16. Are all inactive areas stabilized?  Yes  No
17. Are all inactive slopes stabilized?  Yes  No
18. Are all inactive stock piles stabilized?  Yes  No



19. Enter any additional comments on stabilization needs. \_\_\_\_\_  
\_\_\_\_\_

20. Are all erosion prevention and sediment control (EPSC) devices properly installed and maintained?  Yes  No

Construction Entrance  Yes  No

Silt Fence  Yes  No

21. Do the EPSC devices provide adequate protection?  Yes  No

22. Are there any unneeded controls or are there any that need to be removed (closeout)?  
 Yes  No

23. Enter any additional comments on EPSC devices. \_\_\_\_\_

24. Are there any instances of erosion across the site?  Yes  No

25. If so, what is the percentage? \_\_\_\_\_

26. Enter the reinspection date based on condition of the site and offsite impact. \_\_\_\_\_

27. Enter any additional comments as necessary. \_\_\_\_\_  
\_\_\_\_\_

28. Is any enforcement action necessary?  Yes  No

\_\_\_\_\_  
Printed Name of Inspector

\_\_\_\_\_  
Signature of Inspector

\_\_\_\_\_  
Date



# **APPENDIX G**

## **ENFORCEMENT FORMS**



City of North Charleston  
Public Works Department

## CORRECTION ORDER

Date: \_\_\_\_\_

Name: \_\_\_\_\_

Address: \_\_\_\_\_

City, State Zip code: \_\_\_\_\_

Project: \_\_\_\_\_

Permit No. \_\_\_\_\_

This correction order serves as a warning concerning activities on the above referenced site.

This warning is based on the results of a City of North Charleston inspection on \_\_\_\_\_. A verbal warning was also given to \_\_\_\_\_ at the time of the inspection. A copy of our inspection report detailing the deficiencies is enclosed with this warning.

You have until \_\_\_\_\_ to correct the deficiencies noted on the inspection report. At that time our inspector will re-visit your site. Failure to comply with this warning is considered a violation of the City of North Charleston Stormwater Management Ordinance and will result in the issuance of a **Notice of Violation and/or Stop Work Order**.

If you have any questions concerning this warning you may contact our office at 843-745-1026 (Engineering Division).

Signed by: \_\_\_\_\_

Printed Name: \_\_\_\_\_

September 1, 2008



City of North Charleston  
Public Works Department

## NOTICE OF VIOLATION

Date: \_\_\_\_\_

Name: \_\_\_\_\_

Address: \_\_\_\_\_

City, State Zip code: \_\_\_\_\_

Project: \_\_\_\_\_

Permit No. \_\_\_\_\_

You are hereby served notice that you are in violation of the City of North Charleston's Stormwater Management Ordinance at the above referenced site.

This violation is due to failure to comply with a corrective order issued on \_\_\_\_\_ and the results of a City of North Charleston follow up inspection completed on \_\_\_\_\_. A copy of our inspection report is enclosed with this Notice of Violation.

These deficiencies noted on the inspection report must be corrected within three **(3) working days** of the date of this Notice. Failure to comply with this Notice of Violation will result in an immediate **Stop Work Order** issued for your site and can result in a **civil penalty in the amount of \$1,000/day for each violation.**

If you have questions concerning this violation you can contact our office at 843-745-1026 (Engineering Division).

Signed by: \_\_\_\_\_

Printed Name: \_\_\_\_\_

September 1, 2008



City of North Charleston  
Public Works Department

## NOTICE OF VIOLATION-STOP WORK ORDER

Date: \_\_\_\_\_

Name: \_\_\_\_\_

Address: \_\_\_\_\_

City, State Zip code: \_\_\_\_\_

Project: \_\_\_\_\_

Permit No. \_\_\_\_\_

You are hereby served notice that you are in violation of the City of North Charleston's Stormwater Management Ordinance at the above referenced site. A "**STOP WORK**" order is being posted on this property effective **IMMEDIATELY**.

This violation is due to failure to comply with a Notice of Violation issued on \_\_\_\_\_ and the results of a City of North Charleston follow up inspection completed on \_\_\_\_\_. A copy of our inspection report is enclosed with this violation.

Your site must be inspected by a City of North Charleston Inspector prior to resuming any construction activity. Any activity other than work leading to compliance with this Stop Work Order can result in the issuance of a civil penalty in the amount of **\$1,000/day for each deficiency and/or 30 days in jail**.

If you have questions concerning this violation you can contact our office at 843-745-1026 (Engineering Division).

Signed by: \_\_\_\_\_

Printed Name: \_\_\_\_\_



# **APPENDIX H**

## **TRANSFER OF OWNERSHIP APPLICATION**



## TRANSFER OF OWNERSHIP APPLICATION

- A. Project Name: \_\_\_\_\_
- B. Permit Number: \_\_\_\_\_
- C. NPDES Permit Coverage Number (if applicable): SCR10 \_\_\_\_\_
- D. New Owner Name: \_\_\_\_\_  
 Address: \_\_\_\_\_  
 City: \_\_\_\_\_, State: \_\_\_\_\_  
 Zip: \_\_\_\_\_  
 Phone: \_\_\_-\_\_\_-\_\_\_-\_\_\_ Mobile: \_\_\_-\_\_\_-\_\_\_-\_\_\_ Fax: \_\_\_-\_\_\_-\_\_\_-\_\_\_  
 Email Address (optional): \_\_\_\_\_
- E. Property Info:  Check Box if same as above  
 Address: \_\_\_\_\_  
 City: \_\_\_\_\_, South Carolina  
 Zip: \_\_\_\_\_  
 Tax Map Number(s): \_\_\_\_\_
- F. Original Owner Name: \_\_\_\_\_  
 Address: \_\_\_\_\_  
 City: \_\_\_\_\_, State: \_\_\_\_\_  
 Zip: \_\_\_\_\_  
 Phone: \_\_\_-\_\_\_-\_\_\_-\_\_\_ Mobile: \_\_\_-\_\_\_-\_\_\_-\_\_\_ Fax: \_\_\_-\_\_\_-\_\_\_-\_\_\_  
 Email Address (optional): \_\_\_\_\_
- G. Transfer Information: Transfer Date (MM/DD/YYYY): \_\_\_/\_\_\_/\_\_\_\_\_  
 a. Is the entire permit being transferred to a new Permit Holder?  Yes  No  
 b. Is this a subdivision where only a lot or a group of lots are being transferred?  Yes  No  
 c. If Yes to Item G.b., list the lot, or group of lots being transferred.  
 \_\_\_\_\_
- H. Other Information:  
 a. If there are no modifications being made to the plans, include five (5) sets of plans with signed Designer and Owner's certification statements.  
 b. If this is a subdivision where a lot or group of lots are being transferred, include a plat sheet with the lot or group of lots that are being transferred clearly outlined.

**Original Owner's Certification**

I hereby relinquish the responsibility and ownership of the City of North Charleston Permit listed in Item B above. I realize that the construction activity responsibility for the identified project/lots/group of lots now belongs to the new applicant.

\_\_\_\_\_  
Original Owner's Printed Name

\_\_\_\_\_  
Original Owner's Signature

\_\_\_\_\_  
Date

**New Owner's Certification**

I hereby certify that all construction and/or development will be done pursuant to this plan and I am responsible for the construction activities and related maintenance thereof. City of North Charleston authorities will be allowed to enter the project site for the purpose of on-site inspections.

\_\_\_\_\_  
New Owner's Printed Name


\_\_\_\_\_  
New Owner's Signature

\_\_\_\_\_  
Date



# **APPENDIX I**

## **BMP DETAILS**

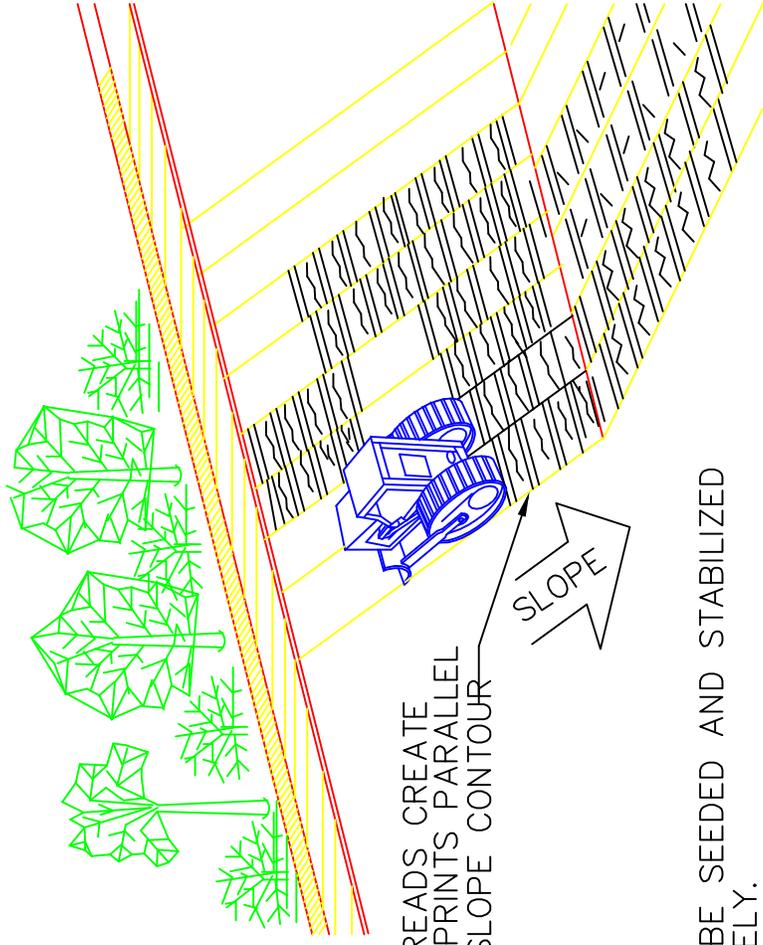

DOZER TRENDS CREATE  
CLEAT IMPRINTS PARALLEL  
TO THE SLOPE CONTOUR



SHOULD BE SEEDED AND STABILIZED  
IMMEDIATELY.

# TRACKING

DEBRIS FROM SLOPE ABOVE IS CAUGHT BY STEPS

DRAINAGE



WATER, SOIL, AND FERTILIZER ARE HELD BY STEPS — VEGETATION ESTABLISHES MORE EASILY ON THE STEPS.

SHOULD BE SEEDED AND STABILIZED IMMEDIATELY.


South Carolina Department of Health and Environmental Control

STAIR STEP GRADING

STANDARD DRAWING NO. EC-02 Page 1

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ DATE AUGUST, 2005

## STAIR STEP GRADING

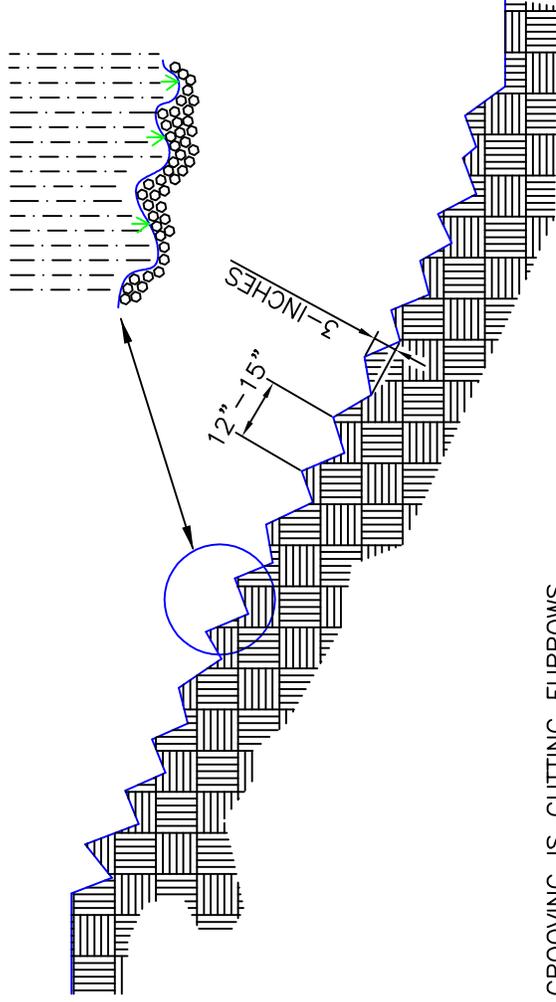

GROOVING IS CUTTING FURROWS ALONG THE CONTOUR OF A SLOPE. IRREGULARITIES IN THE SOIL SURFACE CATCH RAINWATER AND PROVIDE SOME COVERAGE OF LIME, FERTILIZER AND SEED.

SHOULD BE SEEDED AND STABILIZED IMMEDIATELY.

South Carolina Department of Health and Environmental Control

SLOPE GROOVING

STANDARD DRAWING NO. EC-03 Page 1

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ DATE: AUGUST, 2005

**SLOPE GROOVING**

**MAPPING SYMBOLS FOR EROSION  
AND SEDIMENT CONTROL PLANS**


EFFECTIVE DATE: AUGUST, 2005

DESCRIPTION

SYMBOL

EROSION PREVENTION


LAND GRADING:




SURFACE ROUGHENING:




TOPSOILING:




TEMPORARY SEEDING:



MULCHING:



ECB OR TRM



DESCRIPTION

SYMBOL

EROSION PREVENTION

FGM



BFM



PERMANENT SEEDING:




SODDING:




RIPRAP:



OUTLET PROTECTION




RipRap



ECB or TRM

DUST CONTROL:



POLYACRYLAMIDE (PAM)




<u>DESCRIPTION</u>	<u>SYMBOL</u>
SEDIMENT CONTROL	
SEDIMENT BASIN:	
TEMPORARY SEDIMENT TRAP:	
ROCK SEDIMENT DIKE:	
ROCK CHECK DAM:	
SEDIMENT TUBE:	
SILT FENCE:	
REINFORCED SILT FENCE:	
TYPE A – FABRIC INLET PROTECTION:	
TYPE A – SEDIMENT TUBE INLET PROTECTION:	


DESCRIPTION

SYMBOL


TYPE B -- WIRE MESH AND STONE DROP INLET PROTECTION:




TYPE C -- BLOCK AND GRAVEL INLET PROTECTION:




TYPE D -- RIGID INLET FILTERS



TYPE E -- SURFACE COURSE CURB INLET FILTER



TYPE F -- INLET TUBE



ROCK SEDIMENT DIKE:



RUNOFF CONVEYANCE MEASURES:

VEGETATED CHANNELS:



RIPRAP-LINED CHANNELS:



ECB OR TRM-LINED CHANNELS:



PAVED CHANNELS:



PIPE SLOPE DRAINS:




DESCRIPTION

SYMBOL

RUNOFF CONVEYANCE MEASURES:

TEMPORARY STREAM CROSSING:



TEMPORARY DIVERSION DITCH OR SWALE




PERMANENT DIVERSION DITCH:




DIVERSION DIKE OR BERM






LEVEL SPREADER:



SUBSURFACE DRAIN:



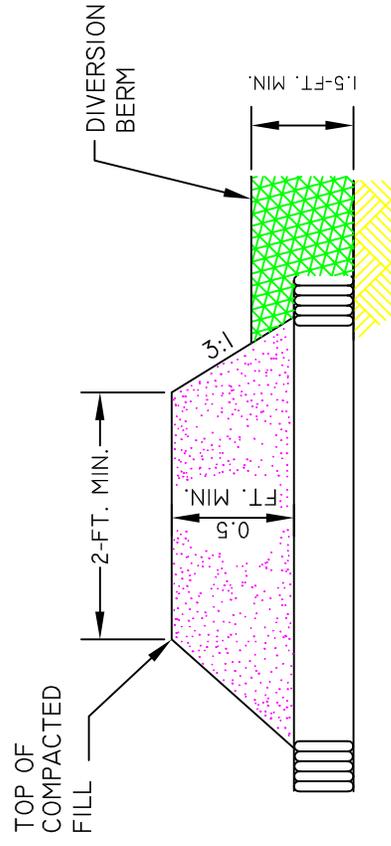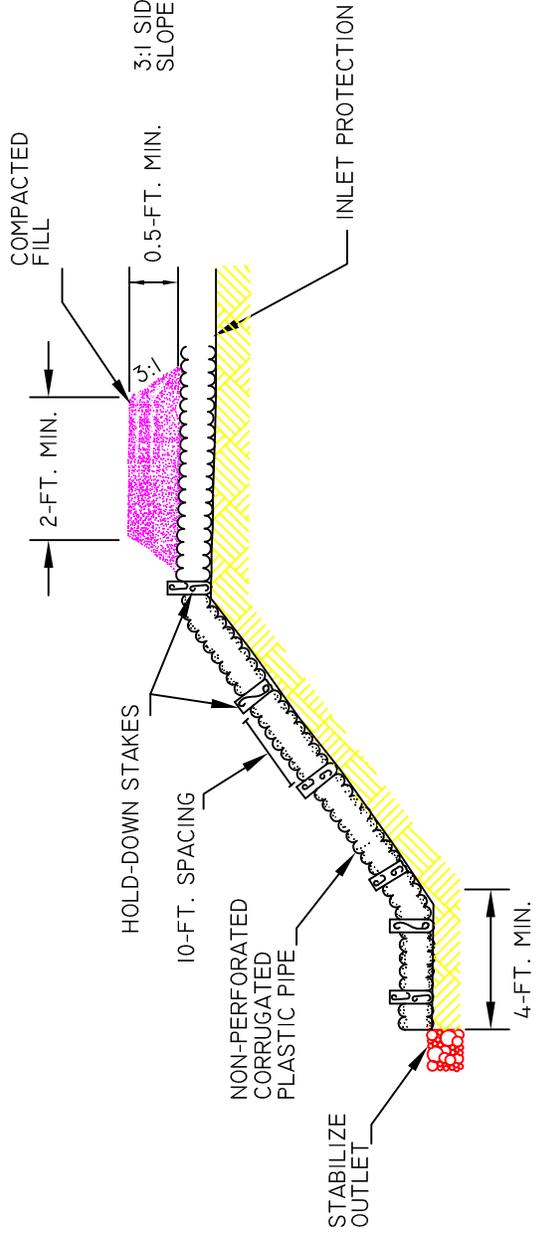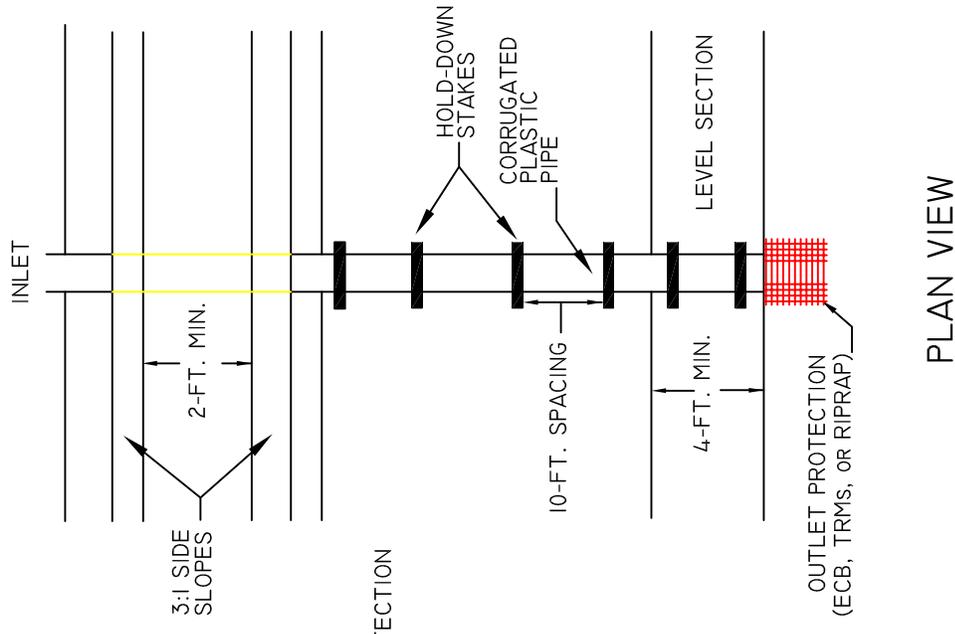

South Carolina Department of  
Health and Environmental Control

PIPE SLOPE DRAIN

STANDARD DRAWING NO. RC-01 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

TYPICAL PIPE SLOPE DRAIN LAYOUT

## PIPE SLOPE DRAIN

### When and Where to Use It

Pipe slope drains are used when it is necessary for water to flow down a slope without causing erosion, especially before a slope has been stabilized or before permanent drainage structures are installed.

### Installation:

Typical pipe slope drains are made of non-perforated corrugated plastic pipe.

Slope drain sections should be securely fastened together, have gasket watertight fittings, and be securely anchored into the soil.

Diversion berms or dikes should direct runoff to slope drains. The minimum depth of these dikes or berms should be 1.5-feet. The height of the berm around the pipe inlet should be a minimum of 1.5-feet high and at least 0.5-feet higher than the top of the pipe. The berm at the pipe inlet shall be compacted around the pipe. The area around the inlet shall be properly stabilized with ECBs, TRMs, riprap or other applicable stabilization techniques.

The area below the outlet must be properly stabilized with ECBs, TRMs, riprap or other applicable stabilization technique.

If the pipe slope drain is conveying sediment-laden water, direct all flows into the sediment trapping facility.

Permanent slope drains should be buried beneath the soil surface a minimum 1.5-feet.

### Inspection and Maintenance:

Inspect pipe slope drain inlet and outlet points every seven (7) calendar days and within 24-hours after each rainfall event that produces ½-inches or more of precipitation.

The inlet should be free from undercutting, and no water should be going around the point of entry. If there are problems, the headwall should be reinforced with compacted earth or sandbags. The outlet point should be free of erosion and installed with appropriate outlet protection.

All temporary pipe slope drains should be removed within 30 days after final site stabilization is achieved or after the temporary BMP is no longer needed. Disturbed soil areas resulting from removal should be permanently stabilized.

South Carolina Department of  
Health and Environmental Control

PIPE SLOPE DRAIN

STANDARD DRAWING NO. RC-01 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

DIKE MATERIAL COMPACTED  
90% STANDARD PROCTOR

2-FT. MIN.

2:1 OR  
FLATTER

1.5-FOOT MIN.

8-FT. MIN.

DIKE SPACING = 100-FT., 200-FT., OR 300-FT. DEPENDING ON GRADE

South Carolina Department of  
Health and Environmental Control

DIVERSION DIKE OR BERM

STANDARD DRAWING NO. RC-02 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
SCDHEC

AUGUST, 2005

## DIVERSION DIKES AND BERMS

### Installation

Slopes shall be stabilized immediately using vegetation, sod, and erosion control blankets or turf reinforcement mats to prevent erosion.

The upslope side of the dike should provide positive drainage so no erosion occurs at the outlet. Provide energy dissipation measures as necessary. Sediment-laden runoff must be released through a sediment trapping facility.

Sediment-laden runoff shall be directed to a sediment trapping facility.

Minimize construction traffic over diversion dikes and berms.

### Inspection and Maintenance:

Dikes and Berms should be inspected, every seven (7) calendar days and within 24-hours after each rainfall event that produces  $\frac{1}{2}$ -inches or more of precipitation and repairs made as necessary.


Damage caused by construction traffic or other activity must be repaired before the end of each working day.

South Carolina Department of  
Health and Environmental Control

DIVERSION DIKE OR BERM

STANDARD DRAWING NO. RC-02 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

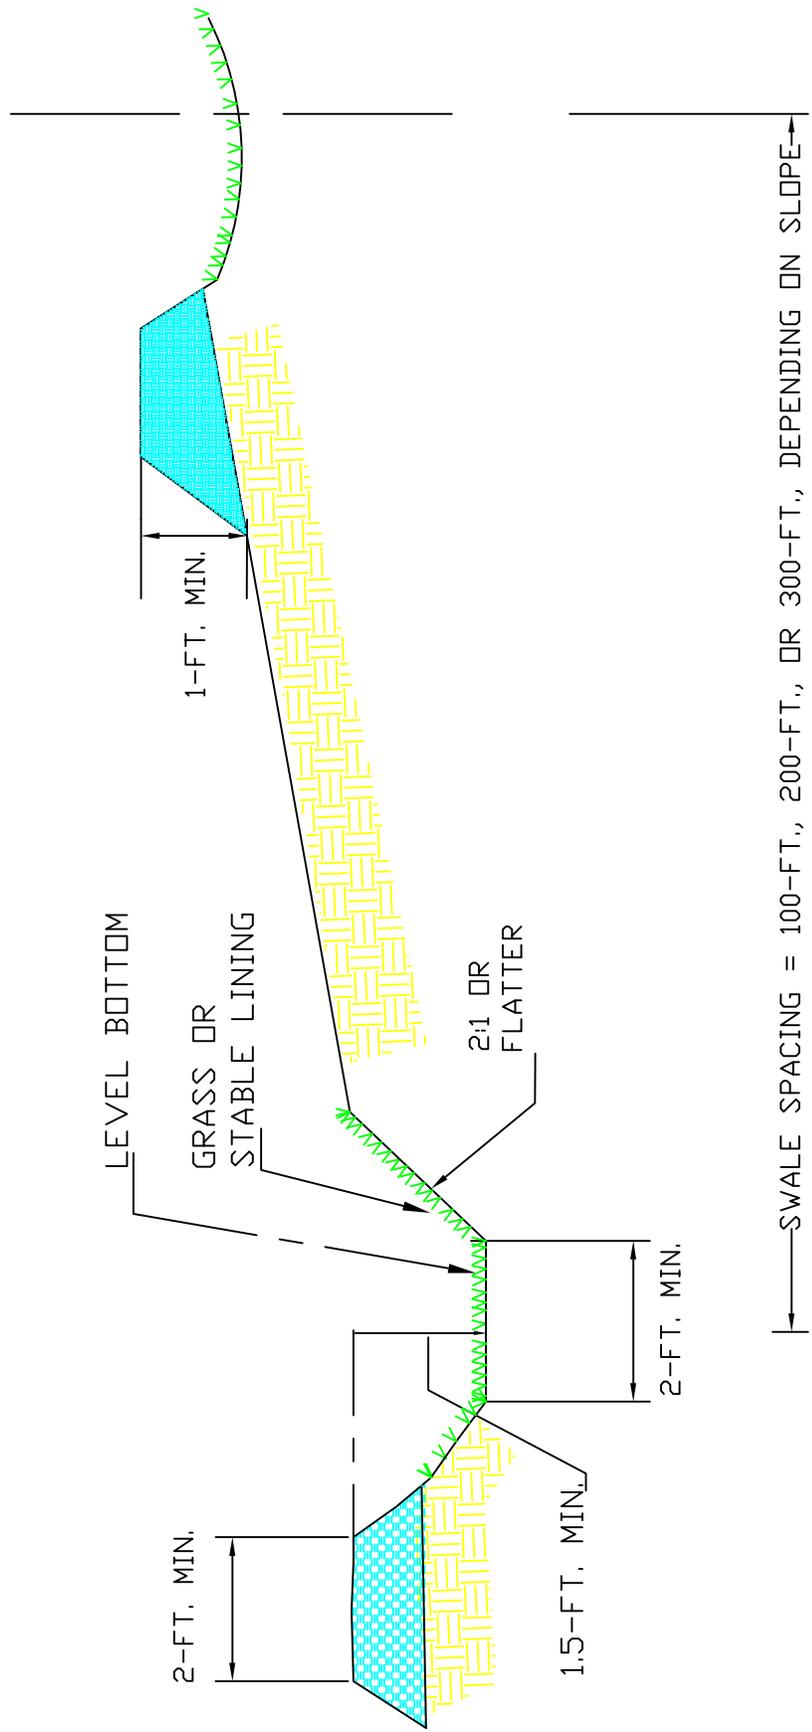

## DIVERSION SWALE

### Installation

The bottom width should be a minimum of 2–feet, and the bottom should be level.

The depth should be a minimum of 1.5–feet and the side slopes should be 2H:1V or flatter.

The maximum grade shall be 5%, with positive drainage to a suitable outlet.

Slopes shall be stabilized immediately using vegetation, sod, and erosion control blankets or turf reinforcement mats to prevent erosion.

The upslope side of the swale should provide positive drainage so no erosion occurs at the outlet. Provide energy dissipation measures as necessary.

Sediment–laden runoff shall be directed to a sediment trapping facility.

### Inspection and Maintenance:

Swales should be inspected, every seven (7) calendar days and within 24–hours after each rainfall event that produces  $\frac{1}{2}$ –inches or more of precipitation and repairs made as necessary.


Damage caused by construction traffic or other activity must be repaired before the end of each working day.

South Carolina Department of  
Health and Environmental Control

DIVERSION SWALE

STANDARD DRAWING NO. RC-03 Page 2 of 2


APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

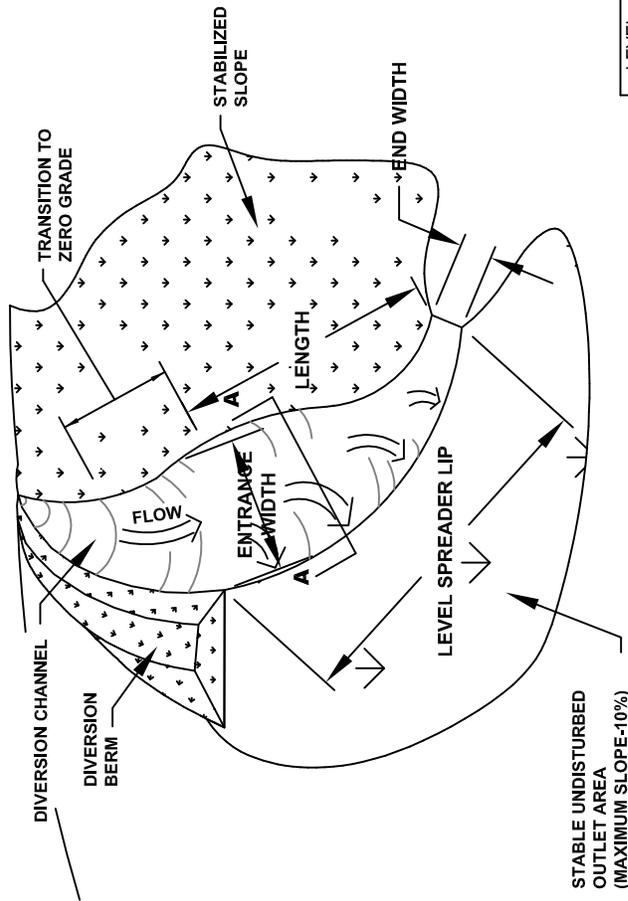

**LEVEL SPREADER**

LEVEL SPREADER	Q (cfs)	ENTRANCE WIDTH (ft)	LENGTH (ft)	END WIDTH (ft)	SPREADER LIP LENGTH (ft)	DEPTH (ft)
15'						

**PERSPECTIVE VIEW**

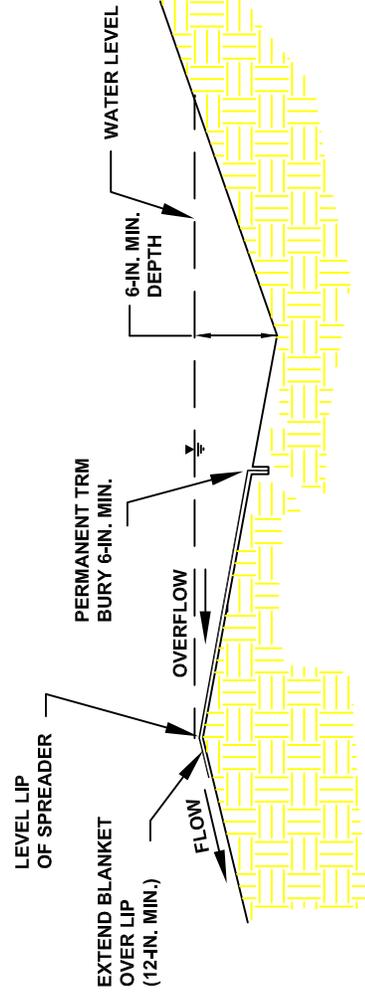

**SECTION A-A**

South Carolina Department of Health and Environmental Control

**LEVEL SPREADER**

STANDARD DRAWING NO. RC-04 Page 1 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ DATE: AUGUST, 2005

## Level Spreader

### Description

A level spreader is a permanent outlet for dikes and diversions consisting of an excavated channel constructed at zero grade across a slope that converts concentrated runoff to sheet flow and releases it onto areas stabilized by existing vegetation. Sediment-laden waters should not be directed towards level spreaders.

### When and Where to Use It:

Level spreaders should be constructed on undisturbed areas that are stabilized by existing vegetation and where concentrated flows are anticipated to occur. Diversion channels call for a stable outlet for concentrated storm water flows. The level spreader can be used for this purpose if the runoff is relatively free of sediment. If properly constructed, the level spreader will significantly reduce the velocity of concentrated storm water and spread it uniformly over a stable undisturbed area.

### Design Criteria:

The lip of the level spreader should consist of a permanent Turf Reinforcement Mat (TRM) able to withstand 5-lbs/ft shear stress. The TRM should extend 10-feet below the lip and be buried at least 6-inches within the spreader, and extend at least 12-inches beyond the lip on the outside of the spreader.

### Installation:

Care must be taken during construction to ensure the lower lip of the structure is level.

If there are any depressions in the lip, flow will tend to concentrate at these points and erosion will occur, resulting in failure of the outlet. This problem may be avoided by using a grade board, a gravel lip or a TRM along the exit lip of the level spreader.

If a TRM is used, it should extend 10-feet below the lip and be buried at least 6-inches within the spreader, and extend at least 12-inches beyond the lip on the outside of the spreader.

The grade of the channel transition for the last 20-feet before entering the level spreader should be less than or equal to 1 percent.

The crest of the overflow should be level (0 percent grade) to ensure uniform spreading of runoff.

### Inspection and Maintenance:

The spreader should be inspected every seven days and within 24-hours after each rainfall event that produces ½-inches or more of precipitation to ensure that it is functioning correctly.

The contractor should avoid the placement of any material on the structure or prevent construction traffic across the structure.


If the spreader is damaged by construction traffic, it should be immediately repaired.

South Carolina Department of  
Health and Environmental Control


LEVEL SPREADER

STANDARD DRAWING NO. RC-04 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

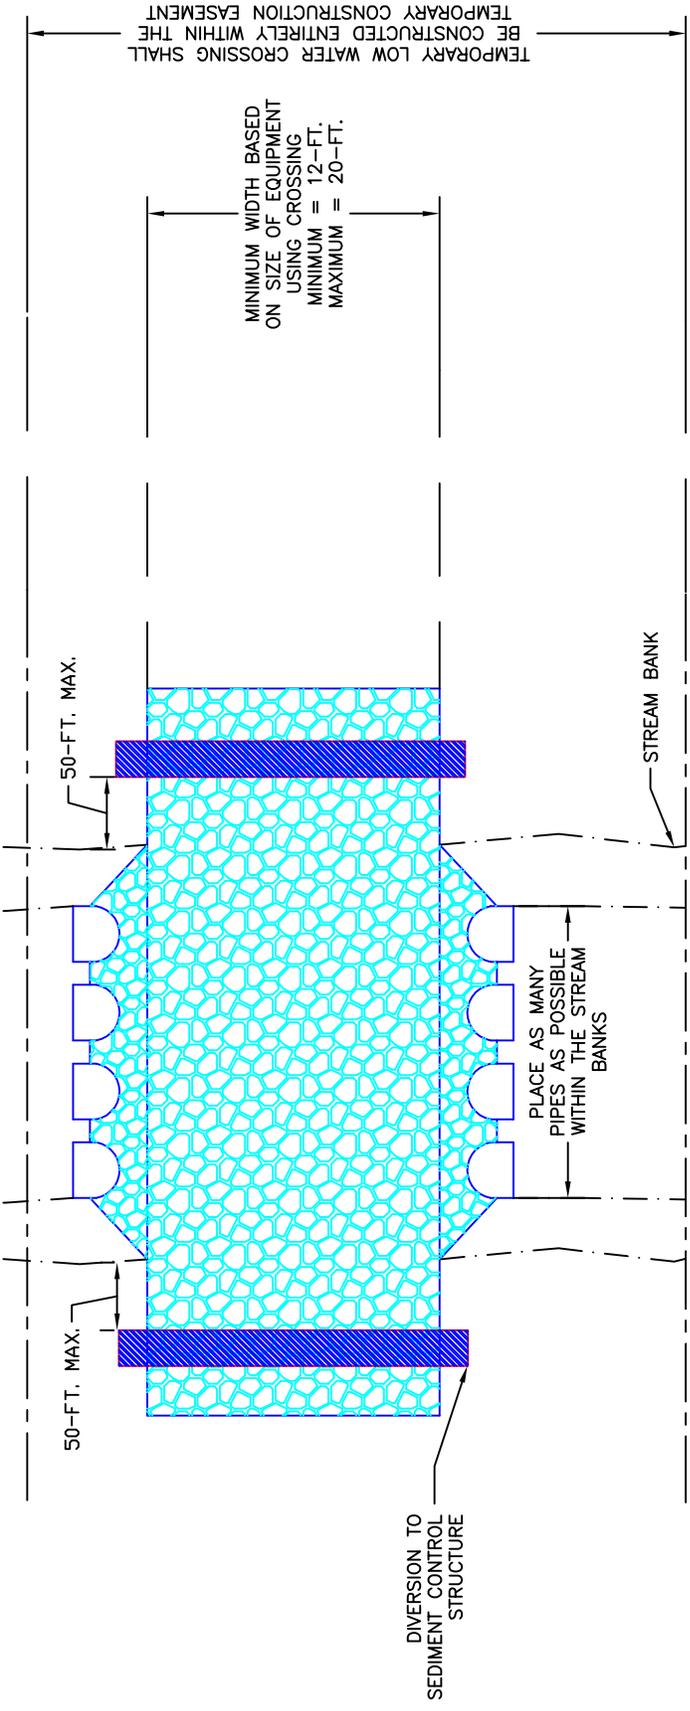

PLAN VIEW

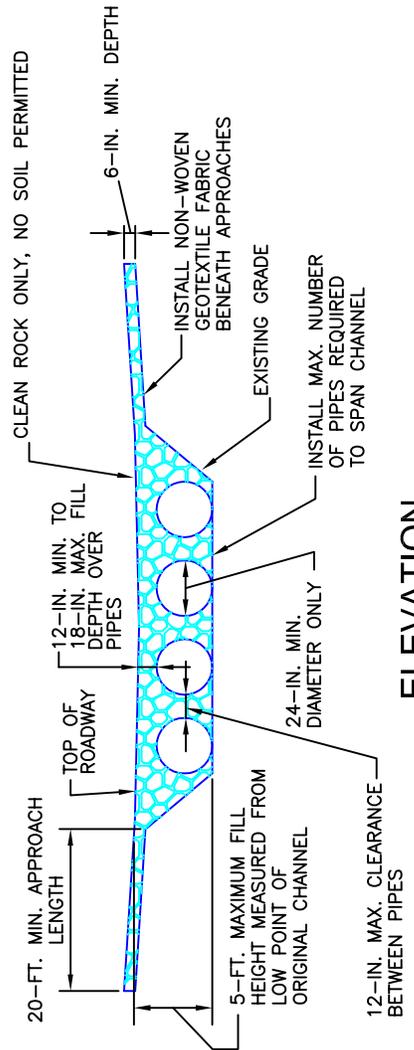

ELEVATION

**South Carolina Department of Health and Environmental Control**

TEMPORARY STREAM  
LOW WATER CROSSING

STANDARD DRAWING NO. **RC-05** Page 1 of 3

APPROVED BY: \_\_\_\_\_ DATE: **AUGUST, 2005**

SCDHEC

## TEMPORARY STREAM LOW WATER CROSSING

Prior to constructing a temporary stream crossing, the owner/person financially responsible for the project must submit an Application for Permit to Construct Across or Along a Stream to the South Carolina Department of Health and Environmental Control (SC DHEC). Temporary stream crossings require authorization. Refer to the US Army Corps of Engineers and SCDHEC nationwide 401 and 404 regulations for information on permitting requirements.

### Installation:

Crossings shall be installed prior to any other activities.

Pump-around diversions shall be installed and maintained prior to any excavation and during the installation of the crossing.

Crossings shall be placed in temporary construction easements only.

The temporary roadway crossing shall be at right angles to the stream. Where approach conditions dictate, the crossing may vary 15 degrees from a line drawn perpendicular to the centerline of the stream at the intended crossing location. However every effort shall be taken to install the crossing perpendicular to the stream. All fill materials associated with the roadway approach shall be limited to a maximum height of 2-feet above the existing flood plain elevation.

A water diverting structure such as a dike or swale shall be constructed (across the roadway on both roadway approaches) 50-feet (maximum) on either side of the roadway crossing. This will prevent roadway surface runoff from directly entering the roadway. The 50-feet is measured from the top of the roadway bank. The flow captured in these dikes and swales shall be directed to a sediment trapping structure. If the roadway approach is constructed with a reverse grade away from the roadway, a separate diverting structure is not required.

Streambank clearing shall be kept to a minimum. Do not excavate rock bottom streambeds to install the crossing. Lay the culvert pipes on the streambed "as is" when applicable. Place as many pipes as possible within the low area of the stream. Place remaining pipes required to cross the stream on the existing stream bottom.

The maximum number of pipes as possible should be placed within the stream banks with a maximum spacing of 12-inches between pipes. The minimum sized pipe culvert that may be used is 24-inches.

The length of the culvert shall be adequate to extend the full width of the crossing, including side slopes. The slope of the culvert shall be at least 0.25 feet per foot.

Coarse aggregate of clean limestone riprap with a 6-inch D50 stone or greater will be used to form the crossing. The depth of stone cover over the culvert shall be equal to  $\frac{1}{2}$  the diameter of the culvert or 12-inches, whichever is greater but no greater than 18-inches.

**South Carolina Department of  
Health and Environmental Control**

TEMPORARY STREAM  
LOW WATER CROSSING

STANDARD DRAWING NO. RC-05 Page 2 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

## TEMPORARY STREAM LOW WATER CROSSING

### Installation:

All fill materials associated with the roadway approach shall be limited to a maximum height of 2-feet above the existing flood plain elevation.

The approaches to the structure shall consist of clean stone or concrete fill only with a minimum thickness of 6-inches. The minimum approach length shall be 20-feet and the width shall be equal to the width of the structure.

### Inspection and Maintenance:

Inspect crossings every seven (7) calendar days and within 24-hours after each rainfall event that produces  $\frac{1}{2}$ -inches or more of precipitation. Check the structure integrity and for excessive sediment deposition and replace fill stone as needed.

Clean mud and/or sediment from the roadway and do not allow it to enter the stream.

The structure shall be removed when it is no longer required to provide access to the construction area. During removal, leave stone and geotextile fabric for approaches in place. Place fill over the approaches as part of the stream bank restoration operation.

A temporary culvert crossing should be in place no longer than 24-months.





South Carolina Department of  
Health and Environmental Control

TEMPORARY STREAM  
LOW WATER CROSSING

STANDARD DRAWING NO. RC-05 Page 3 of 3

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ AUGUST, 2005  
DATE

**SUBSURFACE DRAIN LAYOUT**

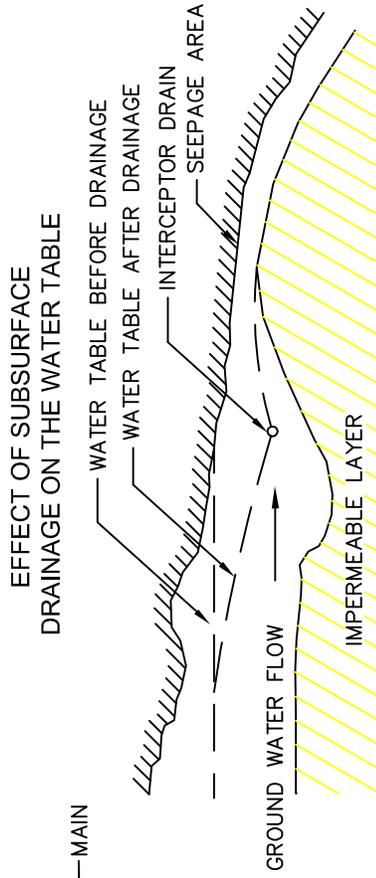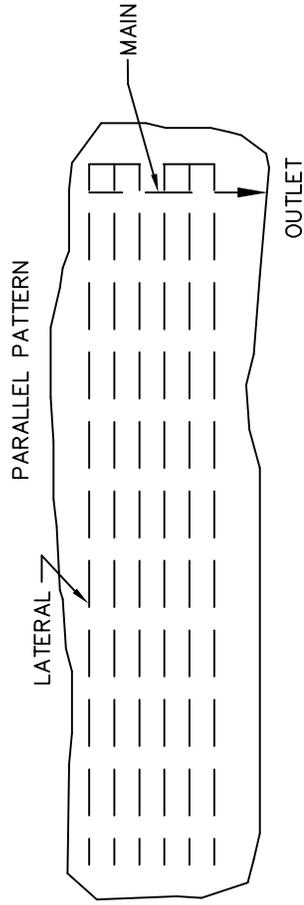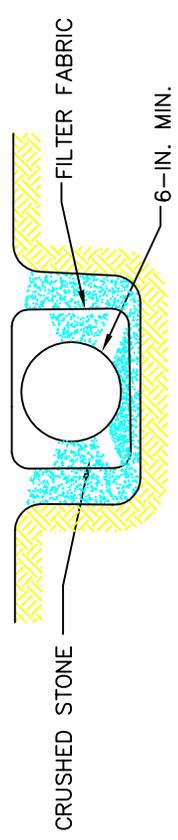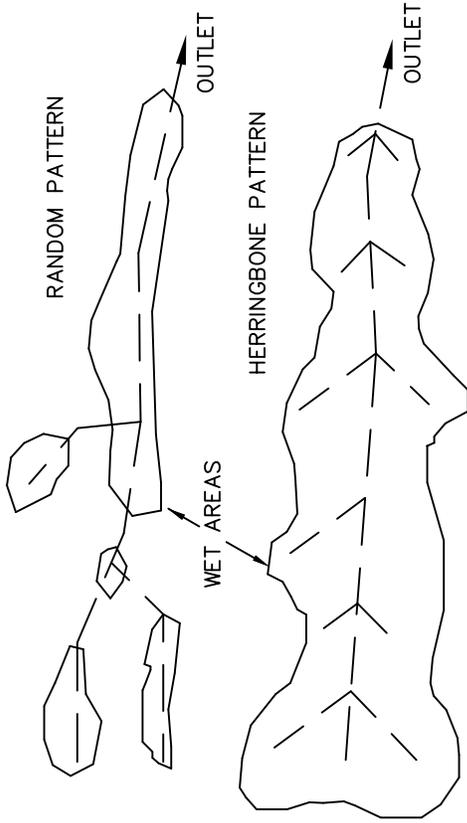


South Carolina Department of Health and Environmental Control


**SUBSURFACE DRAIN LAYOUT**

STANDARD DRAWING NO. **RC-06** Page **1**

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ DATE **AUGUST, 2005**

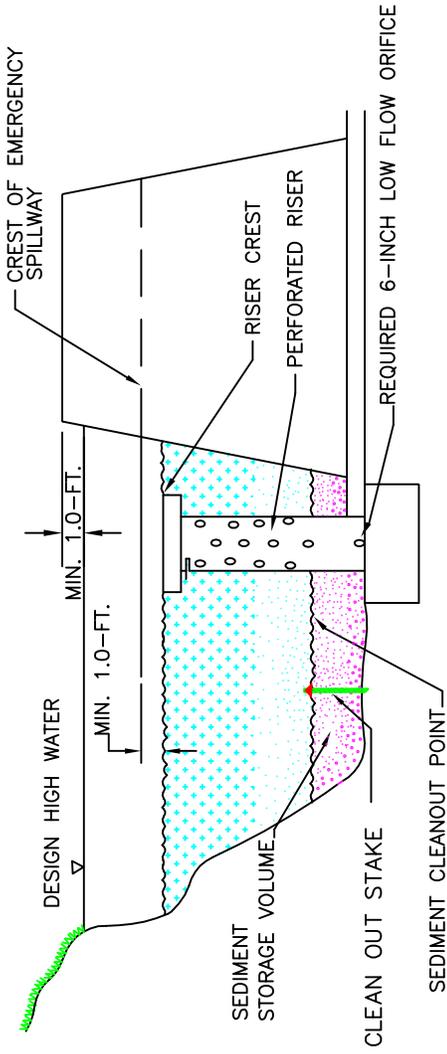

### DESIGN ELEVATIONS WITH REQUIRED EMERGENCY SPILLWAY

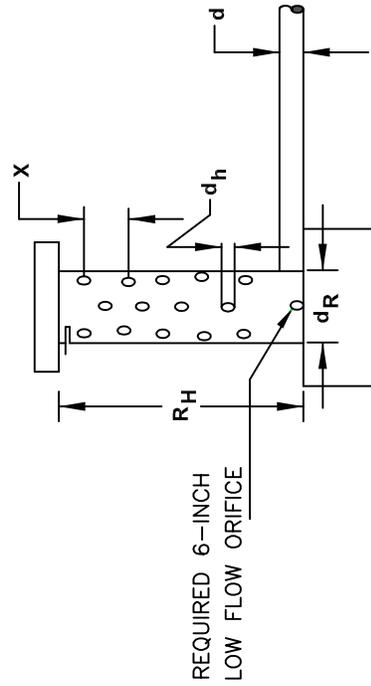

$R_H$  = RISER HEIGHT


$d_R$  = RISER DIAMETER

$d_h$  = ORIFICE DIAMETER

$x$  = ORIFICE SPACING

$d$  = OUTLET PIPE DIAMETER

### RISER PIPE DETAIL

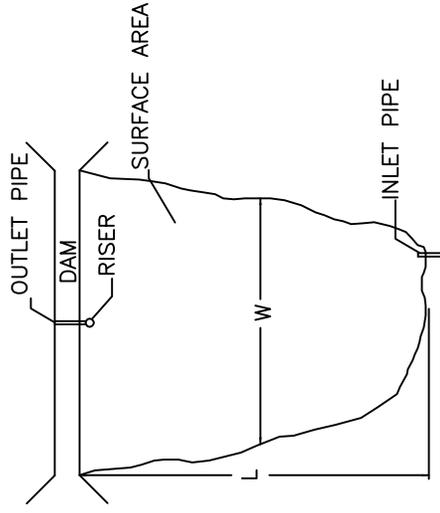

$L = (2 * W)$  MIN.

### PLAN VIEW

South Carolina Department of Health and Environmental Control

SEDIMENT BASIN

STANDARD DRAWING NO. SC-01 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

## SEDIMENT BASIN

### When and Where to Use It

Sediment Basins should not be placed in waters of the state or USGS blue-line streams (unless approved by SCDHEC or Federal authorities).

### Inspection and Maintenance:

The key to a functional sediment basin is continual monitoring, regular maintenance and regular sediment removal.

Attention to sediment accumulations within the pond is extremely important. Sediment deposition should be continually monitored in the basin. Owners and maintenance authorities should be aware that significant concentrations of heavy metals (e.g., lead, zinc, and cadmium) as well as some organics such as pesticides, may be expected to accumulate at the bottom of these treatment facilities.

Remove sediment when it reaches 50% of storage volume or top of the cleanout stake.

Since decomposing vegetation can release pollutants, especially nutrients, captured in the wetpond, it may be necessary to harvest dead vegetation annually. Otherwise the decaying vegetation can export pollutants out of the pond and can cause nuisance conditions to occur.

Regular inspections should be done every seven (7) calendar days and within 24-hours after each rainfall event that produces  $\frac{1}{2}$ -inches or more of precipitation.

All temporary sediment basins should be removed within 30 days after final site stabilization is achieved or after it is no longer needed.

Trapped sediment should be removed from, or stabilized on site.


Disturbed areas resulting from the removal of the sediment basin should be permanently stabilized.

South Carolina Department of  
Health and Environmental Control


SEDIMENT BASIN

STANDARD DRAWING NO. SC-01 Page 2 of 2


APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

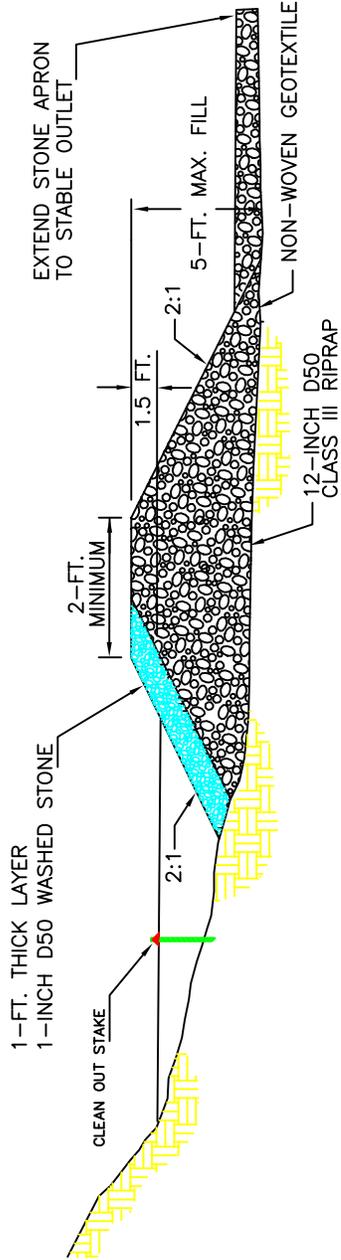

STONE SECTION

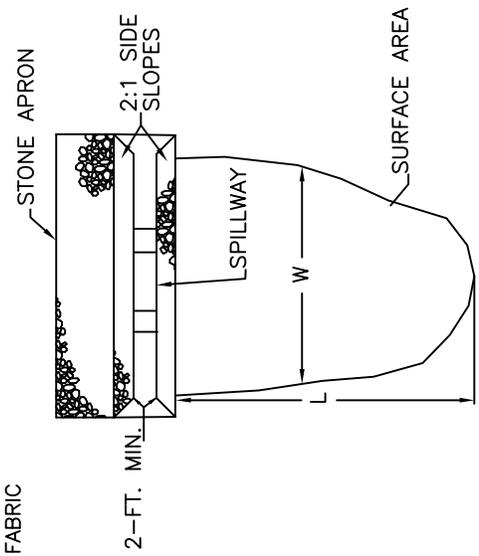

PLAN VIEW

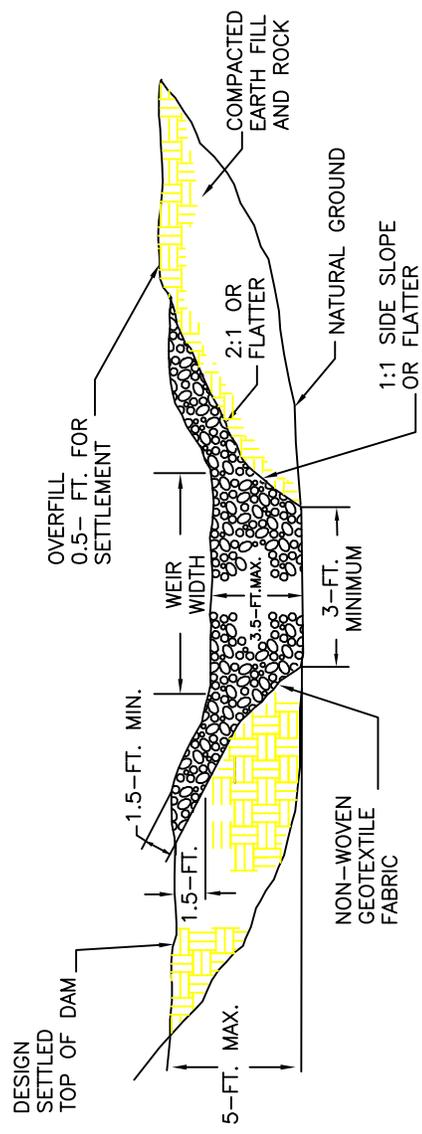

EMBANKMENT AND SPILLWAY ELEVATION

South Carolina Department of Health and Environmental Control

SEDIMENT TRAP

STANDARD DRAWING NO. SC-02 Page 1 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
 SCDHEC \_\_\_\_\_

## SEDIMENT TRAP

### When and Where to Use It

Sediment traps should not be placed in waters of the state or USGS blue-line streams (unless approved by SCDHEC or Federal authorities).

### Installation:

#### Rock Outlet Structure Requirements:

The maximum sediment trap height shall be 5-feet.  
The maximum stone height of the outlet weir shall be 3.5-feet.  
The minimum bottom flow width of the structure shall be 3-feet.  
The minimum top flow length of the structure shall be 2-feet.

The main body of the outlet structure shall consist of 12-inch D50 class III riprap. The upstream face of the outlet structure shall consist of a 1-foot thick layer of 1-inch D50 washed stone. The maximum sideslope of the rock structure shall be 2:1.

Install a non-woven geotextile filter fabric before installing the stone for the outlet structure. Allow the stone to extend downstream past the toe of the embankment.

All inside sediment trap slopes should be 3:1 or flatter.

Mark the sediment cleanout level of trap with a stake in the field. Seed and mulch all disturbed areas.

### Inspection and Maintenance:

The key to a functional sediment trap is continual monitoring, regular maintenance and regular sediment removal.

Remove sediment when it reaches 50% of storage volume or reaches the top of cleanout stake.

Regular inspections should be done every seven (7) calendar days and within 24-hours after each rainfall event that produces  $\frac{1}{2}$ -inches or more of precipitation.

All temporary sediment traps should be removed within 30 days after final site stabilization is achieved or after it is no longer needed.

Trapped sediment should be removed from, or stabilized on site.

Disturbed areas resulting from the removal of the sediment trap should be permanently stabilized.

South Carolina Department of  
Health and Environmental Control

SEDIMENT TRAP

STANDARD DRAWING NO. SC-02 Page 2 of 3

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ AUGUST, 2005  
DATE

### SEDIMENT TRAP DIMENSIONS

SEDIMENT TRAP	BOTTOM LENGTH (ft)	BOTTOM WIDTH (ft)	TOP LENGTH (ft)	TOP WIDTH (ft)	INSIDE SIDE SLOPES (X:H:1V)	DEPTH (ft)

### SEDIMENT TRAP ROCK OUTLET


ROCK OUTLET	HEIGHT (ft)	BOTTOM WIDTH (ft)	INSIDE SIDE SLOPES (X:H:1V)	TOP WEIR WIDTH (ft)	BOTTOM RIPRAP FLOW LENGTH (ft)	TOP RIPRAP FLOW LENGTH (ft)

South Carolina Department of  
Health and Environmental Control


SEDIMENT TRAP

STANDARD DRAWING NO. SC-02 Page 3 of 3

APPROVED BY: \_\_\_\_\_ SCDHEC      AUGUST, 2005 \_\_\_\_\_ DATE

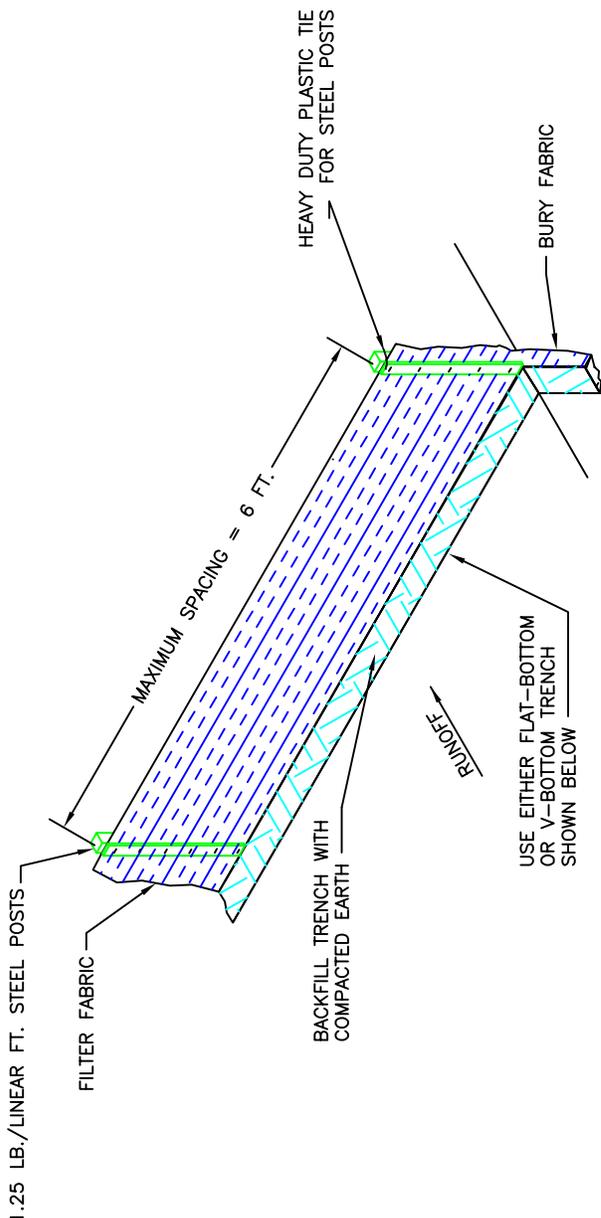

### SILT FENCE INSTALLATION

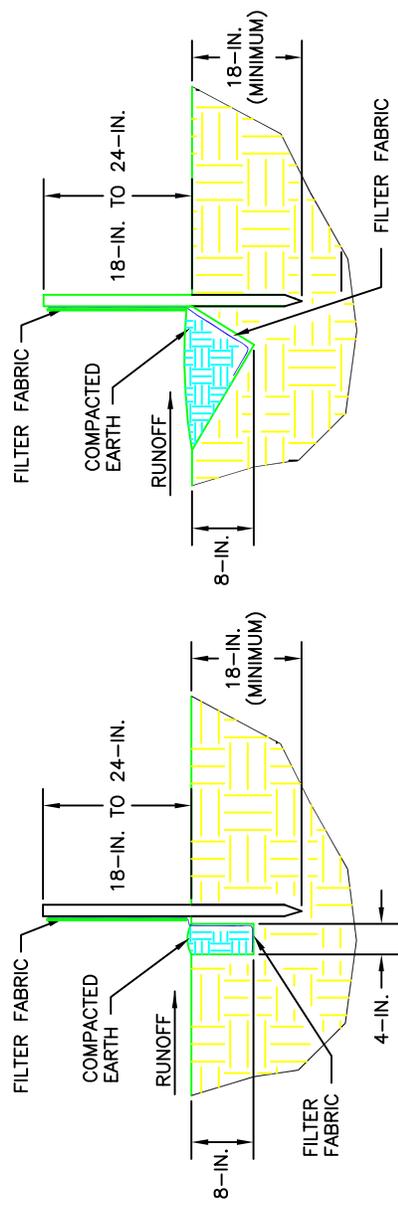

South Carolina Department of Health and Environmental Control

SILT FENCE

STANDARD DRAWING NO. SC-03 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

## SILT FENCE DETAIL

### When and Where to Use It

Silt fence is applicable in areas:

Where the maximum sheet or overland flow path length to the fence is 100–feet.  
Where the maximum slope steepness (normal [perpendicular] to fence line) is 2H:1V.  
That do not receive concentrated flows greater than 0.5 cfs.

Do not place silt fence across channels or use it as a velocity control BMP.

### Materials

#### Steel Posts

Use 48–inch long steel posts that meet the following minimum physical requirements:

Composed of high strength steel with minimum yield strength of 50,000 psi.

Have a standard “T” section with a nominal face width of 1.38–inches and nominal “T” length of 1.48–inches.

Weigh 1.25 pounds per foot ( $\pm 8\%$ ).

Have a soil stabilization plate with a minimum cross section area of 17–square inches attached to the steel posts.  
Painted with a water based baked enamel paint.

Use steel posts with a minimum length of 4–feet, weighing 1.25 pounds per linear foot ( $\pm 8\%$ ) with projections to aid in fastening the fabric. Except when heavy clay soils are present on site, steel posts will have a metal soil stabilization plate welded near the bottom such that when the post is driven to the proper depth, the plate will be below the ground level for added stability.

The soil plates should have the following characteristics:

Be composed of minimum 15 gauge steel.

Have a minimum cross section area of 17–square inches.

#### Geotextile Filter Fabric

Filter fabric is:

Composed of fibers consisting of long chain synthetic polymers composed of at least 85% by weight of polyolefins, polyesters, or polyamides. Formed into a network such that the filaments or yarns retain dimensional stability relative to each other. Free of any treatment or coating which might adversely alter its physical properties after installation. Free of defects or flaws that significantly affect its physical and/or filtering properties. Cut to a minimum width of 36 inches.

Use only fabric appearing on SCDOT Approval Sheet #34 meeting the requirements of the most current edition of the SCDOT Standard Specifications for Highway Construction.

South Carolina Department of  
Health and Environmental Control

SILT FENCE

STANDARD DRAWING NO. SC-03 Page 2 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

## SILT FENCE DETAIL

### Installation

Excavate a trench approximately 6-inches wide and 6-inches deep when placing fabric by hand. Place 12-inches of geotextile fabric into the 6-inch deep trench, extending the remaining 6-inches towards the upslope side of the trench. Backfill the trench with soil or gravel and compact. Bury 12-inches of fabric into the ground when pneumatically installing silt fence with a slicing method. Purchase fabric in continuous rolls and cut to the length of the barrier to avoid joints. When joints are necessary, wrapped the fabric together at a support post with both ends fastened to the post, with a 6-inch minimum overlap. Install posts to a minimum depth of 24-inches. Install posts a minimum of 1- to 2- inches above the fabric, with no more than 3-feet of the post above the ground. Space posts to maximum 6-foot centers. Attach fabric to wood posts using staples made of heavy-duty wire at least 1½-inch long, spaced a maximum of 6-inches apart. Staple a 2-inch wide lathe over the filter fabric to securely fasten it to the upslope side of wooden posts. Attach fabric to the steel posts using heavy-duty plastic ties that are evenly spaced and placed in a manner to prevent sagging or tearing of the fabric. In call cases, ties should be affixed in no less than 4 places. Install the fabric a minimum of 24-inches above the ground. When necessary, the height of the fence above ground may be greater than 24-inches. In tidal areas, extra silt fence height may be required. The post height will be twice the exposed post height. Post spacing will remain the same and extra height fabric will be 4-, 5-, or 6-foot tall. Locate silt fence checks every 100 feet maximum and at low points. Install the fence perpendicular to the direction of flow and place the fence the proper distance from the toe of steep slopes to provide sediment storage and access for maintenance and cleanup.



### Inspection and Maintenance

Inspect every seven calendar days and within 24-hours after each rainfall event that produces ½-inches or more of precipitation. Check for sediment buildup and fence integrity. Check where runoff has eroded a channel beneath the fence, or where the fence has sagged or collapsed by fence overtopping. If the fence fabric tears, begins to decompose, or in any way becomes ineffective, replace the section of fence immediately.

Remove sediment accumulated along the fence when it reaches 1/3 the height of the fence, especially if heavy rains are expected. Remove trapped sediment from the site or stabilize it on site.


Remove silt fence within 30 days after final stabilization is achieved or after temporary best management practices (BMPs) are no longer needed. Permanently stabilize disturbed areas resulting from fence removal.

L = THE DISTANCE SUCH THAT POINTS A & B ARE OF EQUAL ELEVATION

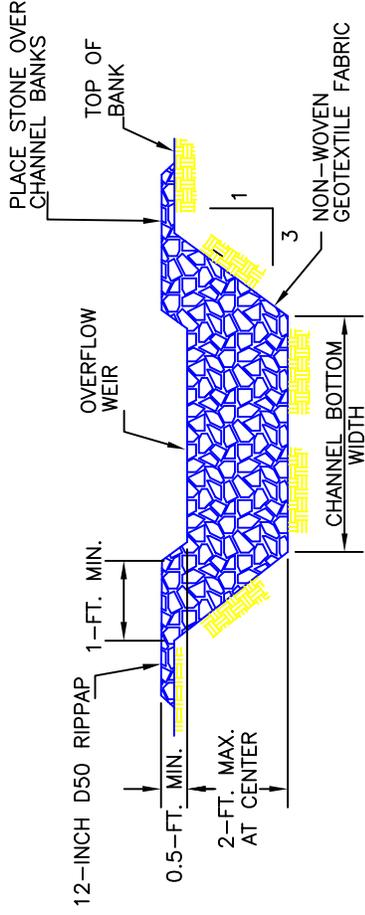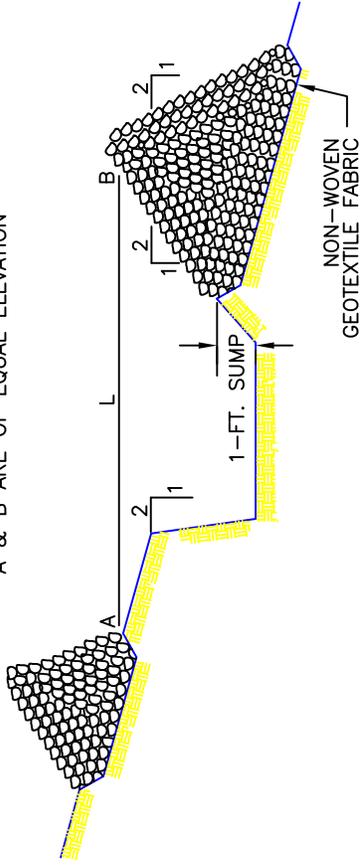

### SPACING BETWEEN DITCH CHECK

### CROSS SECTION A-A THRU STONE DITCH CHECK

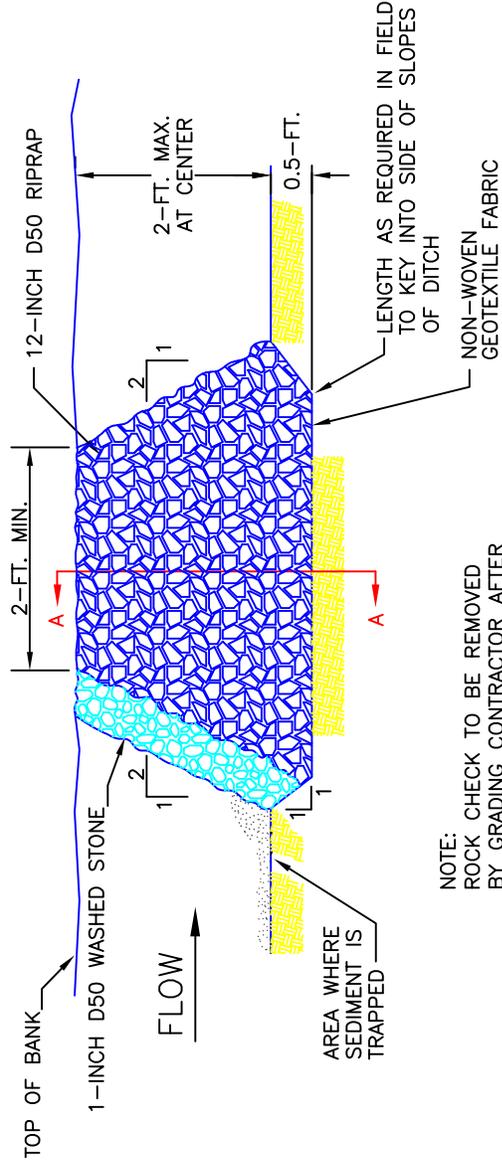

NOTE:  
ROCK CHECK TO BE REMOVED  
BY GRADING CONTRACTOR AFTER  
CONSTRUCTION IS COMPLETE AND  
GRASSING IS ESTABLISHED

### TYPICAL DITCH CHECK SECTION

South Carolina Department of  
Health and Environmental Control

ROCK DITCH CHECK

STANDARD DRAWING NO. SC-04 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

## ROCK DITCH CHECK

### When and Where to Use It

A rock ditch check should be installed in steeply sloped swales, or in swales where adequate vegetation cannot be established. Rock ditch checks should be used only in small open channels. Rock ditch checks should not be placed in waters of the commonwealth or USGS blue-line streams (unless approved by SCDHEC or Federal authorities).

### Installation:

A non-woven geotextile fabric shall be installed over the soil surface where the rock ditch check is to be placed.

The body of the rock ditch check shall be composed of 12-inch D50 Riprap.

The upstream face of the rock ditch check may be composed of 1-inch D50 washed stone.

Rock ditch checks should not exceed a height of 2-feet at the centerline of the channel.

Rock ditch checks should have a minimum top flow length of 2-feet.

Stone should be placed over the channel banks to prevent water from cutting around the ditch check.

The rock must be placed by hand or mechanical placement (no dumping of rock to form dam) to achieve complete coverage of the ditch or swale and to ensure that the center of the check is lower than the edges.

The maximum spacing between the dams should be such that the toe of the upstream check is at the same elevation as the top of the downstream check.

### Inspection and Maintenance:

Inspect rock ditch checks every seven (7) calendar days and within 24-hours after each rainfall event that produces  $\frac{1}{2}$ -inches or more of precipitation. Inspect for sediment and debris accumulation. Inspect ditch check edges for erosion and repair promptly as required.

Sediment should be removed when it reaches  $\frac{1}{3}$  the original check height.

In the case of grass-lined ditches and swales, rock ditch checks should be removed when the grass has matured sufficiently to protect the ditch or swale unless the slope of the swale is greater than 4%.

After construction is complete, all stone should be removed by the grading contractor if vegetation will be used for permanent erosion control measures.

The area beneath the rock ditch checks should be seeded and mulched immediately after rock check dam removal.


South Carolina Department of  
Health and Environmental Control

ROCK DITCH CHECK


STANDARD DRAWING NO. SC-04 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

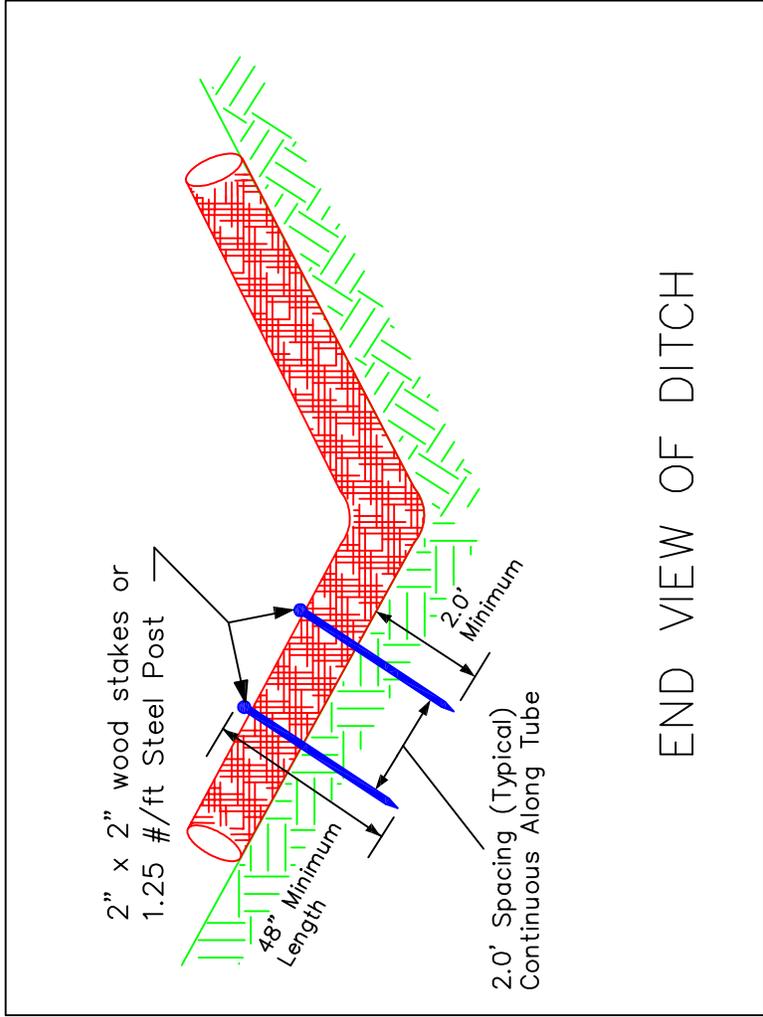

END VIEW OF DITCH

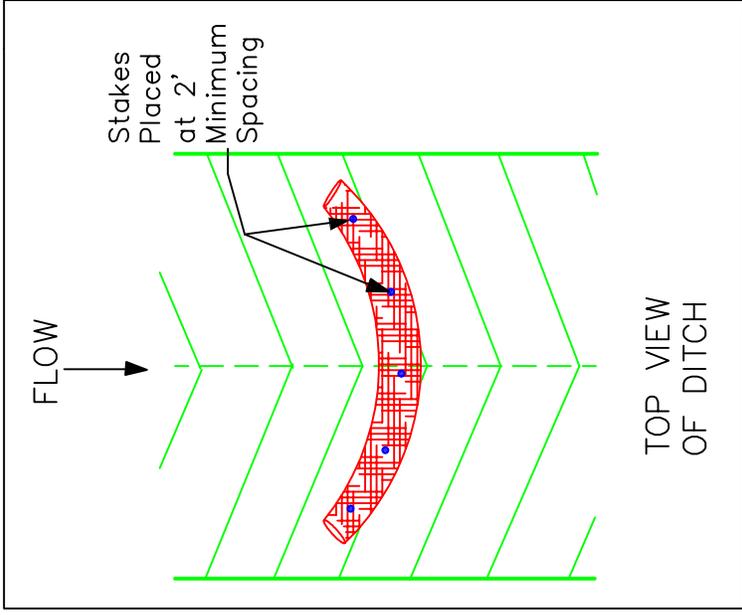

TOP VIEW  
OF DITCH

South Carolina Department of  
Health and Environmental Control

SEDIMENT TUBE

STANDARD DRAWING NO. SC-05 Page 1 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC \_\_\_\_\_

## SEDIMENT TUBE

### Description

Sediment tubes are elongated tubes of compacted geotextiles, curled excelsior wood, natural coconut fiber or hardwood mulch. Straw, pine needle and leaf mulch—filled sediment tubes are not permitted under this specification.

### When and Where to Use It:

Install sediment tubes along contours, in drainage conveyance swales, and around inlets to help reduce the effects of soil erosion by energy dissipation and retain sediment.

### Materials

Sediment tubes for ditch checks and Type A Inlet Structure Filters exhibit the following properties:  
Produced by a Manufacturer experienced in sediment tube manufacturing.

Composed of compacted geotextiles, curled excelsior wood, natural coconut fibers, hardwood mulch or a mix of these materials enclosed by a flexible netting material. Straw, straw fiber, straw bales, pine needles and leaf mulch are not allowed under this specification.

Utilizes outer netting that consists of seamless, high-density polyethylene photodegradable materials treated with ultraviolet stabilizers or a seamless, high-density polyethylene non-degradable materials. Diameter ranging from 18-inches to 24-inches.

Curled excelsior wood, or natural coconut rolled erosion control products (RECPs) that are rolled up to create a sediment tube are not allowed under this specification.

### Installation:

Install over bare soil, mulched areas or erosion control blankets.

Be composed of geotextiles, curled excelsior wood, natural coconut fiber or hardwood mulch enclosed by a flexible netting material. Straw, straw fiber, straw bales, pine needles and leaf mulch are not allowed.

The minimum diameter should be 18 inches.

Sediment tubes should be staked using wooden stakes (2-inch x 2-inch) or steel posts (standard "U" or "T" sections with a minimum weight of 1.25 pounds per foot) a minimum of 48-inches in length placed on 2-foot centers.

Stakes should be intertwined with the outer mesh on the downstream side and driven in the ground to a minimum depth of 1.5 feet leaving less than 1 foot of stake exposed above the sediment tube. Always refer to the Manufacturer's recommendations for the staking detail,  
Install all sediment tubes insuring that no gaps exist between the soil and the bottom of the sediment tube. The ends of adjacent sediment tubes should be lapped 6-inch to prevent flow and sediment from passing through the field joint. In no situations should sediment tubes be stacked on top of one another.

Construct a trench that is 20% of the tube diameter to install the tube in.

Avoid damage to sediment tubes while installing them. If the sediment tube becomes damaged during installation, a stake should be placed on both sides of the damaged area terminating the tube segment and a new tube segment should be installed. Should be installed in swales or drainage ditches perpendicular to the flow of water. Sediment tubes should continue up the side slopes a minimum of 1 foot above the design flow depth. Sediment tubes should be spaced according to the following table.

### SEDIMENT TUBE SPACING

SLOPE	MAXIMUM SEDIMENT TUBE SPACING
LESS THAN 2%	150-FEET
2%	100-FEET
3%	75-FEET
4%	50-FEET
5%	40-FEET
6%	30-FEET
GREATER THAN 6%	25-FEET

South Carolina Department of  
Health and Environmental Control

## SEDIMENT TUBE

STANDARD DRAWING NO. SC-05 Page 2 of 3

APPROVED BY: \_\_\_\_\_  
SCDHEC

AUGUST, 2005  
DATE

## SEDIMENT TUBE

Sediment tube length selected should minimize the number of sediment tubes needed to span the width of the drainage conveyance. If the ditch check length (perpendicular to the water flow) is 15 feet, then one 15 foot sediment tube is preferred compared to two overlapping 10 foot sediment tubes.

Sediment tubes for ditch checks should remain in place until fully established vegetation and root systems have completely developed and can survive on their own.

### Inspection and Maintenance:

Check dams should be inspected every 7 calendar days and within 24-hours after each storm that produces  $\frac{1}{2}$ -inches or more of rain to ensure continued effectiveness.

Large debris, trash, and leaves should be removed.

If erosion causes the edges to fall to a height equal to or below the height of the center, repairs should be made immediately.

Remove accumulated sediment from the upstream side of the sediment tube when the sediment has reached a height of approximately one-third of the exposed height of the tube (measured at the center).

Accumulated sediment should be removed prior to removing sediment tubes.


Sediment Tube removal should be completed only after the contributing drainage area has been completely stabilized. Permanent vegetation should replace areas from which gravel, stone, sediment tubes, or other materials have been removed.

South Carolina Department of  
Health and Environmental Control

## SEDIMENT TUBE

STANDARD DRAWING NO. SC-05 Page 3 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

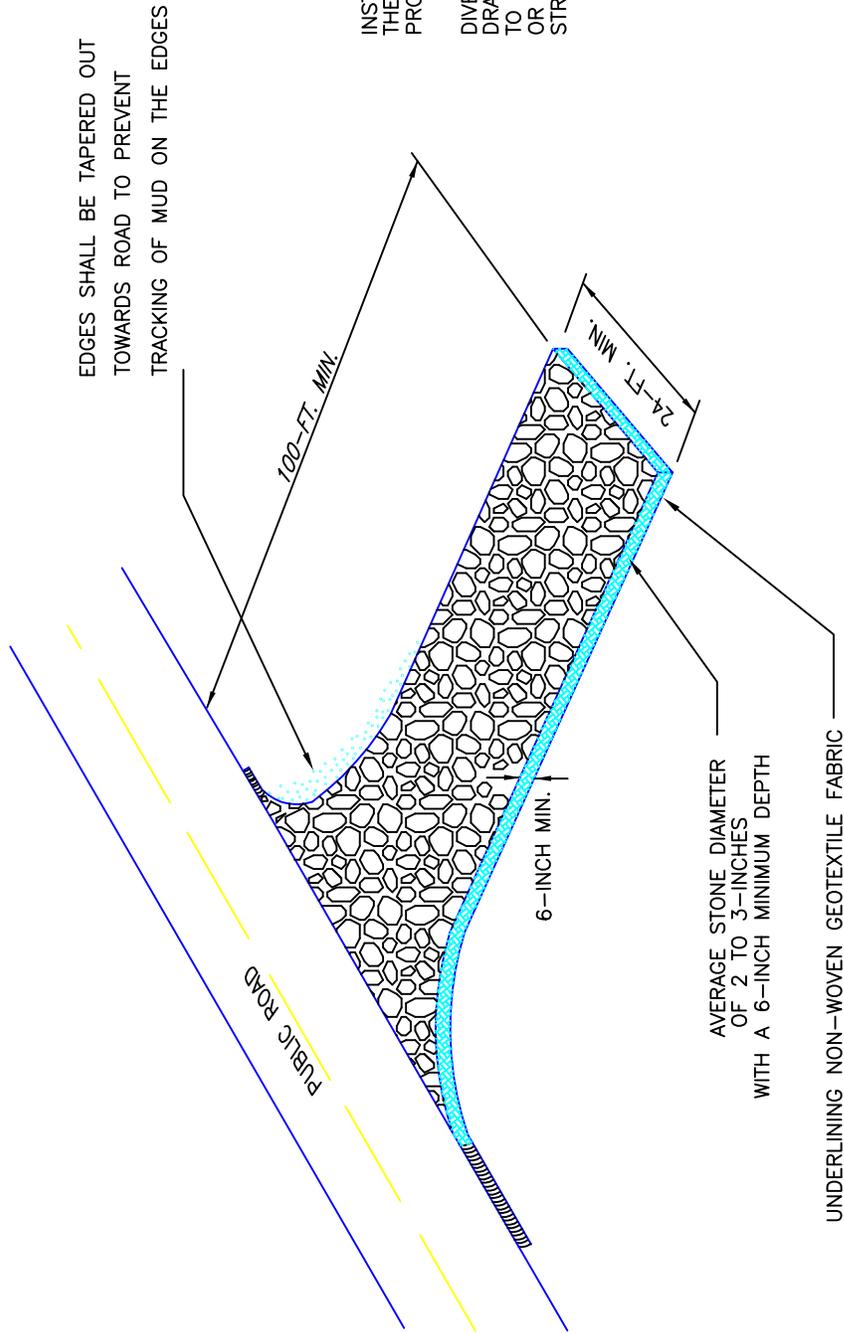

EDGES SHALL BE TAPERED OUT  
TOWARDS ROAD TO PREVENT  
TRACKING OF MUD ON THE EDGES

100-FT. MIN.

24-FT. MIN.

6-INCH MIN.

AVERAGE STONE DIAMETER  
OF 2 TO 3-INCHES  
WITH A 6-INCH MINIMUM DEPTH

UNDERLINING NON-WOVEN GEOTEXTILE FABRIC

INSTALL A CULVERT PIPE ACROSS  
THE ENTRANCE WHEN NEEDED TO  
PROVIDE POSITIVE DRAINAGE.

DIVERT ALL SURFACE RUNOFF AND  
DRAINAGE FROM THE STONE PAD  
TO A SEDIMENT TRAP OR BASIN  
OR OTHER SEDIMENT TRAPPING  
STRUCTURE.

**South Carolina Department of  
Health and Environmental Control**

STABILIZED CONSTRUCTION ENTRANCE

STANDARD DRAWING NO. SC-06 Page 1 of 3

APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
SCDHEC AUGUST, 2005

## STABILIZED CONSTRUCTION ENTRANCE

### When and Where to Use It

Stabilized construction entrances should be used at all points where traffic will be leaving a construction site and moving directly onto a public road.

### Important Considerations

If washing is used, provisions must be made to intercept the wash water and trap the sediment before it is carried offsite. Washdown facilities shall be required as directed by SCDHEC as needed. Washdown areas in general must be established with crushed gravel and drain into a sediment trap or sediment basin. Construction entrances should be used in conjunction with the stabilization of construction roads to reduce the amount of mud picked up by vehicles.

### Installation:

Remove all vegetation and any objectionable material from the foundation area.

Divert all surface runoff and drainage from stones to a sediment trap or basin.

Install a non-woven geotextile fabric prior to placing any stone.

Install a culvert pipe across the entrance when needed to provide positive drainage.

The entrance shall consist of 1-inch to 3-inch D50 stone placed at a minimum depth of 6-inches.

Minimum dimensions of the entrance shall be 24-foot wide by 100-foot long, and may be modified as necessary to accommodate site constraints.

The edges of the entrance shall be tapered out towards the road to prevent tracking of mud at the edge of the entrance.

<b>South Carolina Department of Health and Environmental Control</b>
STABILIZED CONSTRUCTION ENTRANCE
STANDARD DRAWING NO. <b>SC-06</b> Page 2 of 3
APPROVED BY: _____ DATE: AUGUST, 2005 SCDHEC

## STABILIZED CONSTRUCTION ENTRANCE

### Inspection and Maintenance:

Inspect construction entrances every seven (7) calendar days and within 24-hours after each rainfall event that produces 1/2-inches or more of precipitation, or after heavy use. Check for mud and sediment buildup and pad integrity. Make daily inspections during periods of wet weather. Maintenance is required more frequently in wet weather conditions. Reshape the stone pad as needed for drainage and runoff control.

Wash or replace stones as needed and as directed by the inspector. The stone in the entrance should be washed or replaced whenever the entrance fails to reduce mud being carried off-site by vehicles. Frequent washing will extend the useful life of stone.

Immediately remove mud and sediment tracked or washed onto public roads by brushing or sweeping. Flushing should only be used when the water can be discharged to a sediment trap or basin.

Repair any broken pavement immediately.


South Carolina Department of  
Health and Environmental Control

STABILIZED CONSTRUCTION ENTRANCE

STANDARD DRAWING NO. SC-06 Page 3 of 3


APPROVED BY: \_\_\_\_\_ AUGUST, 2005 \_\_\_\_\_ DATE  
SCHEC

2-IN. X 2-IN. WOOD POSTS  
OR  
1.25 LB./LINEAR FT.  
STEEL POSTS

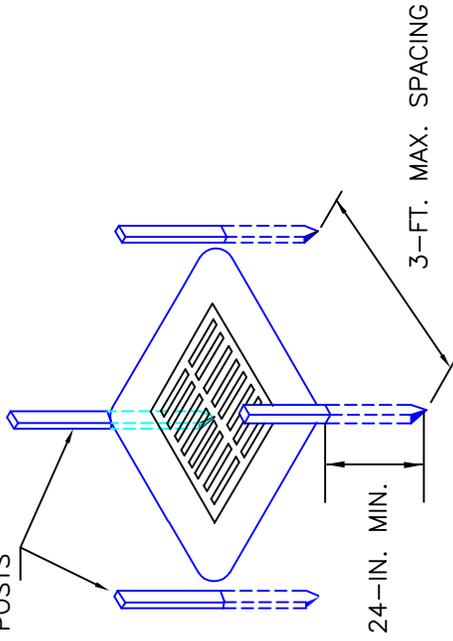


ATTACH FILTER FABRIC TO  
POSTS WITH STAPLES OR TIES  
SPACED 6-IN. APART MAX.

FOLD FABRIC TO OVERLAP  
6 INCHES AND SECURE  
TO POSTS WITH STAPLES  
OR WIRE TIES

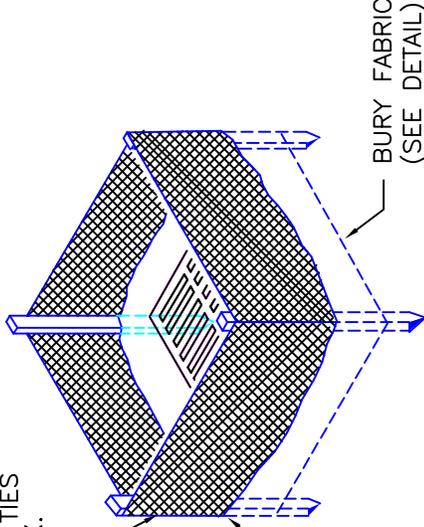

### POST INSTALLATION DETAIL

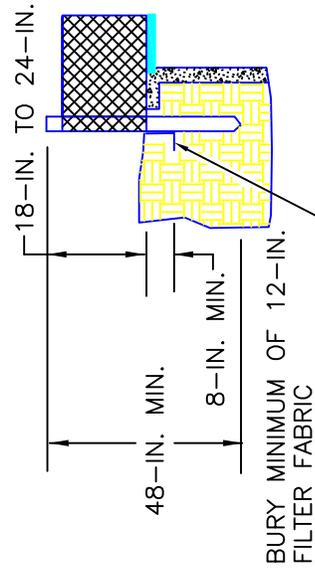

### FILTER FABRIC BURIAL DETAIL

### FILTER FABRIC INSTALLATION DETAIL

South Carolina Department of  
Health and Environmental Control

TYPE A - FILTER FABRIC INLET PROTECTION

STANDARD DRAWING NO. SC-07 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
SCDHEC

## FILTER FABRIC INLET PROTECTION

### Materials:

- Use filter fabric that conforms to SCDOT standard specifications for highway construction (latest edition). Refer to the silt fence geotextile fabrics Approval Sheet #34.
- Use steel posts that meet the following minimum physical requirements:
  - Be composed of high strength steel with minimum yield strength of 50,000 psi.
  - Have a standard "T" section with a nominal face width of 1.38-inches and nominal "T" length of 1.48-inches.
  - Weigh 1.25 pounds per foot ( $\pm 8\%$ ).
  - Be painted with a water based baked enamel paint.
- Attach fabric to metal posts with heavy-duty plastic ties.

### Installation:

- Excavate a trench 6-inches wide and 6-inches deep around the outside perimeter of the inlet unless the fabric is pneumatically installed.
- Extend the filter fabric a minimum of 12-inches into the trench. Backfill the trench with soil or crushed stone and compact over the filter fabric unless the fabric is pneumatically installed.
- Use steel posts with a minimum post length of 60-inches consisting of standard "T" sections with a weight of 1.25 pounds per foot ( $\pm 8\%$ ). Install the filter fabric to a minimum height of 24-inches above grade. Space the steel posts around the perimeter of the inlet a maximum of 3-feet apart and drive them into the ground a minimum of 24-inches. Cut the filter fabric from a continuous roll to the length of the protected area to avoid the use of joints. When joints are necessary, wrap filter fabric together only at a support post with both ends securely fastened to the post, with a minimum 6-inch overlap.
- Attach fabric to steel posts with heavy-duty plastic ties.
- Attach at least four (4) evenly spaced ties in a manner to prevent sagging or tearing of the fabric. In all cases, affix ties in no less than four (4) places.

### Inspection and Maintenance:

- Inspections should be made every 7 calendar days and within 24-hours after each storm that produces  $\frac{1}{2}$ -inches or more of rain. If the fabric becomes clogged, it should be replaced.
- Sediment should be removed when it reaches approximately  $\frac{1}{3}$  the height of the fence. Take care not to damage or undercut fabric when removing sediment. If a sump is used, sediment should be removed when it fills approximately  $\frac{1}{3}$  the depth of the hole. Maintain the pool area, always providing adequate sediment storage volume for the next storm.
- Storm drain inlet protection structures should be removed only after the disturbed areas are permanently stabilized. Remove all construction material and sediment, and dispose of them properly.
- Grade the disturbed area to the elevation of the drop inlet structure crest. Use appropriate permanent stabilization methods to stabilize bare areas around the inlet.

South Carolina Department of  
Health and Environmental Control


Type A

FILTER FABRIC INLET PROTECTION


STANDARD DRAWING NO. SC-07 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
SCDHEC


2-IN. X 2-IN. WOOD POSTS  
OR  
1.25 LB./LINEAR FT.  
STEEL POSTS

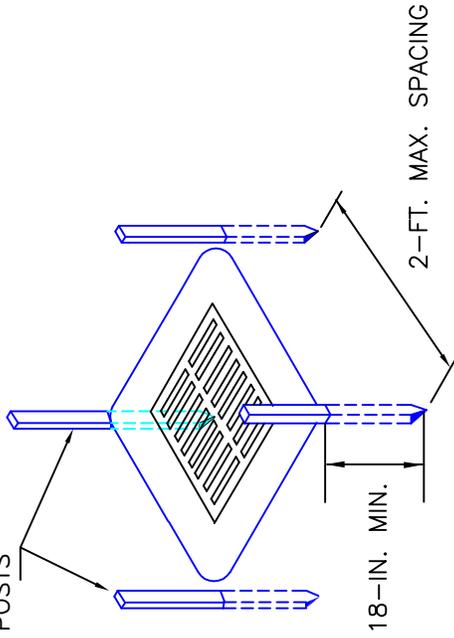

POST INSTALLATION DETAIL

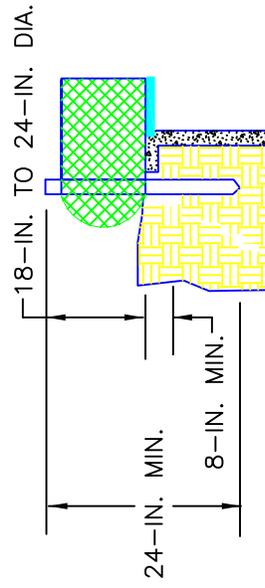

SEDIMENT TUBE BURIAL DETAIL

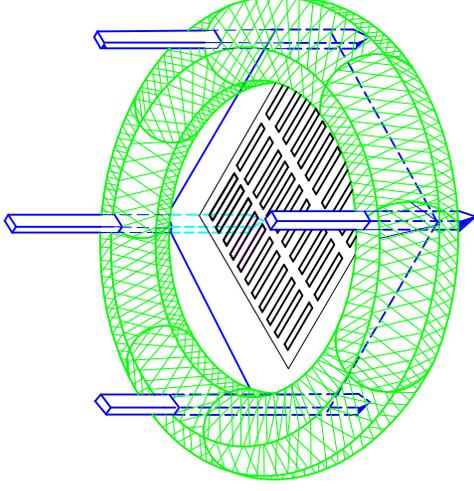

SEDIMENT TUBE INSTALLATION  
DETAIL

South Carolina Department of  
Health and Environmental Control

TYPE A - SEDIMENT TUBE INLET PROTECTION

STANDARD DRAWING NO. SC-07 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
SCDHEC AUGUST, 2005

## SEDIMENT TUBE INLET PROTECTION

### Materials:

Sediment tubes for Type A Inlet Structure. Filters exhibit the following properties:

Produced by a Manufacturer experienced in sediment tube manufacturing.

Composed of compacted geotextiles, curled excelsior wood, natural coconut fibers, hardwood mulch or a mix of these materials enclosed by a flexible netting material. Straw, straw fiber, straw bales, pine needles, and leaf mulch are not allowed under this specification.

Utilizes outer netting that consists of seamless, high-density polyethylene photodegradable materials treated with ultraviolet stabilizers or a seamless, high-density polyethylene non-degradable materials.

Diameter ranging from 18-inches to 24-inches.

Curled excelsior wood, or natural coconut rolled erosion control products (RECPs) that are rolled up to create a sediment tube are not allowed under this specification. Select applicable Sediment Tubes from the SCDOT approved products list.

Use 48-inch long wood posts that meet the following requirements.

2-inch by 2-inch size.

Heavy-duty wire staples at least 1½-inch long, spaced a maximum of 6-inches apart to attach the filter fabric to wooden stakes.

Use 48-inch long steel posts that meet the following minimum physical requirements:

Be composed of high strength steel with minimum yield strength of 50,000 psi.

Have a standard "T" section with a nominal face width of 1.38-inches and nominal "T" length of 1.48-inches.

Weigh 1.25 pounds per foot ( $\pm$  8%).

Be painted with a water based baked enamel paint.

### Installation:

Remove all rocks, clods, vegetation or other obstructions so installed sediment tubes have direct contact with the underlying soil or surface.

Install sediment tubes by laying them flat on the ground. Construct a small trench to a depth that is 20% of the sediment tube diameter. Lay the sediment tube in the trench and compact the upstream sediment tube soil interface. Do not completely bury sediment tubes during installation. Lap the ends of adjacent sediment tubes a minimum of 6-inches to prevent flow and sediment from passing through the field joint. Never stack sediment tubes on top of one another. Install sediment tubes using wooden stakes (2-inch x 2-inch) or steel posts (standard "U" or "T" sections with a minimum weight of 1.25 pounds per foot) a minimum of 48-inches in length placed on 2-foot centers. Intertwine the stakes with the outer mesh on the downstream side, and drive the stakes in the ground to a minimum depth of 24-inches leaving less than 12-inches of stake above the exposed sediment tube.

### Inspection and Maintenance:

Inspect every seven calendar days and within 24-hours after each rainfall event that produces ½-inches or more of precipitation. Inspect sediment tubes after installation for gaps under the tubes and for gaps between joints of adjacent ends of sediment tubes. Repair rills, gullies, and all undercutting near sediment tubes. Remove and/or replace installed sediment tubes as required to adapt to changing construction site conditions. Remove all sediment tubes from the site when the functional longevity is exceeded as determined by the Engineer, Inspector or Manufacturer's Representative. Dispose of sediment tubes in regular means as non-hazardous, inert material.

South Carolina Department of  
Health and Environmental Control

Type A

SEDIMENT TUBE INLET PROTECTION

STANDARD DRAWING NO. SC-07 Page 2 of 2

APPROVED BY:


SCDHEC

AUGUST, 2005


DATE

1.25 LB./LINEAR FT.  
STEEL POSTS

ATTACH 1/2 x 1/2 IN. MAX. OPENING  
WIRE MESH TO POSTS WITH WIRE TIES  
SPACED A MAX. OF 6-IN. APART

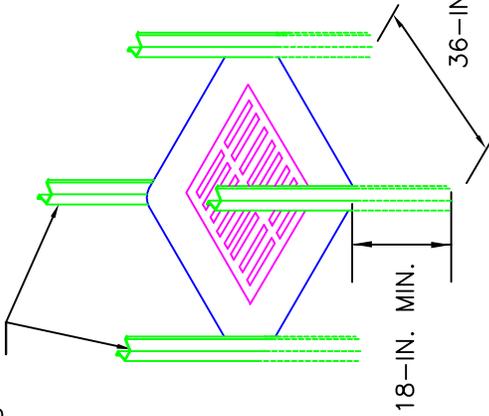


FOLD WIRE MESH TO OVERLAP  
ENDS AND SECURE TO  
POSTS WITH WIRE TIES

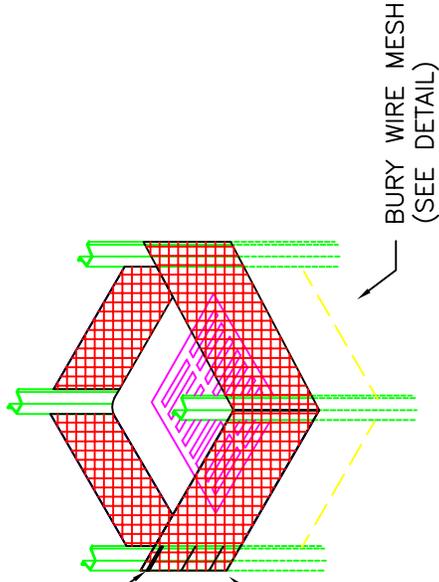

BURY WIRE MESH  
(SEE DETAIL)

### POST INSTALLATION DETAIL

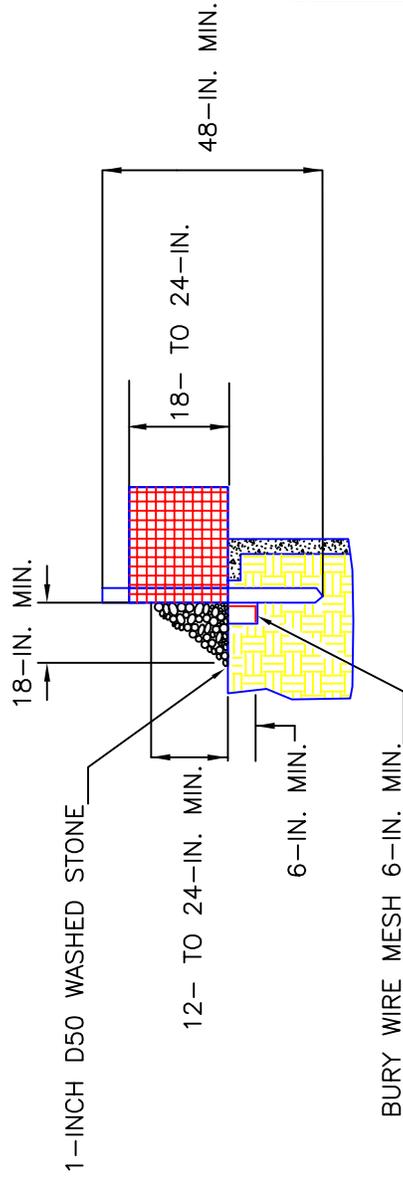

1-INCH D50 WASHED STONE

12- TO 24-IN. MIN.

18- TO 24-IN.

48-IN. MIN.

BURY WIRE MESH 6-IN. MIN.

### WIRE MESH INSTALLATION DETAIL

### STONE AND WIRE MESH INSTALLATION DETAIL

South Carolina Department of  
Health and Environmental Control

TYPE B - HARDWARE FABRIC AND  
STONE INLET PROTECTION

STANDARD DRAWING NO. SC-08 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

## TYPE B – WIRE MESH AND STONE INLET PROTECTION

### Materials

Use hardware fabric or comparable wire mesh with maximum openings of 0.5–inches x 0.5–inches as the supporting material.

Use steel posts that meet the following minimum physical requirements:

Be composed of high strength steel with minimum yield strength of 50,000 psi.

Have a standard "T" section with a nominal face width of 1.38–inches and nominal "T" length of 1.48–inches.

Weigh 1.25 pounds per foot ( $\pm 8\%$ ).

Be painted with a water based baked enamel paint.

Use heavy-duty wire ties to attach the wire mesh material to the steel posts.

Place Aggregate No. 5 washed stone against the hardware fabric on all sides.

### Installation:

Excavate a trench 6–inches deep around the outside perimeter of the inlet.

Use hardware fabric or comparable wire mesh with maximum openings of 0.5–inches by 0.5–inches as the supporting material. Extended the fabric a minimum of 6–inches into the ground. Backfill the trench with soil or crushed stone and compact over the fabric.

Use steel posts with a minimum post length of 36–inches consisting of standard "T" sections with a weight of 1.25 pounds per foot ( $\pm 8\%$ ). Install the wire mesh fabric above grade a minimum of 18–inches without exceeding 24–inches.

Space the steel posts a maximum of 3–feet apart around the perimeter of the inlet and drive them into the ground a minimum of 18–inches.

Use heavy-duty wire ties spaced a maximum of 6–inches apart to attach the wire mesh material to the steel posts.

Place Aggregate No. 5 washed stone to a minimum height of 12–inches, and a maximum height of 24–inches against the hardware fabric on all sides.

### Inspection and Maintenance:

If the stone becomes clogged with sediment, pull the stones away from the inlet and clean or replace them.

Since cleaning of gravel at a construction site may be difficult, an alternative approach would be to use the clogged stone as fill and put fresh stone around the inlet.

Remove accumulated sediment from stone when sediment reaches  $\frac{1}{3}$  of the height of the structure

South Carolina Department of  
Health and Environmental Control

TYPE B – HARDWARE FABRIC AND  
STONE INLET PROTECTION



STANDARD DRAWING NO. SC-08 Page 2 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC

AUGUST, 2005  
DATE

CONCRETE BLOCK WITH BOTTOM ROW OPENINGS FACING OUTWARD

1/2-INCH x 1/2-INCH WIRE MESH

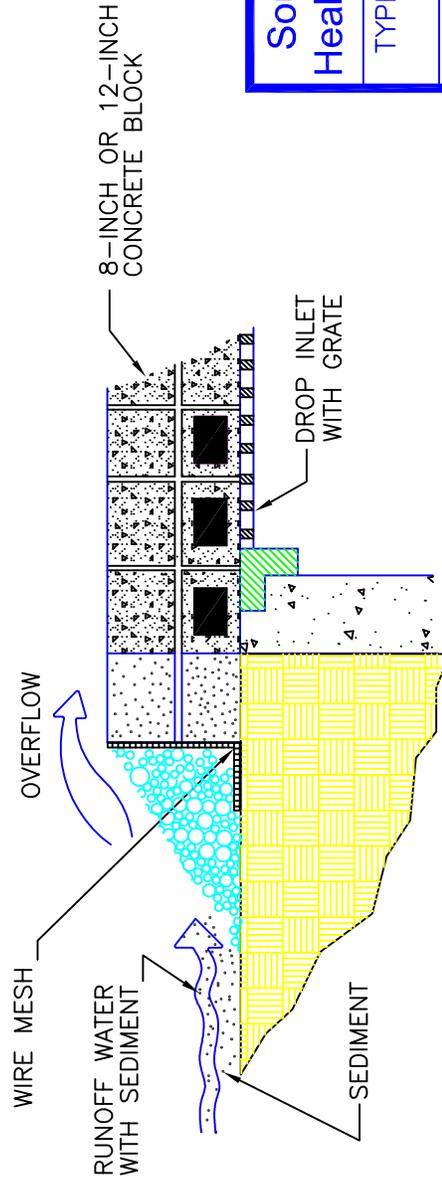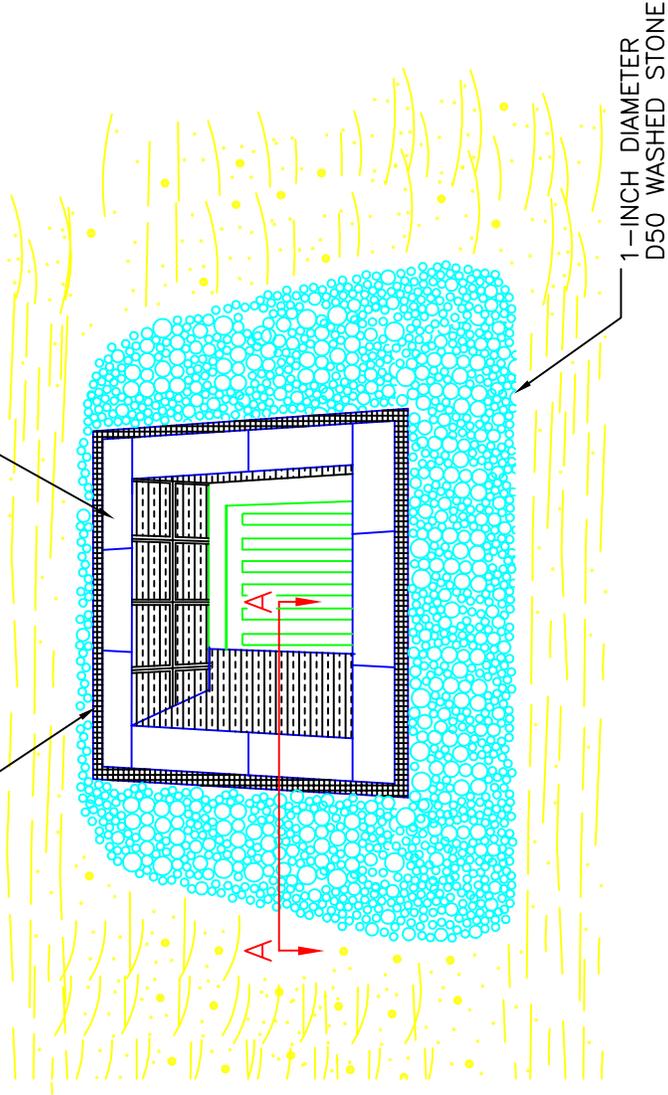

CROSS SECTION A-A

South Carolina Department of Health and Environmental Control

TYPE C - BLOCK AND GRAVEL DROP INLET PROTECTION

STANDARD DRAWING NO. SC-09 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
SCDHEC AUGUST, 2005

## BLOCK AND GRAVEL DROP INLET PROTECTION

### Installation:

Block and gravel filters can be used where heavy flows and higher velocities are expected and where an overflow capacity is necessary to prevent excessive ponding around the structure.

Gravel shall consist of 1–inch D50 Washed Stone and should extend to height equal to the elevation of the top of the blocks.

Place the bottom row of the concrete blocks lengthwise on their side so that the open end faces outward, not upward.

The height of the barrier can be varied, depending upon design needs by stacking a combination of blocks that are 8– and 12–inches wide.

Wire mesh should be placed over the outside vertical face of the concrete blocks to prevent stones from being washed through the holes in the blocks. Hardware cloth or comparable wire mesh with  $\frac{1}{2}$ –inch x  $\frac{1}{2}$ –inch openings should be used.

### Inspection and Maintenance:

Inspections should be made every seven (7) calendar days and within 24–hours after each rainfall event that produces  $\frac{1}{2}$ –inches or more of precipitation. Any needed repairs should be handled immediately.

Sediment should be removed when it reaches approximately  $\frac{1}{3}$  the height of the blocks. If a sump is used, sediment should be removed when it fills approximately  $\frac{1}{3}$  the depth of the hole.

If the stone filter becomes clogged with sediment, the stones must be pulled away from the inlet and cleaned or replaced. Since cleaning of gravel at a construction site may be difficult, an alternative approach would be to use the clogged stone as fill and put fresh stone around the inlet.

Storm drain inlet protection structures should be removed only after the disturbed areas are permanently stabilized. Remove all construction material and sediment, and dispose of them properly. Grade the disturbed area to the elevation of the drop inlet structure crest. Stabilize all bare areas immediately.


**South Carolina Department of  
Health and Environmental Control**

**TYPE C – BLOCK AND GRAVEL DROP  
INLET PROTECTION**

STANDARD DRAWING NO. **SC-09** Page 2 of 2

APPROVED BY: \_\_\_\_\_ **SCDHEC** **AUGUST, 2005**  
DATE

TOP VIEW

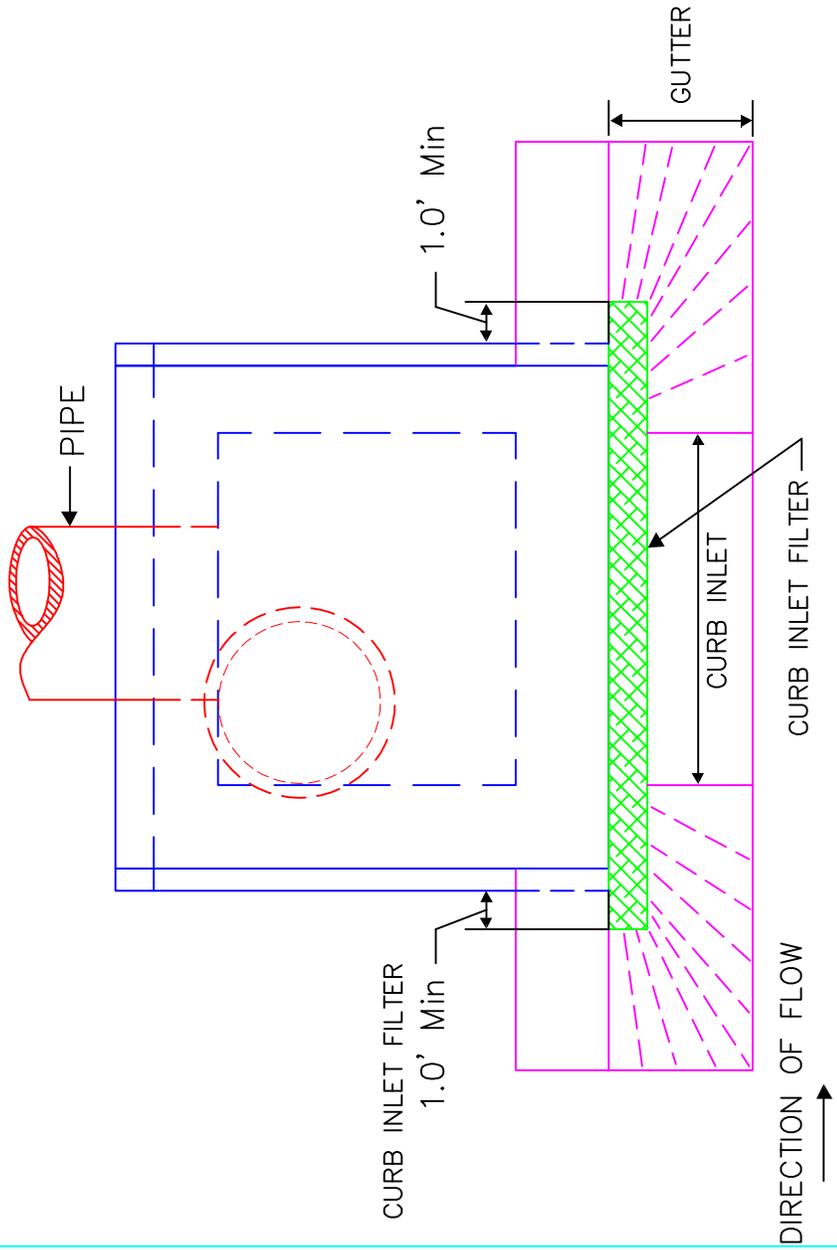

South Carolina Department of  
Health and Environmental Control

TYPE E - SURFACE COURSE  
CURB INLET FILTERS

STANDARD DRAWING NO. SC-10 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
SCDHEC

AUGUST, 2005

## Type E – Surface Course Curb Inlet Filters

### Materials

Only use surface course inlet filters that have a minimum height or diameter of 9-inches and have a minimum length that is 2-feet longer than the length of the curb opening. Surface course inlet filters are not designed to completely block the inlet opening.

Surface course inlet filters are constructed with a synthetic material that will allow storm water to freely flow through while trapping sediment and debris. The geotextile is non-biodegradable and resistant to degradation by ultraviolet exposure and resistant to contaminants commonly encountered in storm water. Straw, straw fiber, straw bales, pine needles and leaf mulch are not permissible filter materials.

Surface course inlet filters have aggregate compartments for stone, sand or other weighted materials or mechanisms to hold the unit in place.

Use filter fabric that is capable of reducing effluent sediment concentrations by no less than 80% under typical sediment migration conditions.

Applicable Type E inlet filters may be selected from the SCDOT approved products list.

### Installation:

Surface course inlet filters are applicable for road Catch Basin after the road surface course is placed. Place surface course inlet filters where sediment may spill over sidewalks and curbs.

Install surface course inlet filters in front of curb inlet openings. The filter shall have a minimum height or diameter of 9-inches and have a minimum length that is 2-feet longer than the length of the curb opening. This will allow sufficient length to cover the inlet with at least 1-foot of clearance beyond the inlet on both ends.

Do not completely block the inlet opening with surface course inlet filters. Install surface course inlet filters in a manner to allow overflows to enter the catch basin.

Fill the aggregate compartment to a level (at least ½ full) that will keep the surface course inlet filter in place and create a seal between the surface course inlet filter and the road surface.

### Inspection and Maintenance:

Ponding is likely if sediment is not removed regularly.

Inspect surface course curb inlet filters on a regular basis and immediately after major rain events.



Clean the surface course curb inlet filter if a visual inspection shows silt and debris build up around the filter.

South Carolina Department of  
Health and Environmental Control

TYPE E - SURFACE COURSE  
CURB INLET FILTERS

STANDARD DRAWING NO. SC-10 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

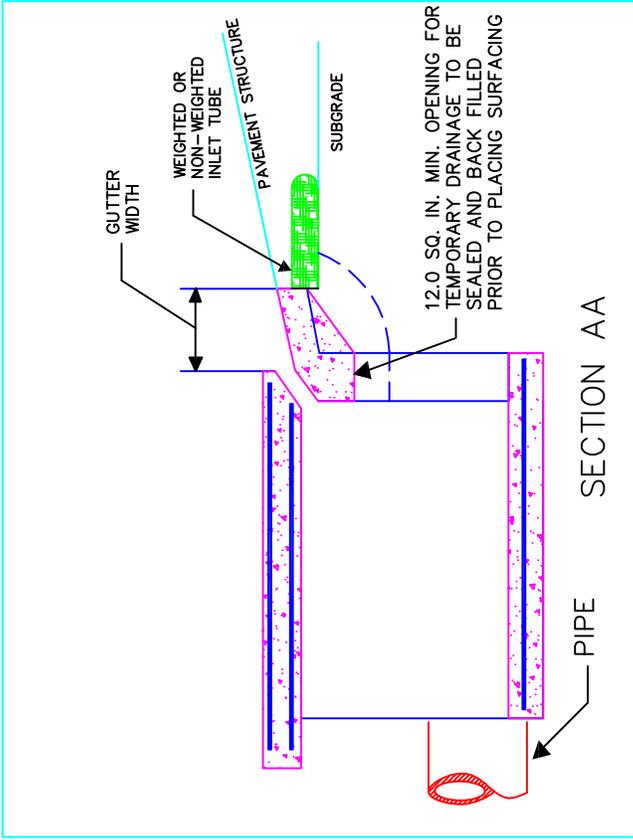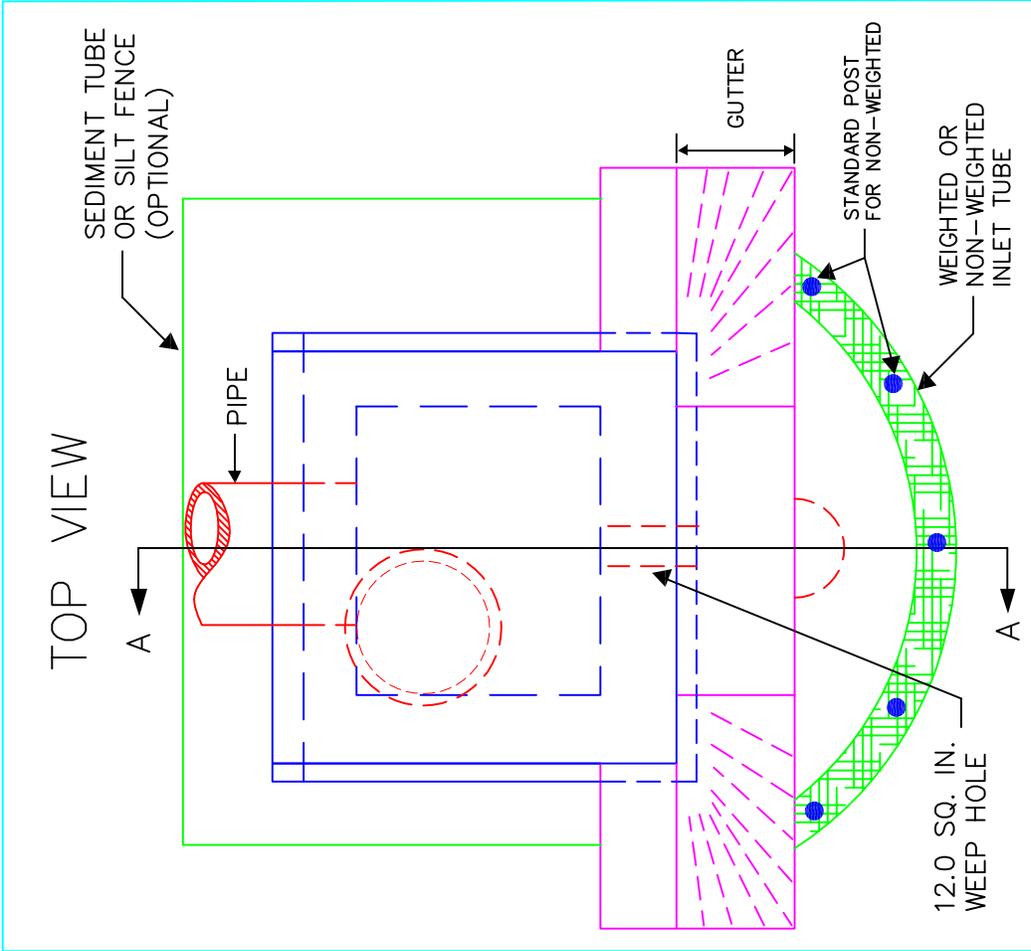

**South Carolina Department of Health and Environmental Control**

**TYPE F INLET TUBES**

STANDARD DRAWING NO. SC-11 Page 1 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

### Type F Inlet Tubes

#### Materials

Use inlet tubes that exhibit the following properties:

Produced by a Manufacturer experienced in sediment tube manufacturing.

Composed of compacted geotextiles, curled excelsior wood, natural coconut fibers or hardwood mulch or a mix of these materials enclosed by a flexible netting material.

Do not use straw, straw fiber, straw bales, pine needles or leaf mulch under this specification.

Utilize an outer netting that consists of seamless, high-density polyethylene photodegradable materials treated with ultraviolet stabilizers or a seamless, high-density polyethylene non-degradable materials. Curled wood excelsior fiber, or natural coconut fiber rolled erosion control products (RECP) rolled up to create an inlet tube devices are not allowed under this specification.

#### Weighted Inlet Tubes

Weighted inlet tubes are sediment tubes capable of staying in place without external stabilization measures and may have a weighted inner core or other weighted mechanism to keep them in place.

#### Materials

Applicable Type F weighted inlet tubes may be selected from the SCDOT approved products list.

#### Installation:

Install weighted inlet tubes lying flat on the ground, with no gaps between the underlying surface and the inlet tube.  
Never stack weighted inlet tubes on top of one another.

Do not completely block inlets with weighted inlet tubes.

Install weighted inlet tubes in such a manner that all overflow or overtopping water has the ability to enter the inlet unobstructed.

To avoid possible flooding, two or three concrete cinder blocks may be placed between the weighted inlet tubes and the inlet.

#### Non-Weighted Inlet Tubes

Non-weighted inlet tubes are defined as sediment tubes that require staking or other stabilization methods to keep them safely in place.

#### Materials

Applicable Type F non-weighted inlet tubes may be selected from the SCDOT approved products list.

#### Inspection and Maintenance:

Inlet tubes may be temporarily moved during construction as needed.



Replace inlet tubes damaged during installation as directed by the Inspector or Manufacturer's Representative at the contractor's expense.

South Carolina Department of  
Health and Environmental Control

TYPE F INLET TUBES

STANDARD DRAWING NO. SC-11 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

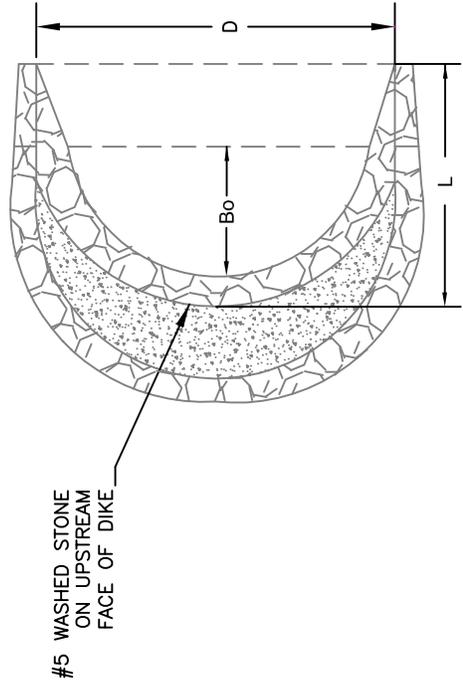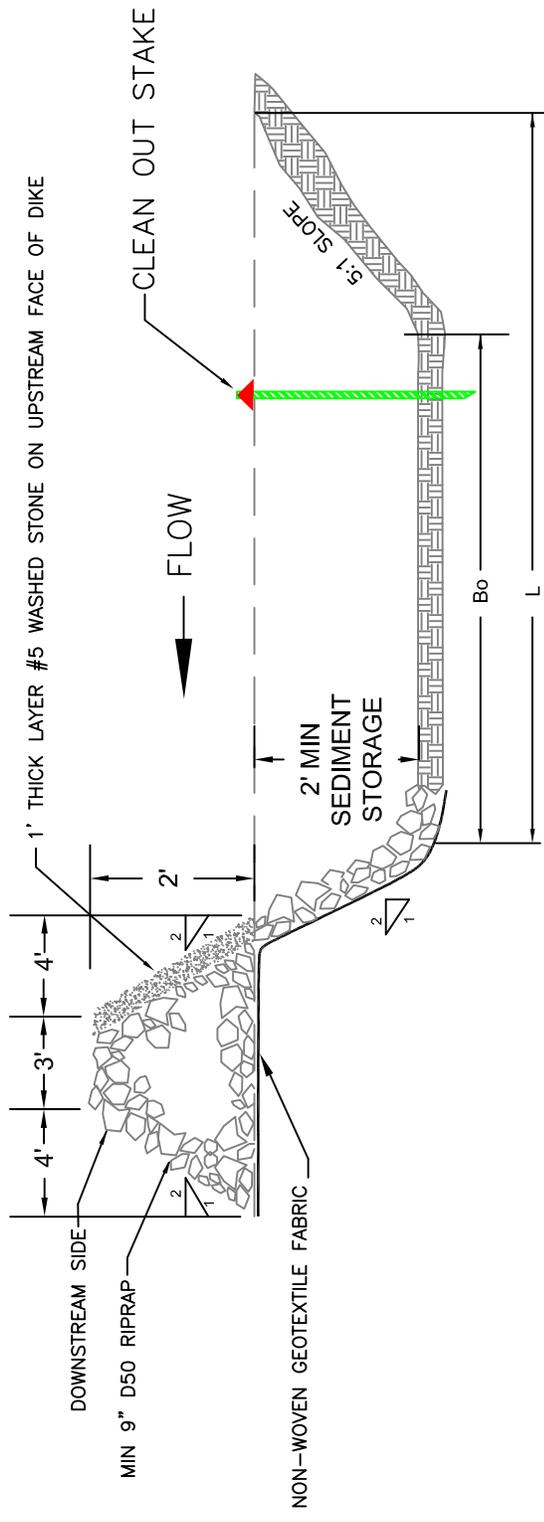

MAXIMUM 2-ACRE DRAINAGE AREA TO DIKE

**TYPICAL ROCK DIKE DIMENSIONS**

D	L	B <sub>0</sub>	PEAK FLOW (CFS)	TOTAL STORAGE VOL. (CU. FT.)	SEDIMENT STORAGE VOLUME (CU. FT.)
15'	17.5'	3.5'	24.1	838	250
20'	20.0'	6.0'	32.1	1263	406
25'	22.5'	8.5'	40.1	1766	601
30'	25.0'	11.0'	48.2	2348	836

South Carolina Department of Health and Environmental Control

ROCK SEDIMENT DIKE

STANDARD DRAWING NO. SC-12 Page 1 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

## ROCK SEDIMENT DIKE

### When and Where to Use It:

Rock sediment dikes are most effective in areas where sediment control is needed with minimal disturbance. They can be used as sediment control structures for the outfalls of diversion swales, diversion dikes, in low areas or other areas where concentrated sediment laden flow is expected. Rock sediment dikes should not be placed in Waters of the State or any other streams that have a base flow.

### Installation:

- A non-woven geotextile fabric shall be installed over the soil surface where the rock sediment dike is to be placed.
- The body of the rock sediment dike shall be composed of minimum 9-inch D50 Riprap.
- The upstream face of the rock sediment dike shall be composed of a 1-foot thick layer of 3/4-inch to 1-inch D50 washed stone placed at a slope of 2H:1V.
- Rock sediment dikes shall have a minimum top flow length of 3-feet (2-foot flow length through the riprap and 1-foot flow length through the washed stone).
- The rock must be placed by hand or mechanical placement (no dumping of rock to form the sediment dike) to achieve the proper dimensions.
- A sediment sump shall be located on the upstream side of the structure to provide sediment storage. The upstream side of the sediment sump shall have a slope of 5H:1V to inhibit erosion of the sediment storage area. The minimum depth of the sediment sump shall be 2-feet. Mark the sediment cleanout level of the sediment dike with a stake in the field.
- Seed and mulch all disturbed areas.

South Carolina Department of  
Health and Environmental Control

ROCK SEDIMENT DIKE

STANDARD DRAWING NO. SC-12 Page 2 of 3

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ DATE AUGUST, 2005

## ROCK SEDIMENT DIKE

### Inspection and Maintenance:

The key to a functional rock sediment dike is continual monitoring, regular maintenance and regular sediment removal.

Regular inspections should be done every seven (7) calendar days and within 24-hours after each rainfall event that produces  $\frac{1}{2}$ -inches or more of precipitation.

Remove sediment when it reaches 50% of the sediment storage volume or when reaches the top of cleanout stake. Removed sediment from the sump should be removed from, or stabilized on site.


All rock sediment dikes should be removed within 30 days after final site stabilization is achieved or after they are no longer needed. Disturbed areas resulting from the removal of rock sediment dikes should be permanently stabilized.

South Carolina Department of  
Health and Environmental Control

ROCK SEDIMENT DIKE

STANDARD DRAWING NO. SC-12 Page 3 of 3

APPROVED BY: \_\_\_\_\_ DATE AUGUST, 2005  
SCDHEC

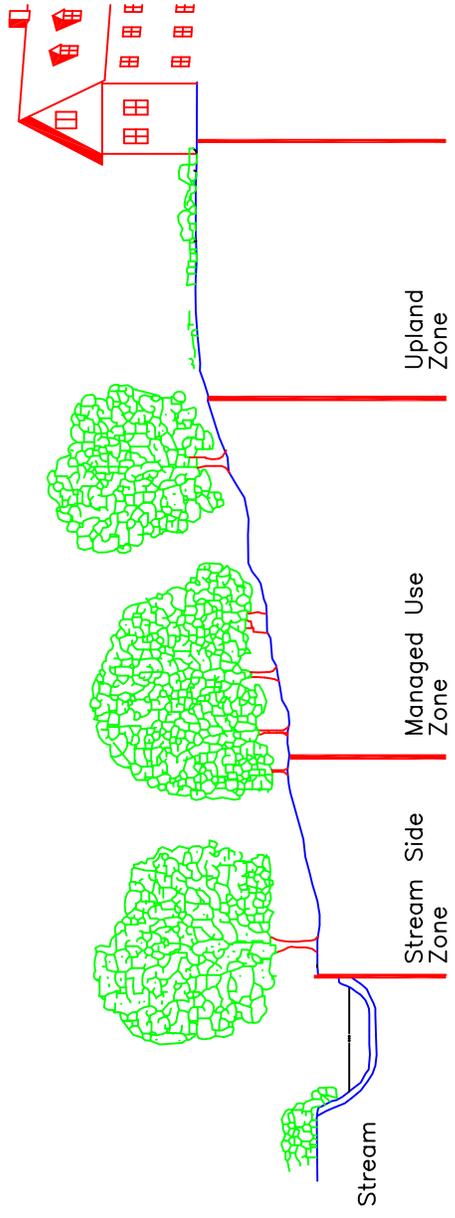

Stream Class	Stream Side Zone (ft)	Managed Use Zone (ft)	Upland Zone (ft)	Total Buffer Width on Each Side of the Stream (ft)
1	30	None	15	45
2	30	20	15	65
3	30	45	25	100

\*\* All buffer widths shall be measured from the top of the stream bank.


- Class 1: Streams that have a drainage area greater than or equal to 100 acres.
- Class 2: Streams that have a drainage area greater than or equal to 300 acres.
- Class 3: Streams that have a drainage area greater than or equal to 640 acres.

**Three Zoned Urban Stream Buffer**


STREAM BUFFER

STANDARD DRAWING NO. WQ-01 Page 1

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ DATE: AUGUST, 2005

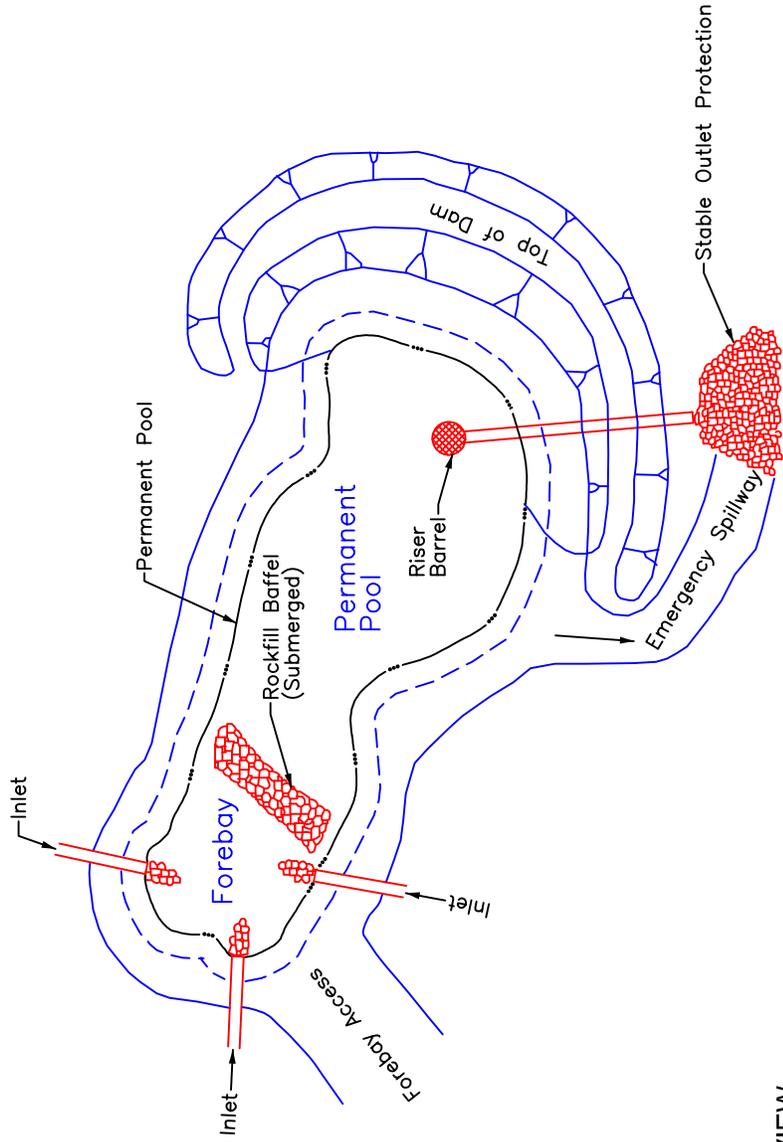

PLAN VIEW

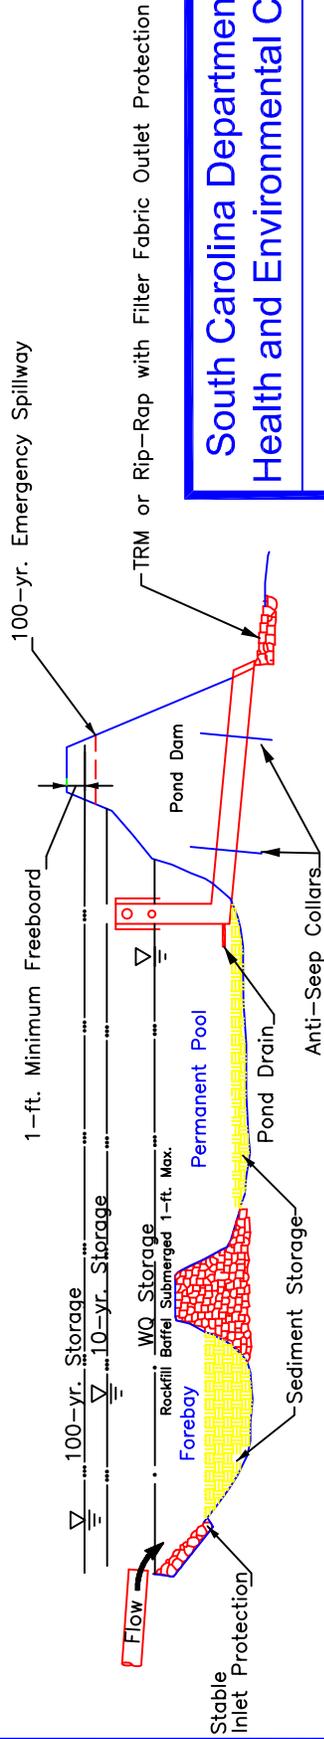

PROFILE

South Carolina Department of Health and Environmental Control

WET DETENTION POND

STANDARD DRAWING NO. WQ-02 Page 1 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC DATE: \_\_\_\_\_ AUGUST, 2005

## WET DETENTION POND

### Installation:

A forebay shall be provided for all inlets to a wet water quality pond and shall be placed upstream of the main wet pond area. The forebay is separated from the larger wet detention pond area by barriers or baffles that may be constructed of earth, stones, riprap, gabions, or geotextiles. The top of the forebay barrier shall be a maximum of one (1)-foot below the normal pool elevation, and may extend above the elevation of the permanent pool.

The permanent pool shall be four (4) to six (6) feet in depth.

Acceptable trash guards include:

Hoods that extend at least 6-inches below the permanent pool water surface elevation.

Reverse flow pipes where the outlet structure inlet is located at least 6-inches below the permanent pool water surface elevation.

Trash boxes made of sturdy wire mesh.

### Inspection and Maintenance:

The side slopes of the pond shall be mowed monthly.

Since decomposing vegetation captured in the wetpond can release pollutants, especially nutrients, it may be necessary to harvest dead vegetation annually. Otherwise the decaying vegetation can export pollutants out of the pond and also can cause nuisance conditions to occur.

Debris shall be cleared from all inlet and outlet structures monthly.

All eroded or undercut areas shall be repaired as needed.

A sediment marker shall be placed in the forebay to determine when sediment removal is required.

Sediment accumulations in the main pond area shall be monitored and sediment shall be removed when the permanent pool volume has been significantly filled and/or the pond becomes eutrophic.


South Carolina Department of  
Health and Environmental Control

WET DETENTION POND


STANDARD DRAWING NO. WQ-02 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

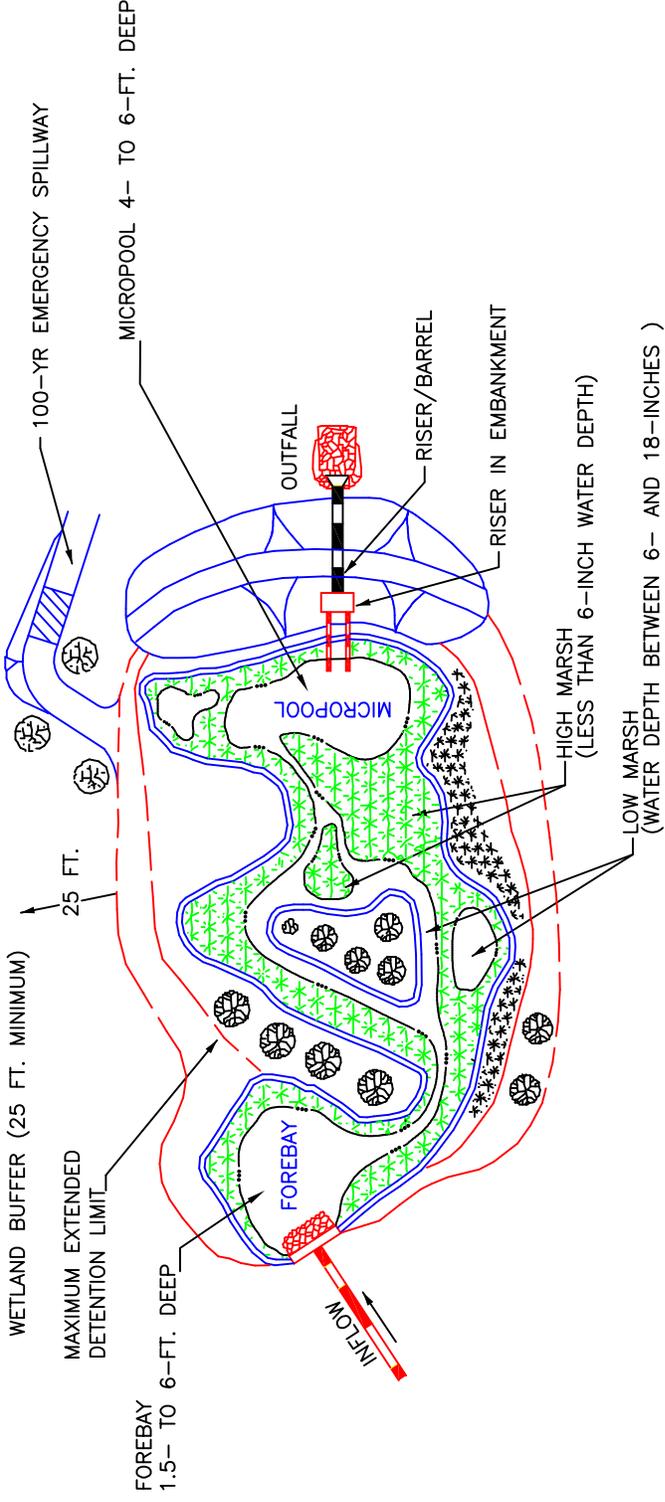

PLAN VIEW

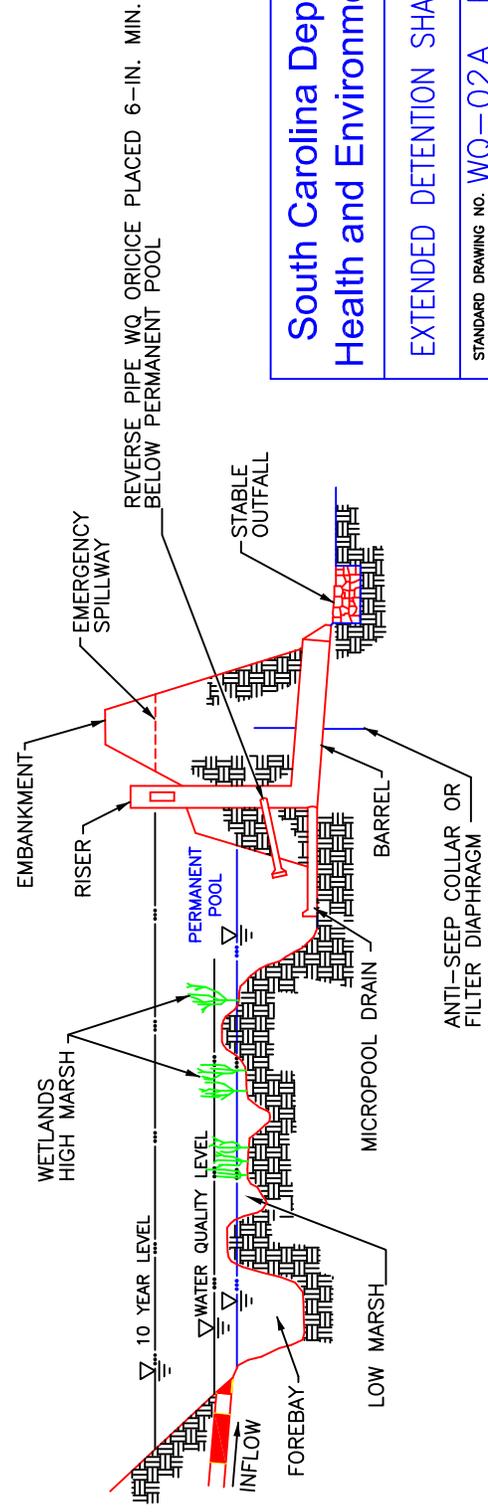

PROFILE

South Carolina Department of  
Health and Environmental Control

EXTENDED DETENTION SHALLOW WETLAND

STANDARD DRAWING NO. WQ-02A Page 1 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC DATE: AUGUST, 2005

## EXTENDED DETENTION SHALLOW WETLAND

### Installation:

One-half (1/2) of the total shallow water zone shall be designated as being a high marsh. This zone extends up from 6-inches below the permanent pool water level (6-inches deep).

One-half (1/2) of the total shallow water zone shall be designated as low marsh. This zone extends from a depth of 18- to 6-inches below the permanent pool water level.

All inlets shall discharge to the forebay, and be protected with a properly designed Turf Reinforcement Mat. The forebay shall be constructed of an earthen berm that shall be no lower than the normal permanent pool depth.

The outlet micropool shall be required to allow adequate depth for the extended detention release outlet to function properly and allow a drain to be installed to drain the wetland when needed. The outlet micropool shall be 4-6 feet deep.

The water quality orifice shall be protected from clogging by incorporating an appropriate trash guard. The trash guard selected shall be durable and extend at least six (6)-inches below the normal pool surface of the wetland.

### Inspection and Maintenance:

Maintenance requirements are particularly high while vegetation is being established. Monitoring during the first year is critical to the success of the wetland, and should be done after all storm events greater than 2-inches of rainfall to assess erosion, flow channelization and sediment accumulation. Inspection shall be made at least once every 6-months during the first 3-years of establishment.

A sediment cleanout stake shall be placed in the forebay area to determine when sediment removal is required.

Debris shall be removed from inlet and outlet structure monthly.

Wetland vegetation shall be monitored and replaced as necessary once every 6-months during the first 3-years of establishment. The depth of the zones within the wetland shall be inspected and maintained annually and invasive vegetation shall be removed annually.

Repair all eroded or undercut areas as needed.


South Carolina Department of  
Health and Environmental Control

EXTENDED DETENTION SHALLOW WETLAND


STANDARD DRAWING NO. WQ-02A Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

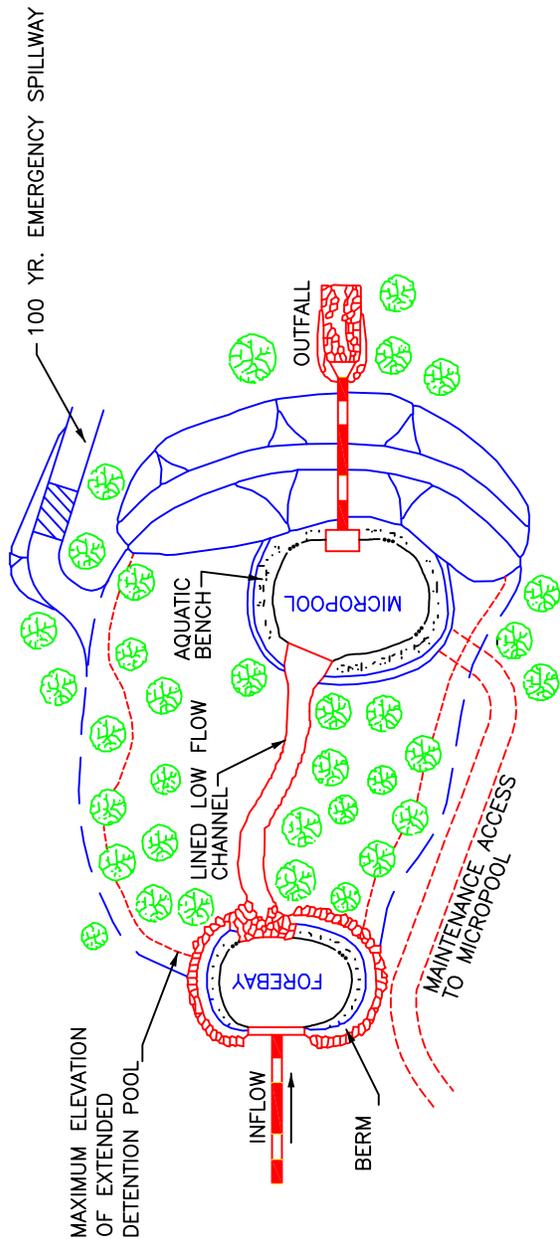

PLAN VIEW

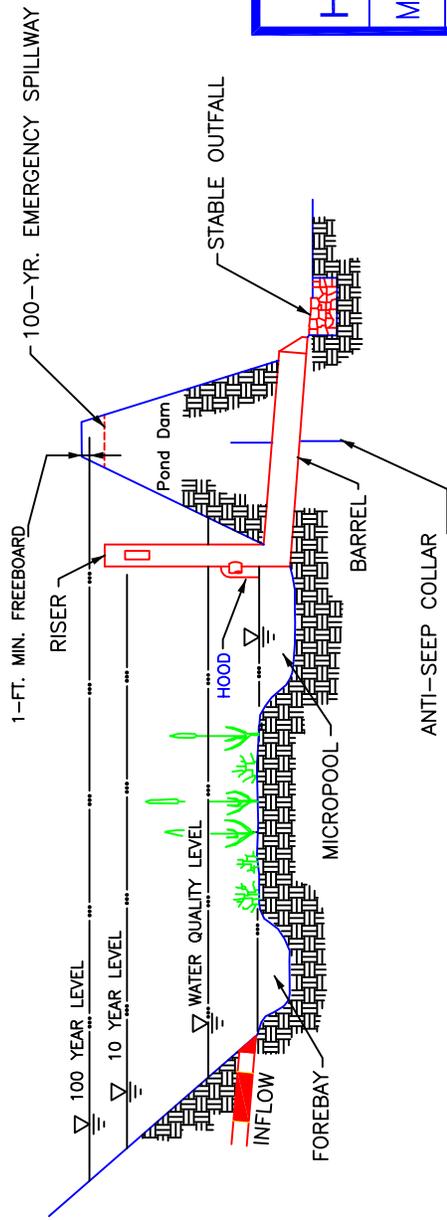

PROFILE

South Carolina Department of Health and Environmental Control

MICROPOOL EXTENDED DETENTION POND

STANDARD DRAWING NO. WQ-02B Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
 SCDHEC

## MICROPOOL EXTENDED DETENTION POND

### Installation:

A forebay shall be provided for all inlets to a micropool extended water quality pond and shall be placed upstream of the micropool area. The forebay is separated from the micropool by a berm that may be constructed of earth, stones, riprap, gabions, or geotextiles. The top of the forebay barrier shall be equal to the normal pool elevation, and may extend above the elevation of the permanent pool. A TRM lined low flow channel shall be constructed to convey flow from the forebay to the micropool area.

The micropool shall be four (4) to six (6) feet in depth.

A low flow orifice shall be installed to slowly release the water quality volume. The low flow orifice shall be protected from clogging by designing appropriate trash guards. Acceptable trash guards include:

Hoods that extend at least 6-inches below the water quality pool water surface elevation.

Reverse flow pipes where the outlet structure inlet is located at least 6-inches below the water quality water surface elevation.

Emergency spillways shall be installed to safely pass the post-development 100-year 24-hour storm event without overtopping any dam structures.

### Inspection and Maintenance:

The side slopes of the pond shall be mowed monthly.

Since decomposing vegetation captured in the wetpond can release pollutants, especially nutrients, it may be necessary to harvest dead vegetation annually. Otherwise the decaying vegetation can export pollutants out of the pond and can cause nuisance conditions to occur.

Debris shall be cleared from all inlet and outlet structures monthly.

All eroded or undercut areas shall be repaired as needed.

A sediment marker shall be placed in the forebay to determine when sediment removal is required.


Sediment accumulations in the main pond area shall be monitored and sediment shall be removed when the permanent pool volume has been significantly filled and/or the pond becomes eutrophic.

**South Carolina Department of  
Health and Environmental Control**


MICROPOOL EXTENDED DETENTION POND

STANDARD DRAWING NO. WQ-02B Page 2 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ AUGUST, 2005  
DATE

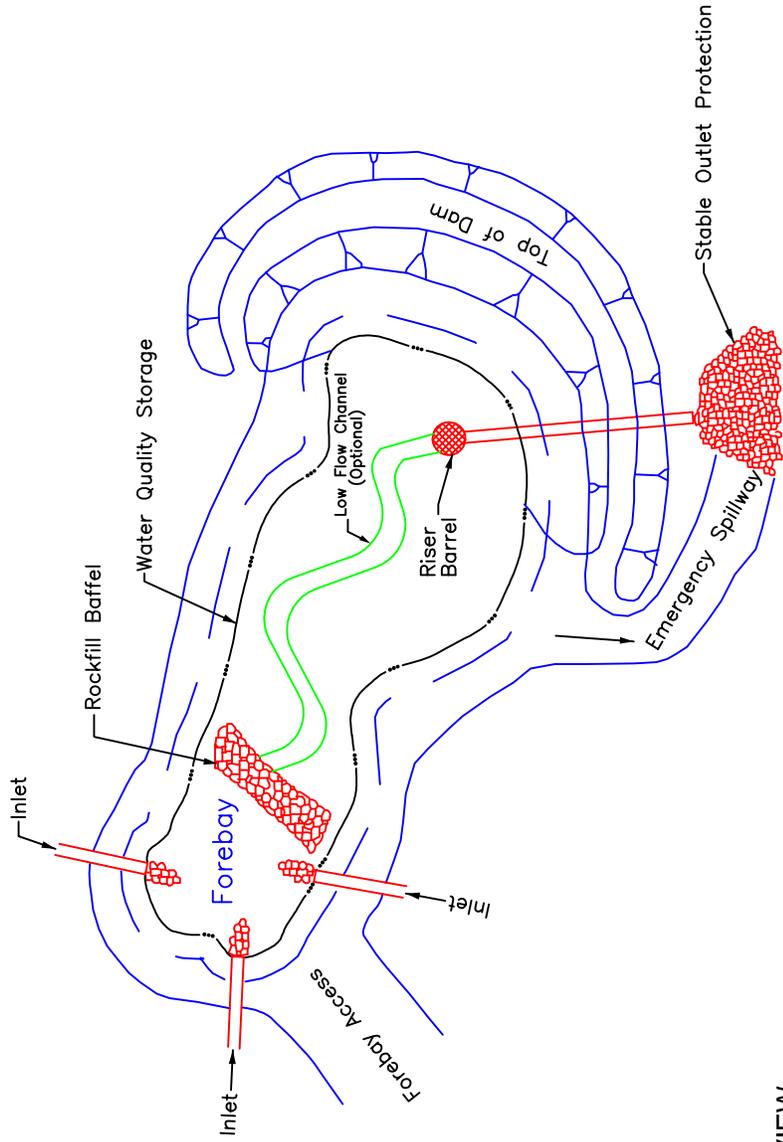

PLAN VIEW

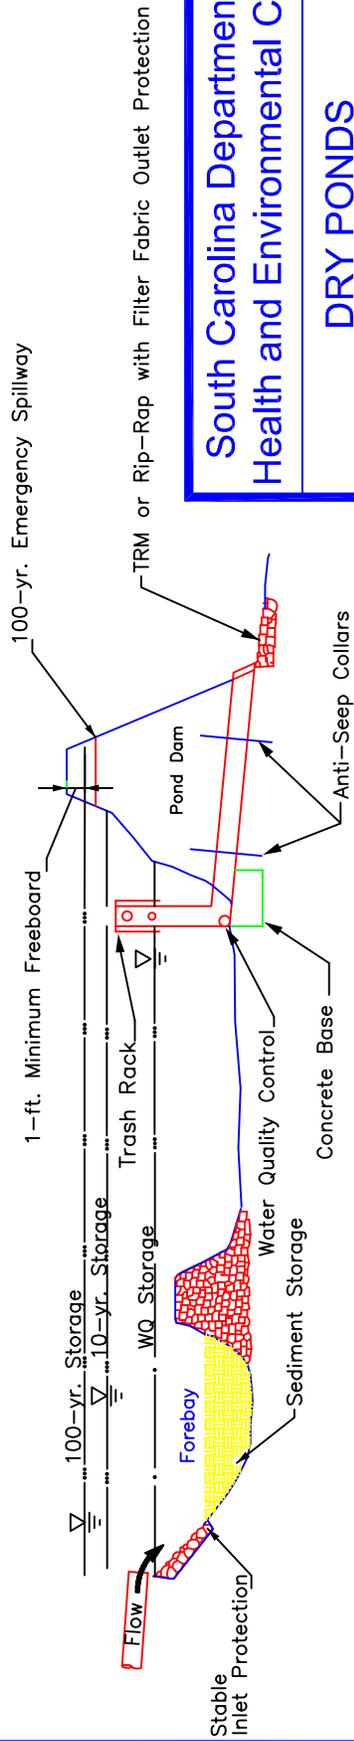

PROFILE

South Carolina Department of  
Health and Environmental Control

DRY PONDS

STANDARD DRAWING NO. WQ-03 Page 1 of 3

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ DATE: AUGUST, 2005

### Dry Storm Water Detention Ponds

Dry pond inside slopes should not be more than 3:1

The pond floor should have a minimum slope of 2% toward the outlet or underdrain system. Adequate maintenance access must be provided for all dry detention and dry ED ponds.

#### Low Flow Channel

A low flow channel should be provided to prevent standing water conditions. This channel should be protected to prevent scouring. The remainder of the pond should drain toward this channel. Where recreational uses are desired, the low-flow channel should be placed to one side instead in the middle of the pond.

#### Outfall

For a dry detention pond, the outlet structure is sized for water quality control and water quantity control (based upon hydrologic/routing calculations) and can consist of a weir, orifice, outlet pipe, combination outlet, or other acceptable control structure.

A low flow orifice capable of releasing the water quality volume over 24 hours must be provided. The water quality orifice should have a minimum diameter of 2-inches and should be adequately protected from clogging by an acceptable external trash rack.

The outfall of dry ponds should always be stabilized to prevent scour and erosion. If the pond discharges to a channel with dry weather flow, care should be taken to minimize tree clearing along the downstream channel, and to reestablish a forested riparian zone in the shortest possible distance.

#### Emergency Spillway:

An emergency spillway must be included to pass the 100-year storm event. The spillway prevents pond water levels from overtopping the embankment and causing structural damage. The spillway must be designed and installed to protect against erosion problems.


#### Anti-seep Collars:

Seepage control or anti-seep collars should be provided for all outlet pipes.


#### Inspection and Maintenance:

Regular inspection and maintenance is critical to the effective operation of dry ponds as designed. Maintenance responsibility for a pond should be vested with a responsible authority by means of a legally binding and enforceable maintenance agreement that is executed as a condition of plan approval.

Inspections should be conducted semi-annually and after significant storm events to identify potential problems early. Most maintenance efforts will need to be directed toward vegetation management and basic housekeeping practices such as removal of debris accumulations and vegetation management to ensure that the pond dewaterers completely to prevent mosquito and other habitats.

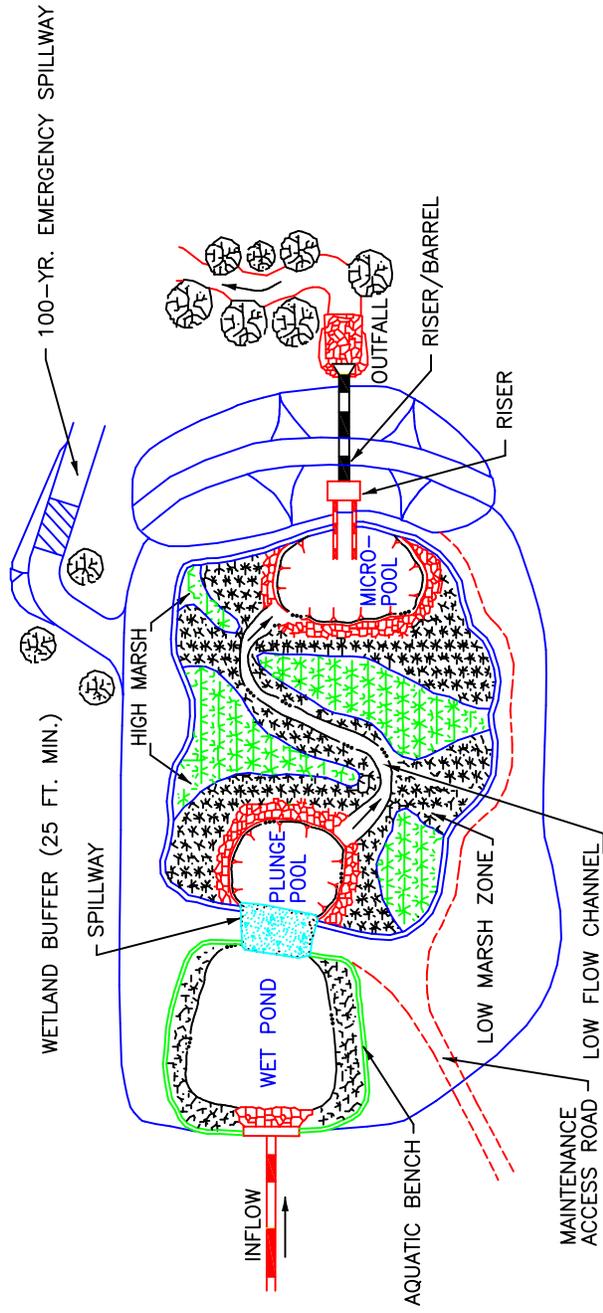

PLAN VIEW

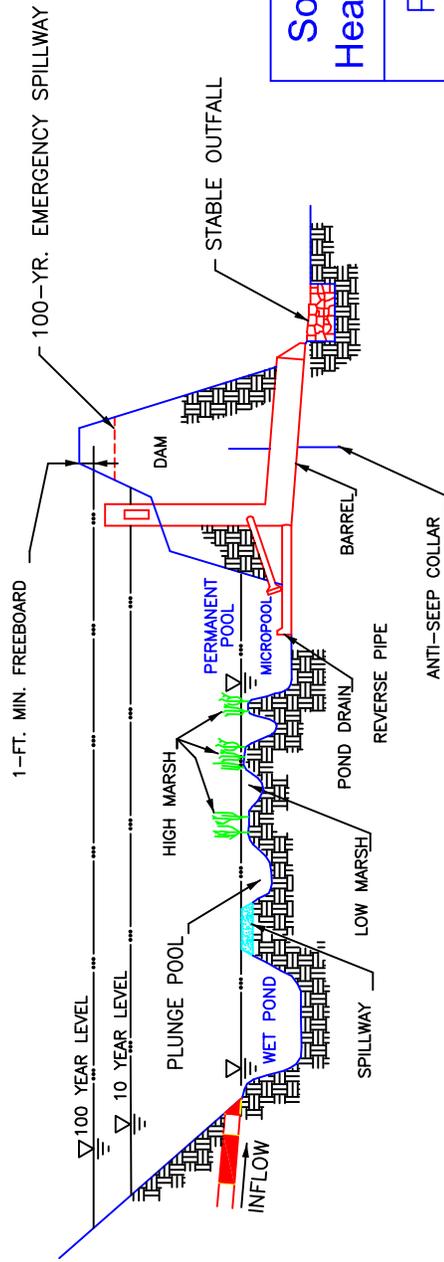

PROFILE

South Carolina Department of  
Health and Environmental Control

POND/WETLAND SYSTEM

STANDARD DRAWING NO. WQ-04 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

## POND/WETLAND SYSTEM

### Installation:

All inlets shall discharge to wet pond area, and be protected with a properly designed Turf Reinforcement Mat or other acceptable inlet protection. The wet pond shall be 4- to 6-foot deep and have a designed overflow spillway that discharges to a plunge pool. The plunge pool shall be 4- to 6-foot deep that having a lined low flow channel to convey flow from the plunge pool to the micropool area.

The outlet micropool shall be required to allow adequate depth for the extended detention release outlet to function properly and allow a drain to be installed to drain the wetland when needed. The outlet micropool shall be 4-6 feet deep.

The water quality orifice shall be protected from clogging by incorporating an appropriate trash guard. The trash guard selected shall be durable and extend at least six (6)-inches below the normal pool surface of the wetland.

A principle spillway of the constructed storm water wetland shall be installed to safely pass the 25-year 24-hour storm event. The spillway shall be equipped with a trash rack.

An emergency spillway shall be installed to safely convey discharges resulting from the 100-year 24-hour storm event.

### Inspection and Maintenance:

Maintenance requirements for constructed storm water wetlands are particularly high while vegetation is being established. Monitoring during the first year is critical to the success of the wetland. Wetlands shall be monitored after all storm events greater than 2-inches of rainfall during the first year to assess erosion, flow channelization and sediment accumulation. Inspection shall be made at least once every 6-months during the first 3-years of establishment.

A sediment cleanout stake shall be placed in the forebay area to determine when sediment removal is required.

Debris shall be removed from inlet and outlet structure monthly.

Wetland vegetation shall be monitored and replaced as necessary once every 6-months during the first 3-years of establishment. The depth of the zones within the wetland shall be inspected and maintained annually, and invasive vegetation shall be removed annually.

Repair all eroded or undercut areas as needed.

South Carolina Department of  
Health and Environmental Control



POND/WETLAND SYSTEM

STANDARD DRAWING NO. WQ-04 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

PLAN VIEW

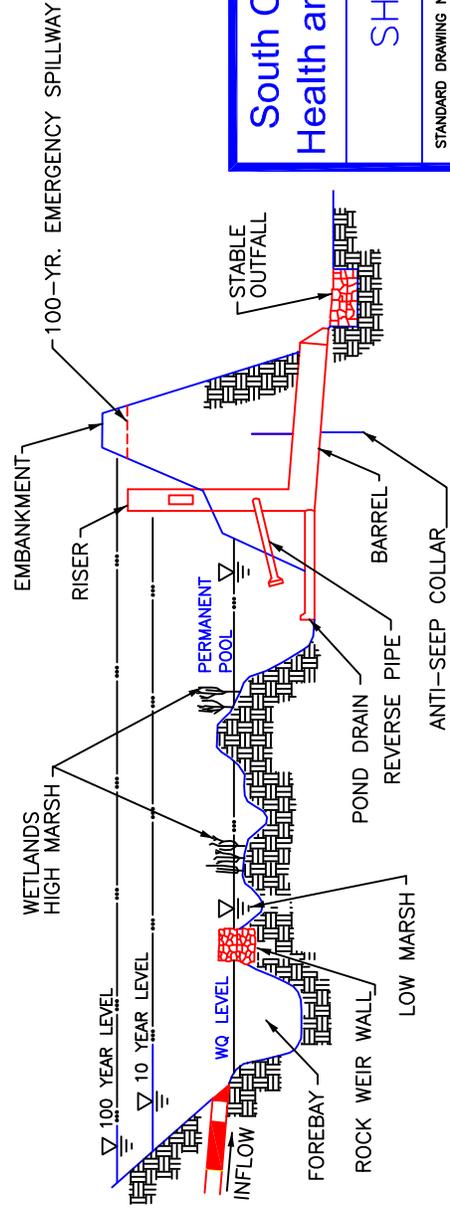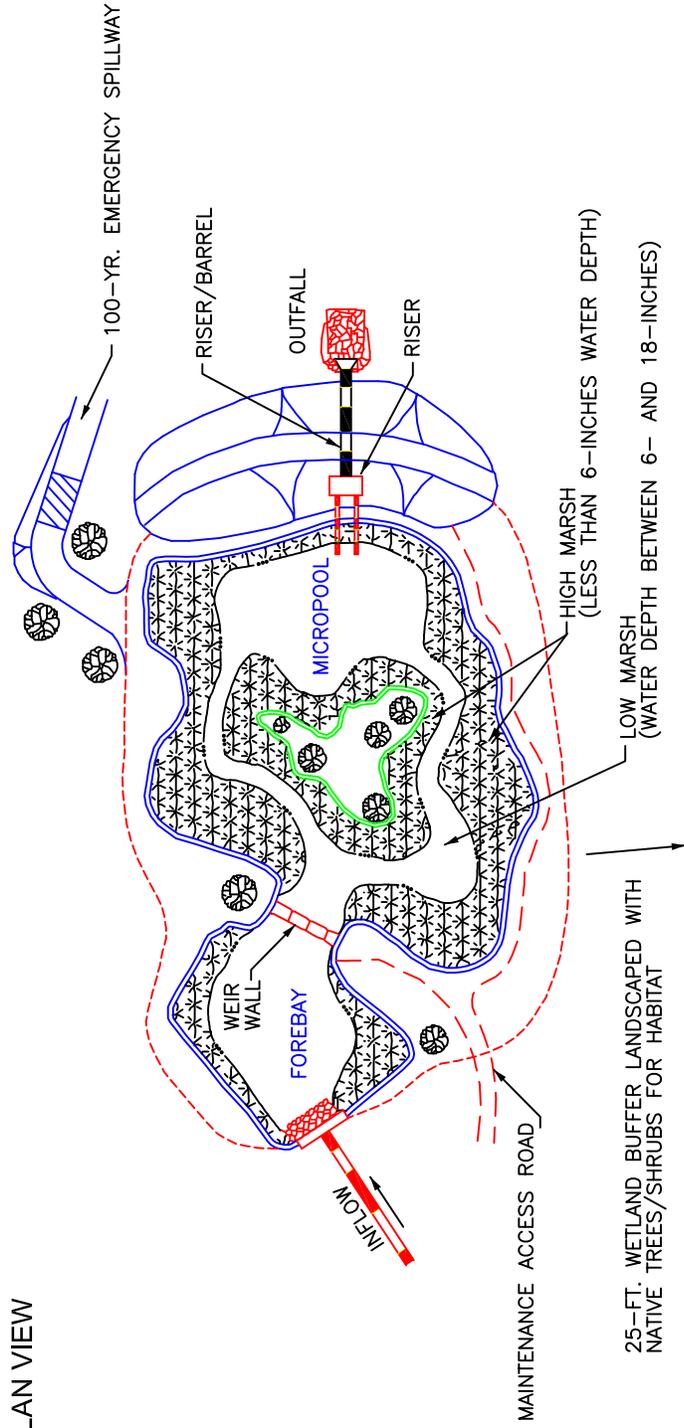

South Carolina Department of Health and Environmental Control

SHALLOW WETLAND

STANDARD DRAWING NO. WQ-04A Page 1 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC DATE: AUGUST, 2005

PROFILE

## SHALLOW WETLAND

### Installation:

All inlets shall discharge to the forebay, and be protected with a properly designed Turf Reinforcement Mat. The forebay shall be constructed of a rock berm that shall be no lower than the water quality pool depth.

The outlet micropool shall be required to allow adequate depth for the extended detention release outlet to function properly and allow a drain to be installed to drain the wetland when needed. The outlet micropool shall be 4–6 feet deep.

The water quality orifice shall be protected from clogging by incorporating an appropriate trash guard. The trash guard selected shall be durable and extend at least six (6)–inches below the normal pool surface of the wetland.

A principle spillway of the constructed storm water wetland shall be installed to safely pass the 25–year 24–hour storm event. The spillway shall be equipped with a trash rack.

An emergency spillway shall be installed to safely convey discharges resulting from the 100–year 24–hour storm event.

### Inspection and Maintenance:

Maintenance requirements for constructed storm water wetlands are particularly high while vegetation is being established. Monitoring during the first year is critical to the success of the wetland. Wetlands shall be monitored after all storm events greater than 2–inches of rainfall during the first year to assess erosion, flow channelization and sediment accumulation. Inspection shall be made at least once every 6–months during the first 3–years of establishment.

A sediment cleanout stake shall be placed in the forebay area to determine when sediment removal is required.

Debris shall be removed from inlet and outlet structure monthly.

Wetland vegetation shall be monitored and replaced as necessary once every 6–months during the first 3–years of establishment. The depth of the zones within the wetland shall be inspected and maintained annually, and invasive vegetation shall be removed annually.

Repair all eroded or undercut areas as needed.


South Carolina Department of  
Health and Environmental Control

SHALLOW WETLAND


STANDARD DRAWING NO. WQ-04A Page 2 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC

AUGUST, 2005  
DATE

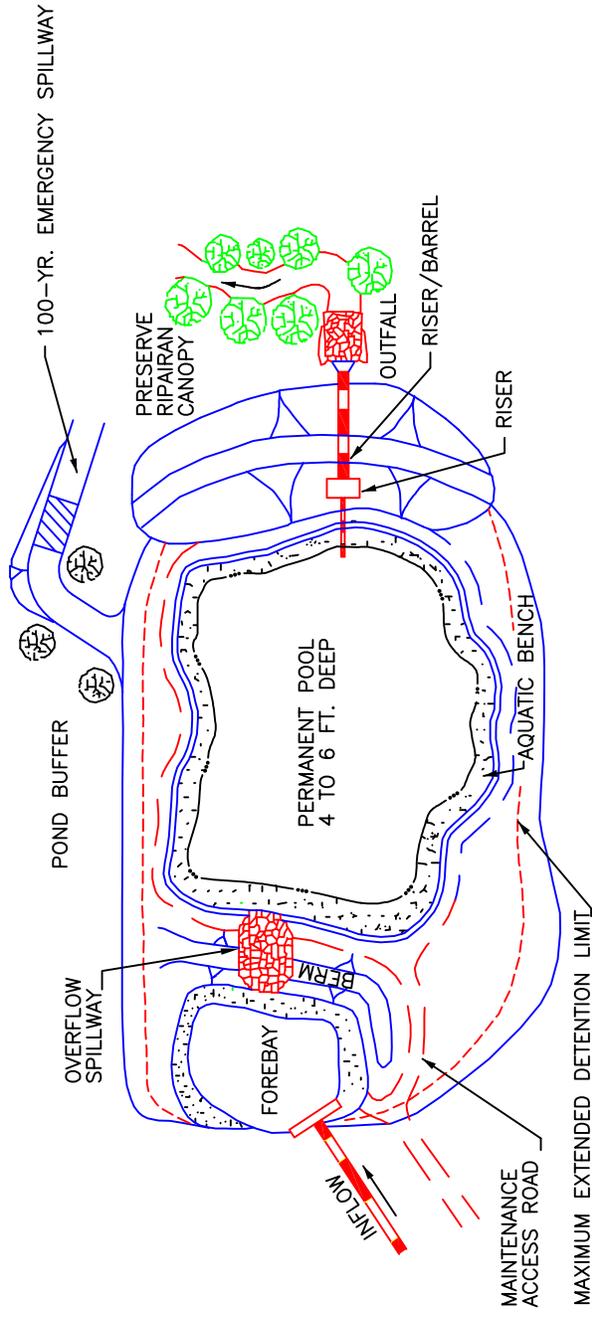

PLAN VIEW

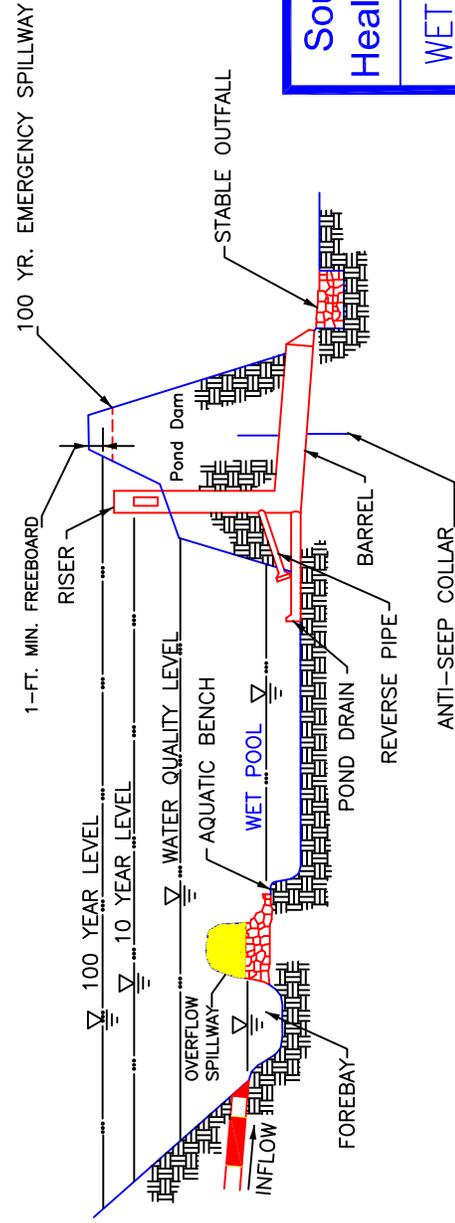

PROFILE

**South Carolina Department of  
Health and Environmental Control**

**WET EXTENDED DETENTION POND**

STANDARD DRAWING NO. WQ-04B Page 1 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC DATE: \_\_\_\_\_

## WET EXTENDED DETENTION POND

### Installation:

A forebay shall be provided for all inlets to a wet extended water quality pond and shall be placed upstream of the main wet pond area. The forebay is separated from the larger wet detention pond area by a berm that may be constructed of earth, stones, riprap, gabions, or geotextiles. The top of the forebay barrier shall be equal to the normal pool elevation, and may extend above the elevation of the permanent pool. A spillway shall be constructed to convey flow from the forebay to the wet detention pond area.

A low flow orifice shall be installed to slowly release the water quality volume. The low flow orifice shall be protected from clogging by designing appropriate trash guards. Acceptable trash guards include:

- Hoods that extend at least 6-inches below the permanent pool water surface elevation.

- Reverse flow pipes where the outlet structure inlet is located at least 6-inches below the permanent pool water surface elevation.

- Trash boxes made of sturdy wire mesh.

Emergency spillways shall be installed to safely pass the post-development 100-year 24-hour storm event without overtopping any dam structures.

### Inspection and Maintenance:

The side slopes of the pond shall be mowed monthly.

Since decomposing vegetation captured in the wetpond can release pollutants, especially nutrients, it may be necessary to harvest dead vegetation annually. Otherwise the decaying vegetation can export pollutants out of the pond and also can cause nuisance conditions to occur.

Debris shall be cleared from all inlet and outlet structures monthly.

All eroded or undercut areas shall be repaired as needed.

A sediment marker shall be placed in the forebay to determine when sediment removal is required.

Sediment accumulations in the main pond area shall be monitored and sediment shall be removed when the permanent pool volume has been significantly filled and/or the pond becomes eutrophic.


South Carolina Department of  
Health and Environmental Control

WET EXTENDED DETENTION POND


STANDARD DRAWING NO. WQ-04B Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

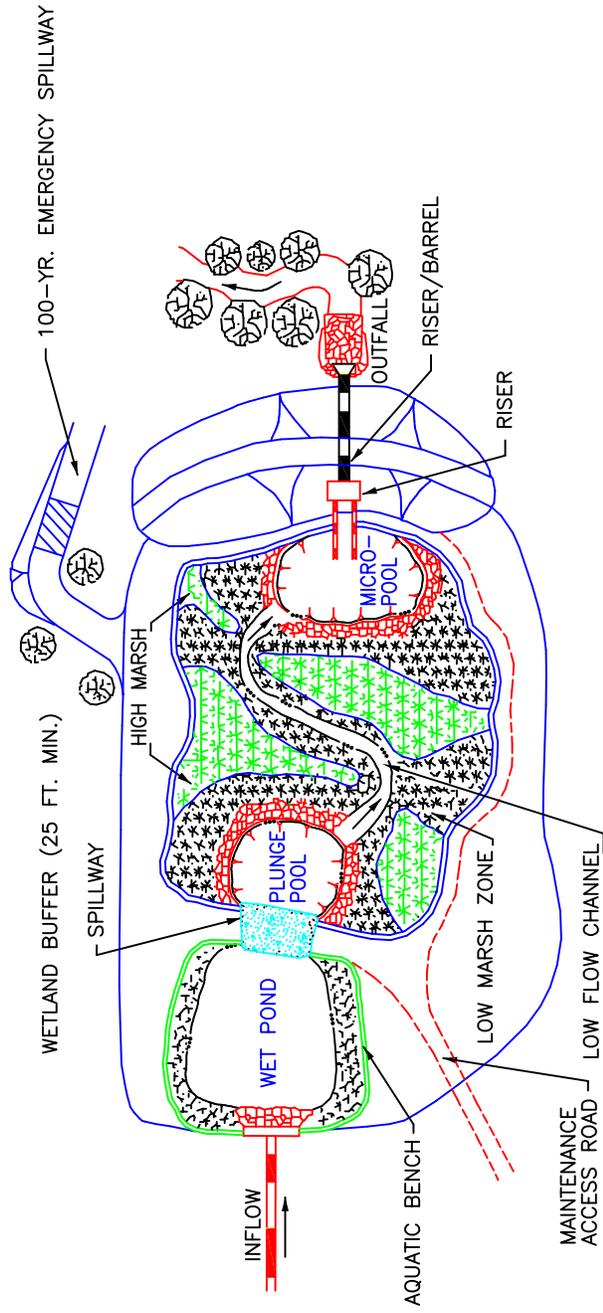

PLAN VIEW

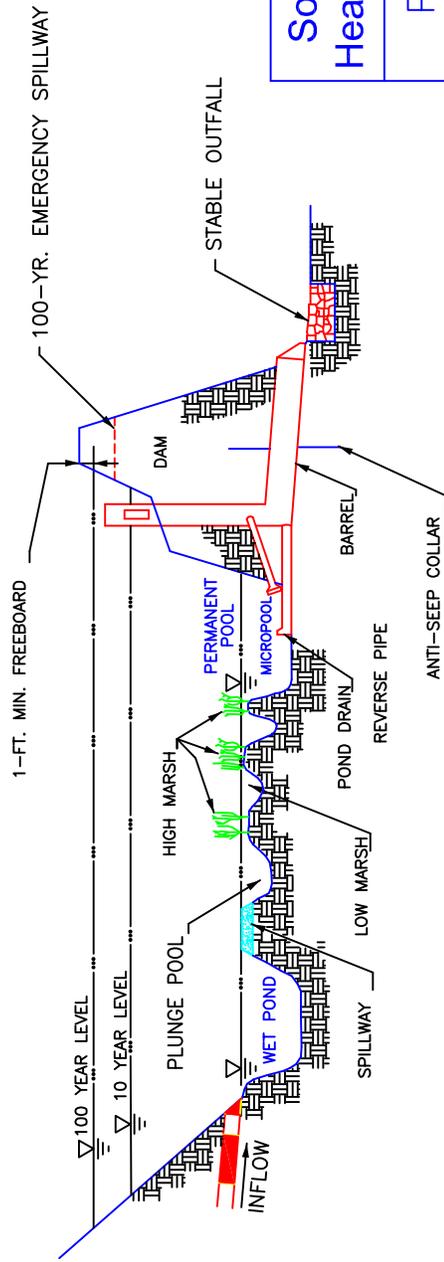

PROFILE

South Carolina Department of  
Health and Environmental Control

POND/WETLAND SYSTEM

STANDARD DRAWING NO. WQ-04C Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

## POND/WETLAND SYSTEM

### When and Where to Use It

The system has two separate cells, a wet pond and a shallow marsh. The wet pond is designed to trap sediment and reduce runoff velocities before the runoff enters the shallow marsh. The primary water quality benefits are achieved in the shallow wetland. Less land is required for the pond/wetland system than the shallow wetland and the extended detention shallow wetland.

### Installation:

One-half ( $\frac{1}{2}$ ) of the total shallow water zone shall be high marsh. This zone extends up from 6-inches below the permanent pool water level (6-in deep).

One-half ( $\frac{1}{2}$ ) of the total shallow water zone shall be low marsh. This zone extends from a depth of 18- to 6-inches below the permanent pool water level.

All inlets shall discharge to wet pond area, and be protected with a properly designed Turf Reinforcement Mat or other acceptable inlet protection. The wet pond shall be 4- to 6-feet deep and have a designed overflow spillway that discharges to a plunge pool. The plunge pool shall be 4- to 6-feet deep that having a lined low flow channel to convey flow from the plunge pool to the micropool area.

The outlet micropool shall be required to allow adequate depth for the extended detention release outlet to function properly and allow a drain to be installed to drain the wetland when needed. The outlet micropool shall be 4-6 feet deep.

The water quality orifice shall be protected from clogging by incorporating an appropriate trash guard. The trash guard selected shall be durable and extend at least six (6)-inches below the normal pool surface of the wetland.

A principle spillway of the constructed storm water wetland shall be installed to safely pass the 10-year 24-hour storm event. The spillway shall be equipped with a trash rack.

An emergency spillway shall be installed to safely convey discharges resulting from the 100-year 24-hour storm event.

### Inspection and Maintenance:

Maintenance requirements for constructed storm water wetlands are particularly high while vegetation is being established. Monitoring during the first year is critical to the success of the wetland. Wetlands shall be monitored after all storm events greater than 2-inches of rainfall during the first year to assess erosion, flow channelization and sediment accumulation. Inspection shall be made at least once every 6-months during the first 3-years of establishment.

A sediment cleanout stake shall be placed in the forebay area to determine when sediment removal is required.

Debris shall be removed from inlet and outlet structure monthly.

Wetland vegetation shall be monitored and replaced as necessary once every 6-months during the first 3-years of establishment. The depth of the zones within the wetland shall be inspected and maintained annually, and invasive vegetation shall be removed annually.

Repair all eroded or undercut areas as needed.


South Carolina Department of  
Health and Environmental Control

POND/WETLAND SYSTEM

STANDARD DRAWING NO. WQ-04C Page 2 of 2


APPROVED BY: \_\_\_\_\_ SCDHEC

AUGUST, 2005  
DATE

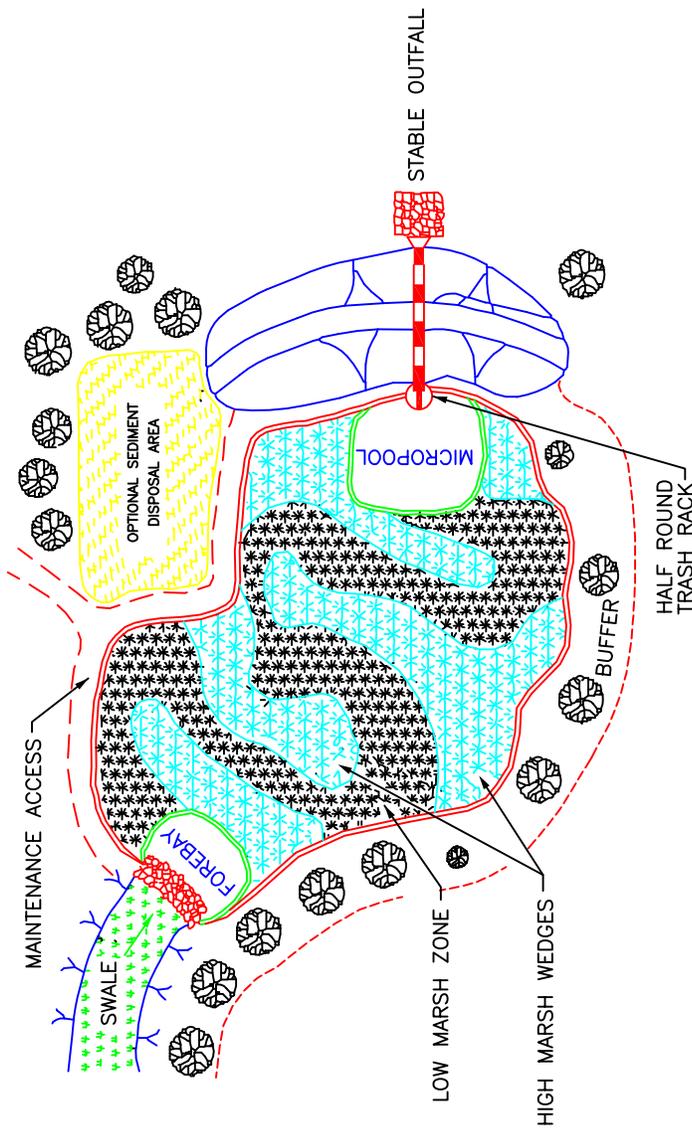

PLAN VIEW

100-YR. EMERGENCY SPILLWAY

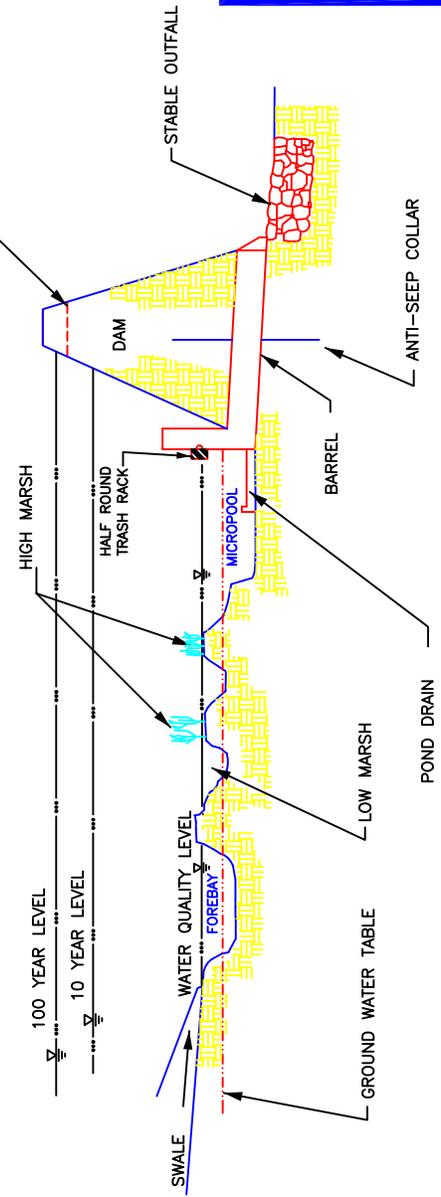

PROFILE

South Carolina Department of  
Health and Environmental Control

POCKET WETLAND

STANDARD DRAWING NO. WQ-04D Page 1 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC DATE: \_\_\_\_\_ AUGUST, 2005

## POCKET WETLAND

### Installation:

One-half ( $\frac{1}{2}$ ) of the total shallow water zone shall be designated as being a high marsh. This zone extends up from 6-inches below the permanent pool water level (6-inches deep).

One-half ( $\frac{1}{2}$ ) of the total shallow water zone shall be low marsh. This zone extends from a depth of 18- to 6-inches below the permanent pool water level.

All inlets shall discharge to forebay through open vegetated swales. The forebay is separated from the pocket wetland area by barriers or baffles that may be constructed of earth, stones, riprap, gabions, or geotextiles. The top of the forebay shall be equal to or may extend above the water quality permanent pool elevation.

The outlet micropool shall be required to allow adequate depth for the extended detention release outlet to function properly and allow a drain to be installed to drain the wetland when needed. The outlet micropool shall be 4- to 6-foot deep.

The water quality orifice shall be protected from clogging by incorporating an appropriate trash guard. The trash guard selected shall be durable and extend at least six (6)-inches below the normal pool surface of the micropool.

A principle spillway of the constructed storm water wetland shall be installed to safely pass the 10-year 24-hour storm event. The spillway shall be equipped with a trash rack.

An emergency spillway shall be installed to safely convey discharges resulting from the 100-year 24-hour storm event.

### Inspection and Maintenance:

Maintenance requirements for constructed storm water wetlands are particularly high while vegetation is being established. Monitoring during the first year is critical to the success of the wetland. Wetlands shall be monitored after all storm events greater than 2-inches of rainfall during the first year to assess erosion, flow channelization and sediment accumulation. Inspection shall be made at least once every 6-months during the first 3-years of establishment.

A sediment cleanout stake shall be placed in the forebay area to determine when sediment removal is required.

Debris shall be removed from inlet and outlet structure monthly.

Wetland vegetation shall be monitored and replaced as necessary once every 6-months during the first 3-years of establishment. The depth of the zones within the wetland shall be inspected and maintained annually, and invasive vegetation shall be removed annually.

Repair all eroded or undercut areas as needed.


South Carolina Department of  
Health and Environmental Control

POCKET WETLAND

STANDARD DRAWING NO. WQ-04D Page 2 of 2

APPROVED BY: \_\_\_\_\_ SCDHEC

AUGUST, 2005  
DATE

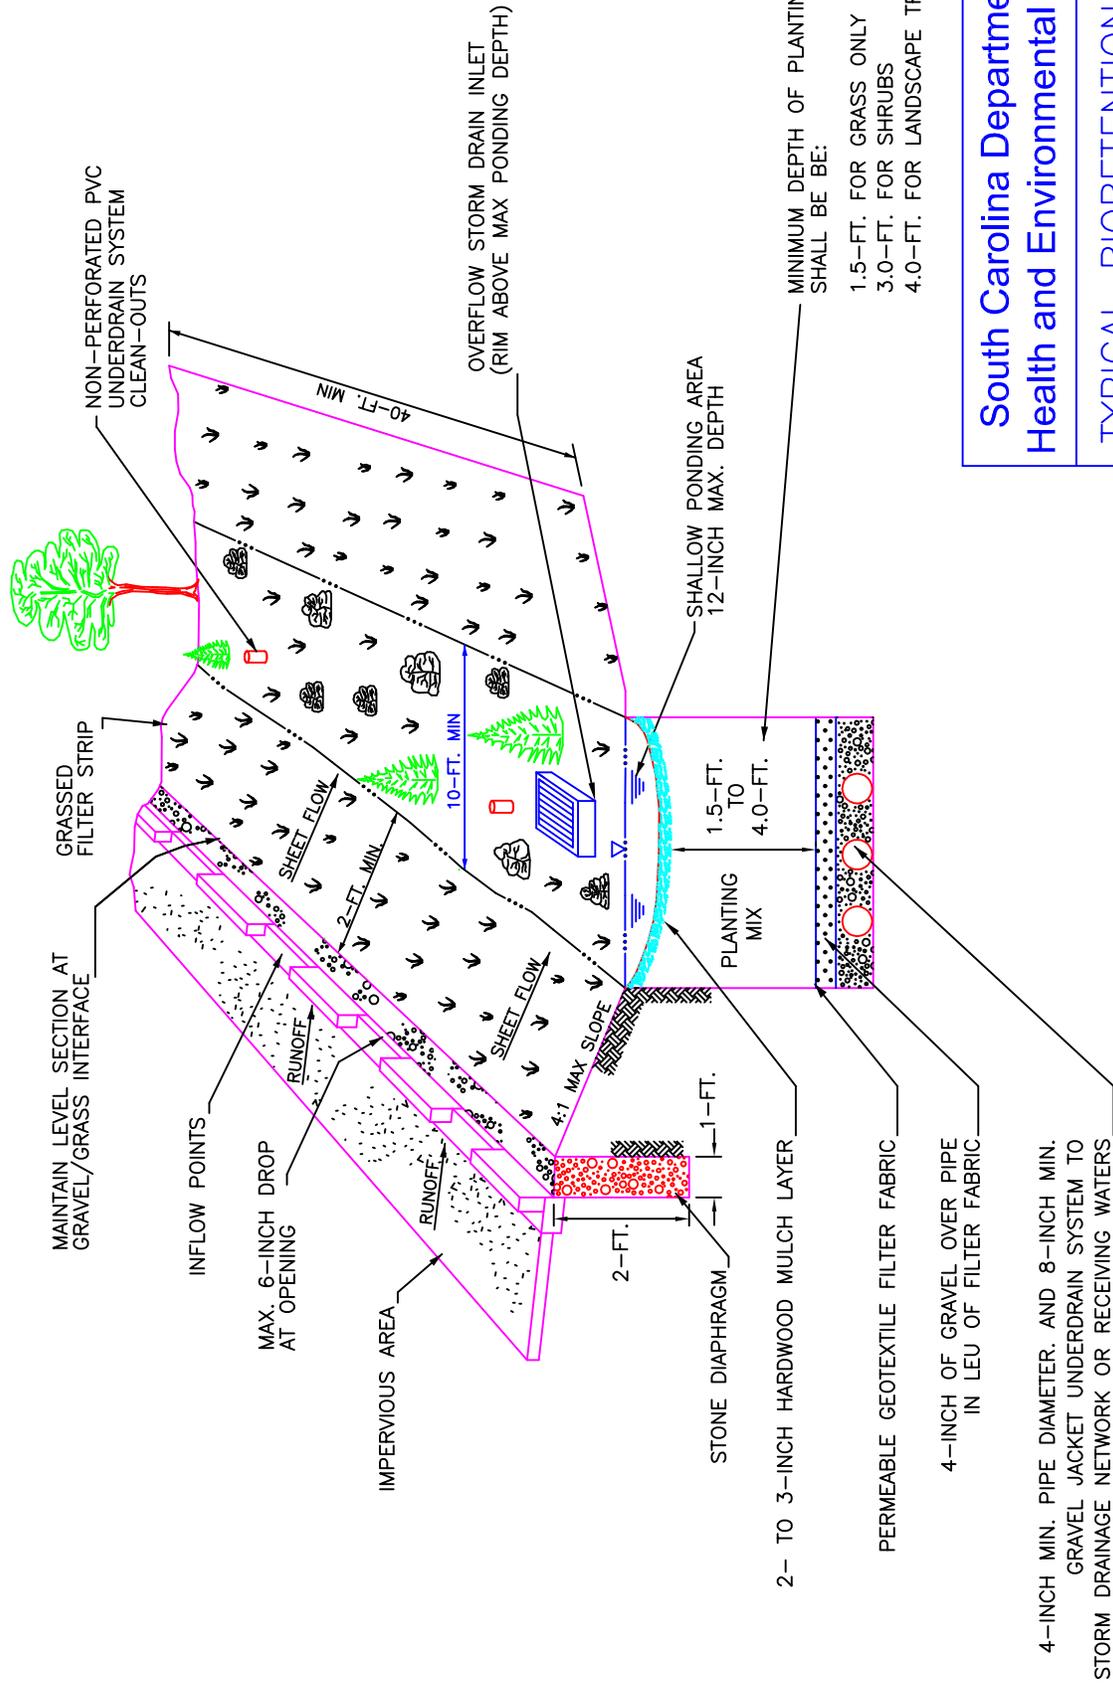

MAINTAIN LEVEL SECTION AT GRAVEL/GRASS INTERFACE

INFLOW POINTS

MAX. 6-INCH DROP AT OPENING

IMPERVIOUS AREA

2-FT.

1-FT.

4:1 MAX SLOPE

STONE DIAPHRAGM

2- TO 3-INCH HARDWOOD MULCH LAYER

PERMEABLE GEOTEXTILE FILTER FABRIC

4-INCH OF GRAVEL OVER PIPE IN LEU OF FILTER FABRIC

4-INCH MIN. PIPE DIAMETER AND 8-INCH MIN. GRAVEL JACKET UNDERDRAIN SYSTEM TO STORM DRAINAGE NETWORK OR RECEIVING WATERS

GRASSED FILTER STRIP

NON-PERFORATED PVC UNDERDRAIN SYSTEM CLEAN-OUTS

SHEET FLOW

2-FT. MIN

10-FT. MIN

40-FT. MIN

OVERFLOW STORM DRAIN INLET (RIM ABOVE MAX PONDING DEPTH)


SHALLOW PONDING AREA 12-INCH MAX. DEPTH

1.5-FT. TO 4.0-FT.


MINIMUM DEPTH OF PLANTING MIX SHALL BE BE:

- 1.5-FT. FOR GRASS ONLY
- 3.0-FT. FOR SHRUBS
- 4.0-FT. FOR LANDSCAPE TREES

SOURCE: ADAPTED FROM PRINCE GEORGE'S COUNTY DESIGN MANUAL FOR THE USE OF BIORETENTION IN STORMWATER MANAGEMENT, 1993

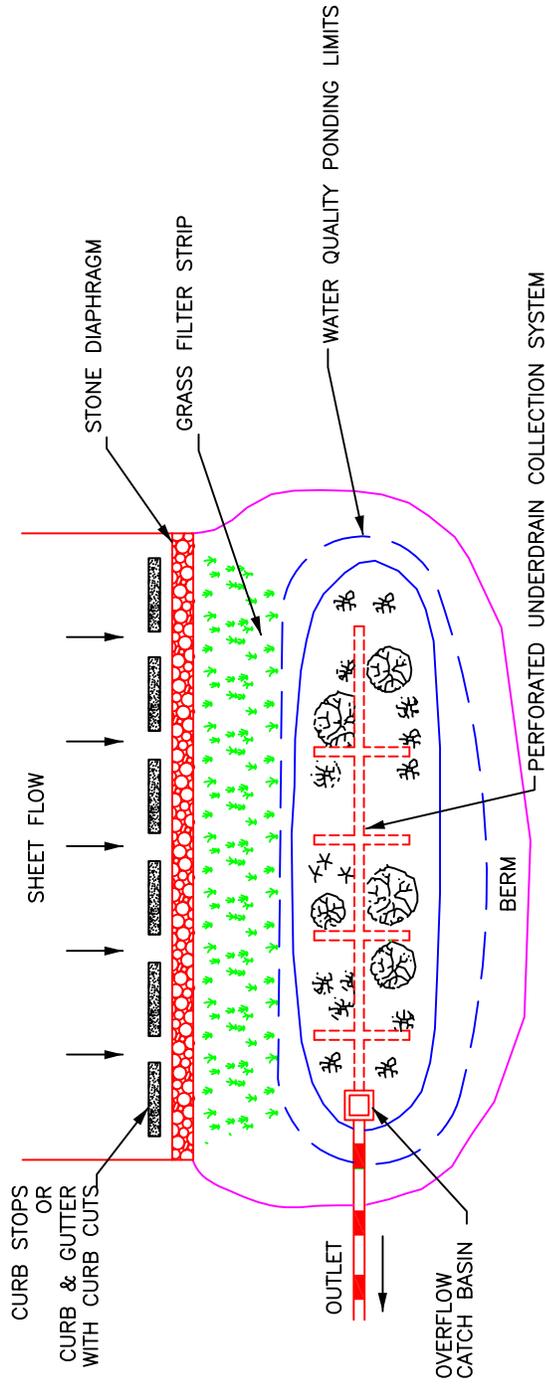

PLAN VIEW

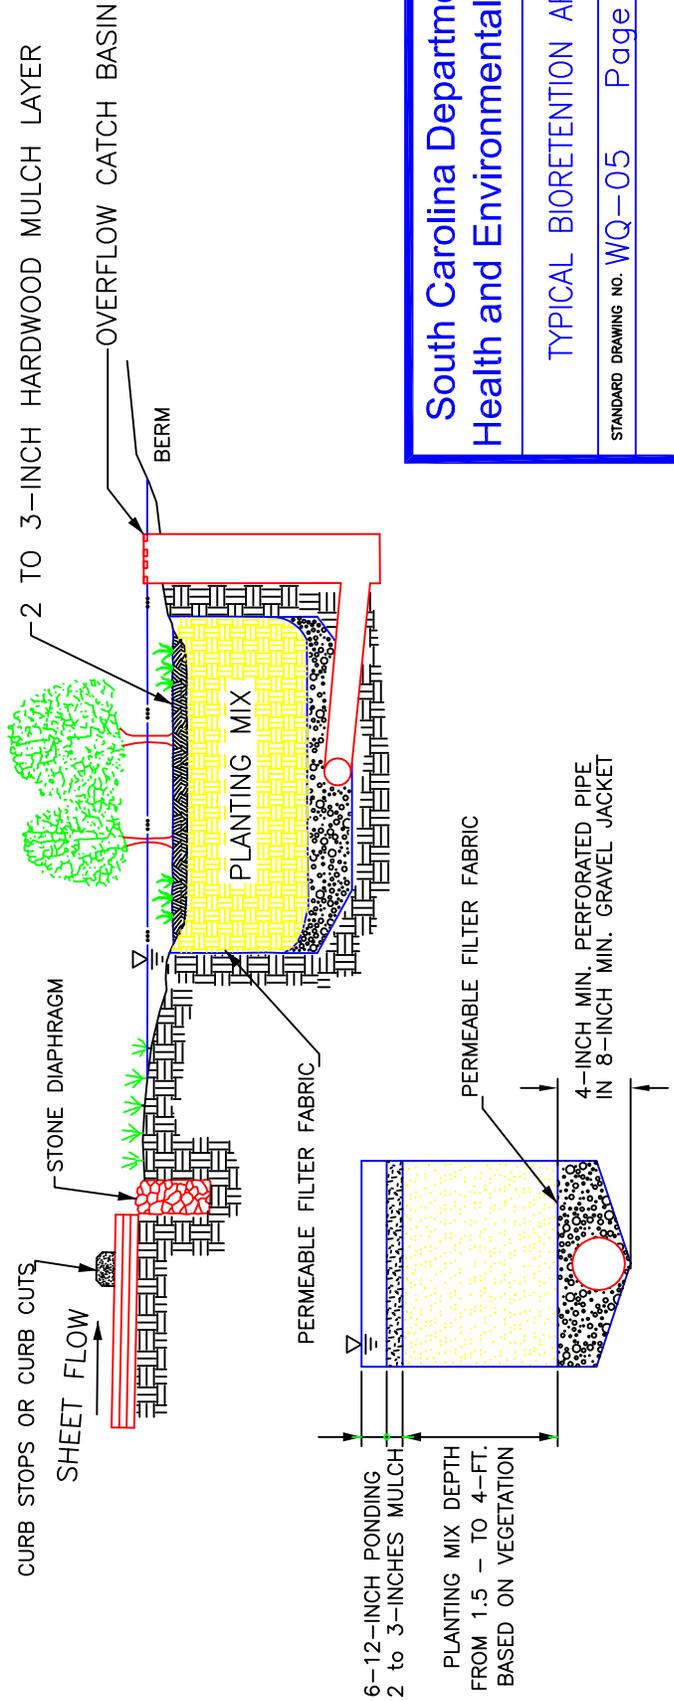

TYPICAL SECTION

South Carolina Department of Health and Environmental Control

TYPICAL BIORETENTION AREA

STANDARD DRAWING NO. WQ-05 Page 2 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
 SCDHEC

## TYPICAL BIORETENTION AREA

### Installation:

The minimum width of the bioretention area shall be ten (10)–feet and the minimum length shall be forty (40)–feet.

The planting mix should be approximately 65–75% sand, 25% silt or topsoil, and 10% organic or leaf compost. The maximum clay content shall be less than 10%. The minimum depth of the planting mix shall be based on the following:

- 1.5–feet for grass only bioretention areas,
- 3.0–feet for bioretention areas that utilize shrubs, and
- 4.0–feet for bioretention areas that utilize trees.

### Inspection and Maintenance:

Regular inspection and maintenance is critical to the effective operation of bioretention areas as designed. Maintenance responsibility of the bioretention area shall be vested with a responsible authority by means of a legally binding and enforceable maintenance agreement that is executed as a condition of plan approval.

The surface of the ponding area may become clogged with fine sediments over time. Core aeration or cultivating unvegetated areas may be required to ensure adequate filtration.

Other required maintenance includes but is not limited to:


- Pruning and weeding to maintain appearance shall be done periodically as needed.
- Hardwood mulch shall be replaced or replenished 2–to 3–inches thick periodically as needed.
- Trash and debris shall be removed periodically as needed.

South Carolina Department of  
Health and Environmental Control

TYPICAL BIORETENTION AREA

STANDARD DRAWING NO. WQ-05 Page 3 of 3

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

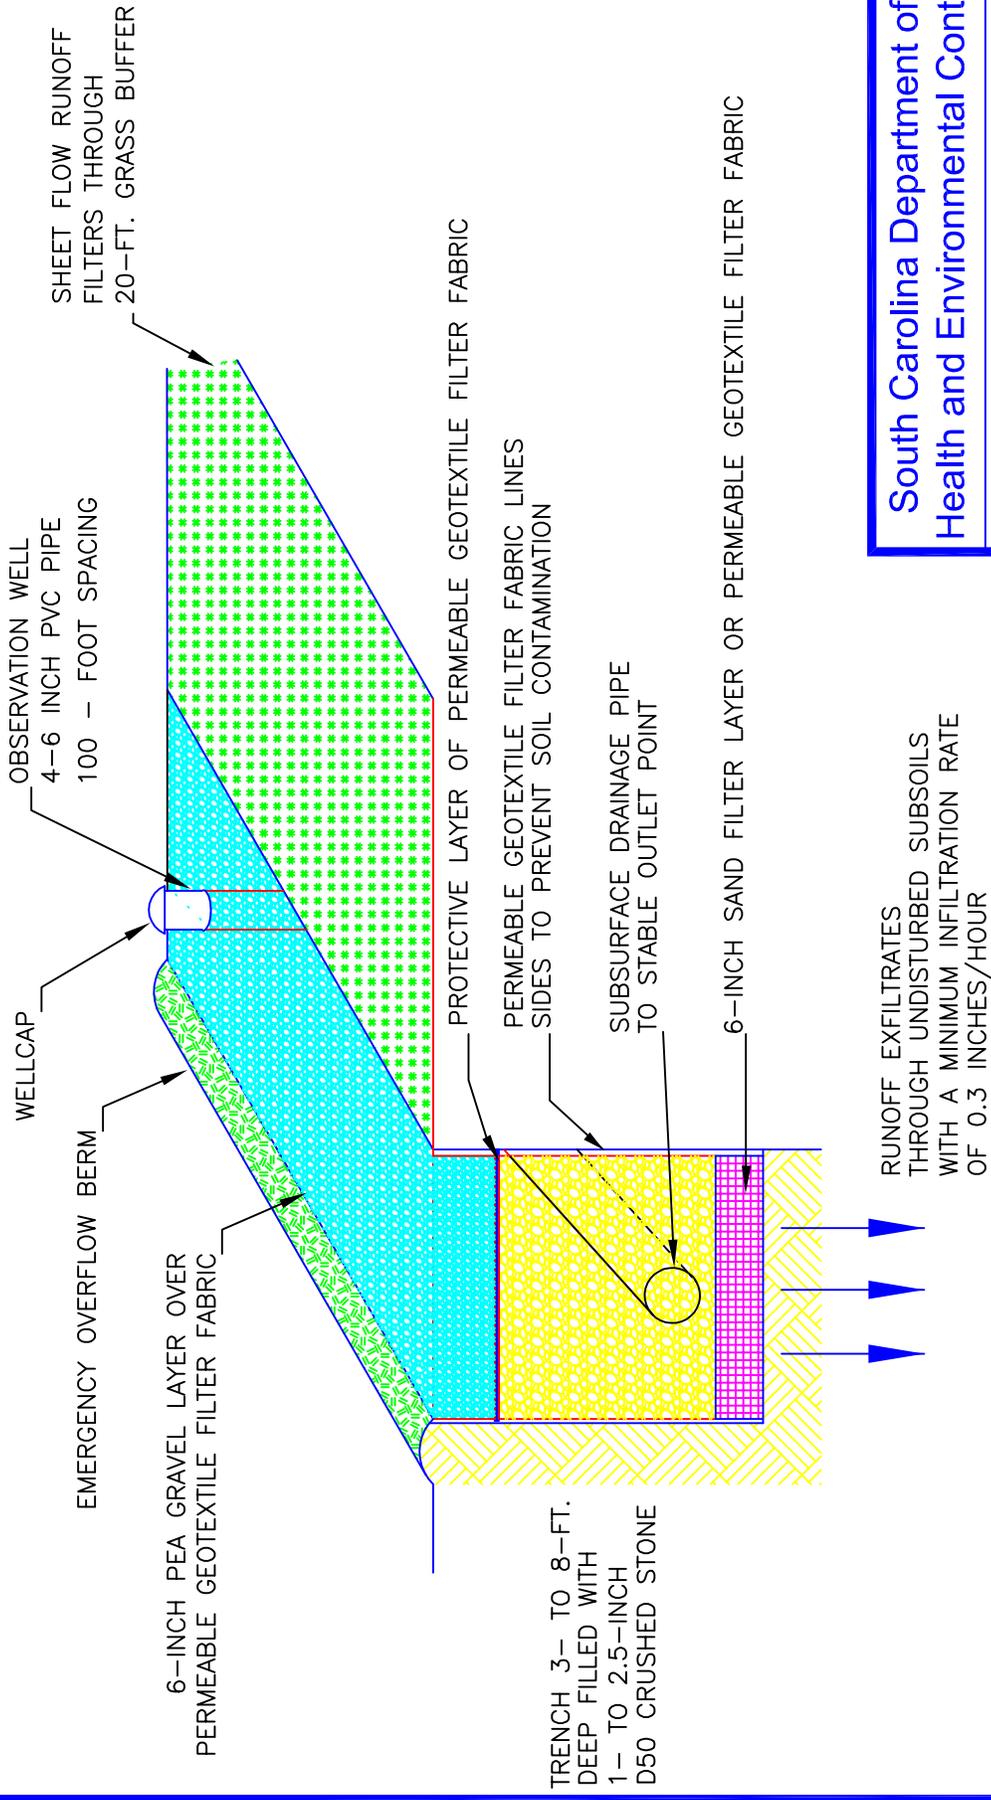

SCHEMATIC OF AN INFILTRATION TRENCHES

## INFILTRATION TRENCH

### Installation:

A 6-inch sand filter shall be located on the bottom of the trench.

The stone fill media shall consist of 1.0- to 2.5- inch D50 crushed stone with 6-inches of pea gravel located on top separated by a permeable filter fabric. This filter fabric prevents should be easily separated from the geotextiles that protect the sides of the excavated trench.

Observation wells a maximum of 100-ft apart shall be installed in every infiltration trench and shall be made of 4- to 6-inch PVC pipe. The well shall extend to the bottom of the trench. The observation well shall be installed along the centerline of the trench, and be flush with the ground elevation of the trench. The top of the well shall be capped and locked to discourage vandalism and tampering.

### Inspection and Maintenance:

Regular inspection and maintenance is critical to the effective operation of infiltration trenches as designed. Maintenance responsibility shall be vested with a responsible authority by means of a legally binding and enforceable maintenance agreement that is executed as a condition of the Storm Water Management Permit approval.

A record shall be kept of the average de-watering time of the infiltration trench to determine if maintenance is required.

The top 6-inch layer of pea gravel and the geotextile separating the pea gravel from the stone media serve as a sediment barrier and will be required to be replaced when full of sediment.

Debris and trash shall be cleared from all inlet and outlet structures monthly.

The observation well shall be checked following 72 hours (3-days) of dry weather after a rainfall event. If complete de-watering is not observed, there may clogging and proper maintenance shall be performed.

Trees, shrubs, or invasive vegetation shall be removed semi-annually.

If complete failure is observed, total rehabilitation of the trench shall be performed by excavating the trench walls to expose clean soil, and replacing the sand, filter media, gravel, and geotextiles.

South Carolina Department of  
Health and Environmental Control


INFILTRATION TRENCH

STANDARD DRAWING NO. WQ-06 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005


SCDHEC

**PLAN VIEW**

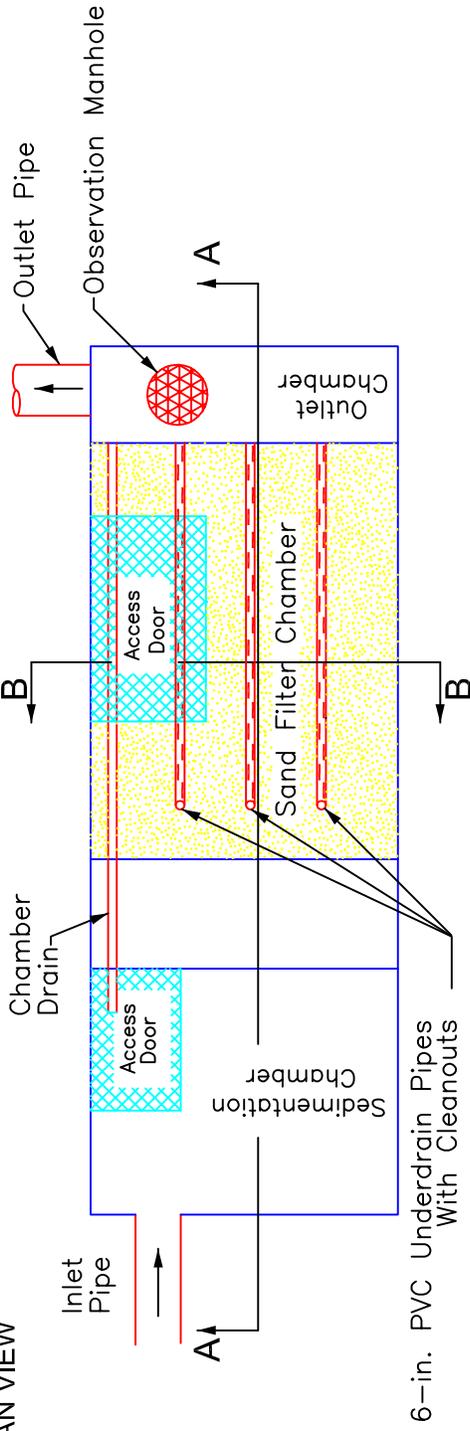


6-in. PVC Underdrain Pipes With Cleanouts

**SECTION A-A**

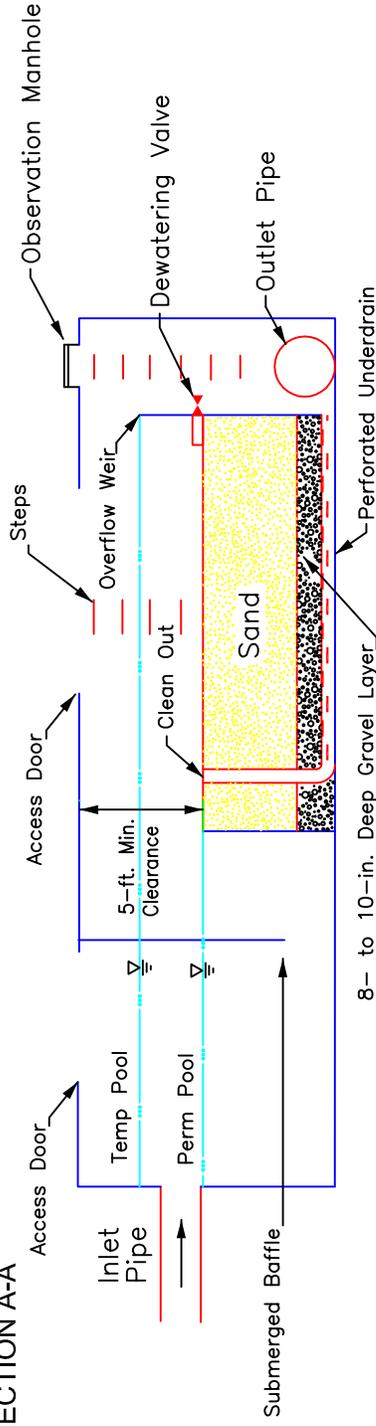

8- to 10-in. Deep Gravel Layer

**SECTION B-B**

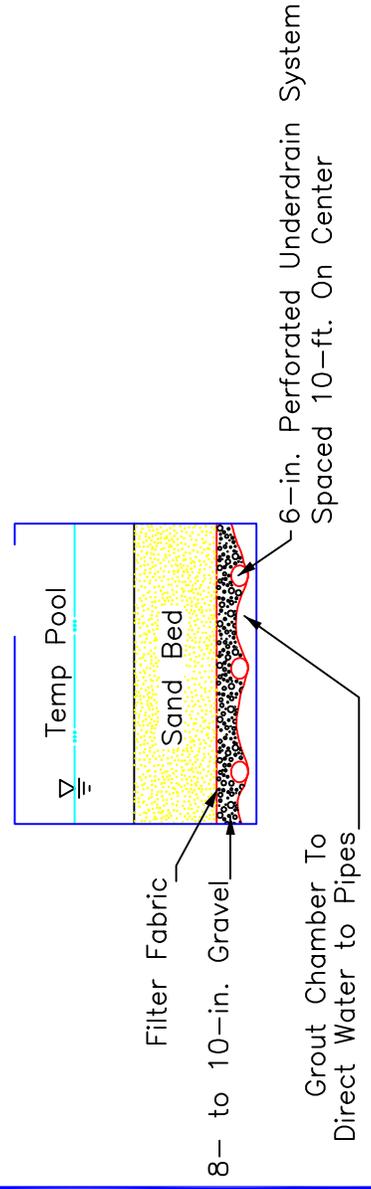

**South Carolina Department of Health and Environmental Control**

**UNDERGROUND SAND FILTER (DC FILTER)**

STANDARD DRAWING NO. **WQ-6** Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: **AUGUST, 2005**

SCDHEC

## SAND FILTERS

### When and Where to Use It

Sand filtration facilities are most applicable for smaller sites of 5 acres or less where the percent imperviousness of the site is very high. Sand filters shall be used on sites where the drainage area to the facility will remain well stabilized after the construction phase to prevent excess sediment and debris from permanently clogging the filter.

It is recommended that individual sand filters be sized to treat relatively small drainage area of 1 to 2 acres. The implementation of several filters on the site will prevent the entire site from being untreated if one of the filter facilities becomes clogged, requiring maintenance.

### Installation:

A 5-foot minimum clearance height shall be provided between the top of the sand bed and the bottom of the concrete slab to provide clearance for maintenance. A de-watering valve shall be placed just above the sand bed layer to drain the facility in situation where the sand filter becomes clogged and requires maintenance.

An under drain system shall be used to collect the runoff water that has percolated through the sand filter. The pipe shall be 6-inch perforated schedule 40 PVC piping placed in a 8- to 10-inch deep gravel jacket. A permeable geotextile filter fabric layer shall be placed between the sand and the gravel. To ensure adequate drainage, the bottom chamber shall be sloped towards the under drain pipes that shall be spaced 10-foot apart along the filter bed. The under drain system may discharge to the main storm sewer system or may outfall to an outlet chamber.

### Inspection and Maintenance:

Regular inspection and maintenance is critical to the effective operation of sand filter facilities as designed. Maintenance responsibility for the sand filter shall be vested with a responsible authority by means of a legally binding and enforceable maintenance agreement that is executed as a condition of plan approval. Typical maintenance responsibilities include clearing debris and trash from all inlet and outlet structures monthly, removing trash and debris from the sediment chamber monthly, and removing all sediment from the sediment chamber annually.

A record shall be kept of the average de-watering time of the sand filter facility to determine if maintenance is required. When the filtering capacity of the sand has diminished, the top layers of the sand (2- to 3-inches) shall be removed and replaced. This typically will need to be done every 3- to 5-years.



South Carolina Department of  
Health and Environmental Control

UNDERGROUND SAND FILTER (DC FILTER)

STANDARD DRAWING NO. WQ-6 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005

SCDHEC

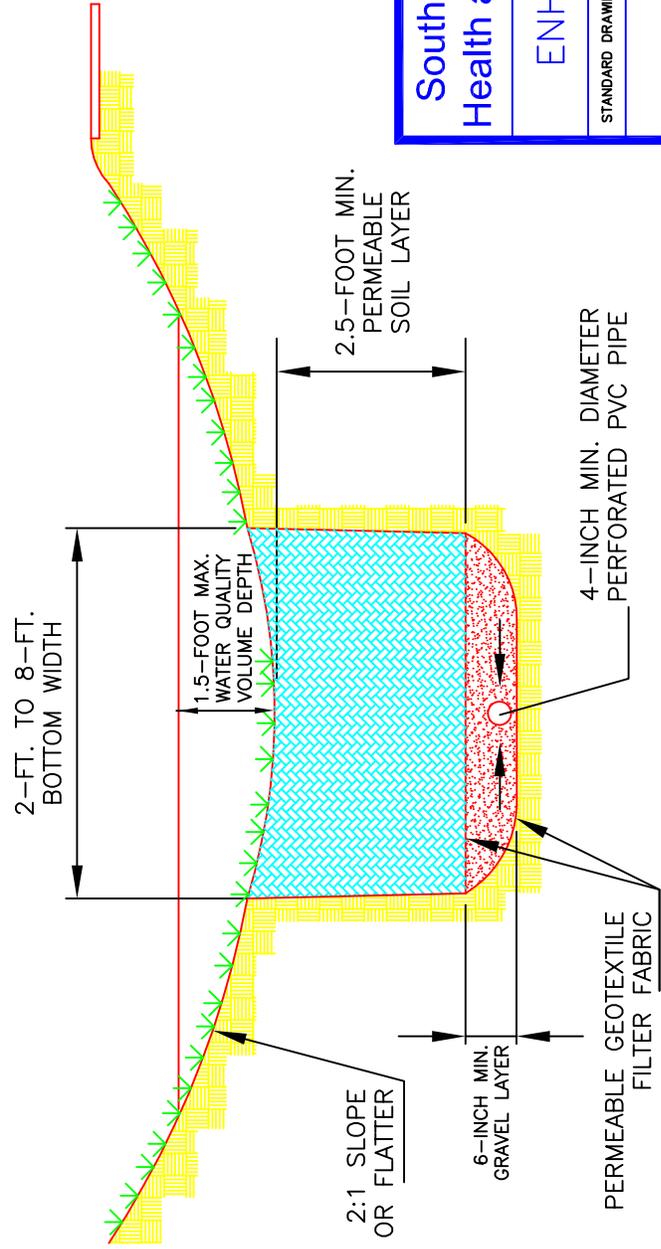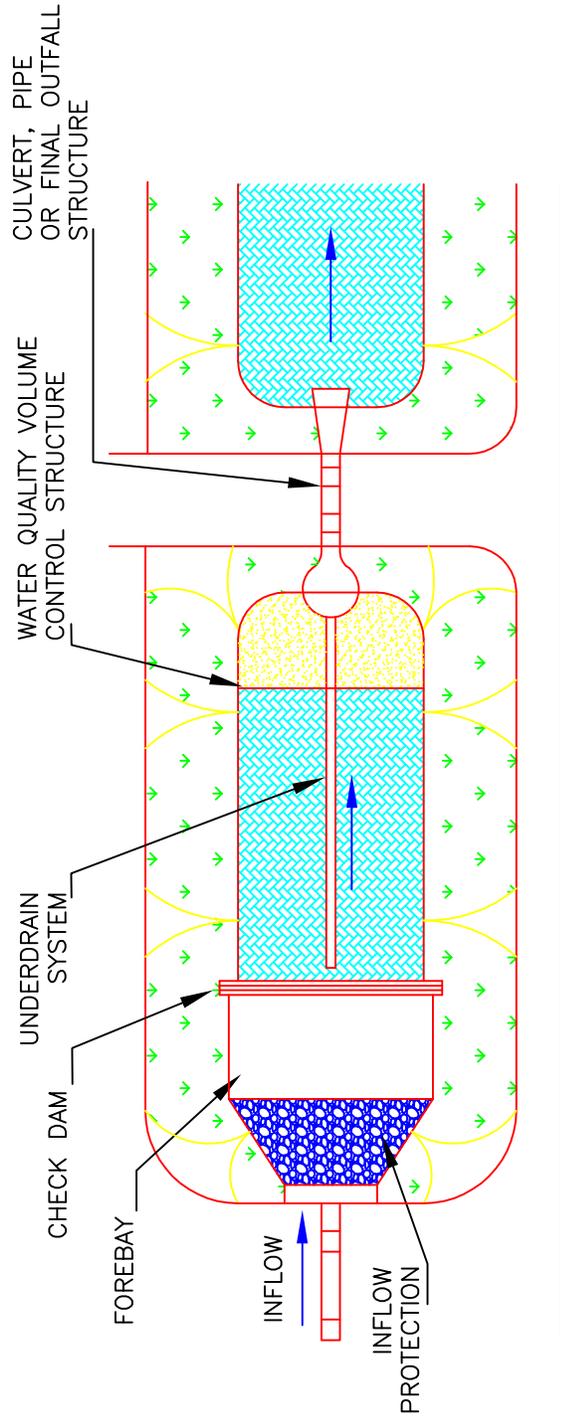

South Carolina Department of  
Health and Environmental Control

ENHANCED DRY SWALE

STANDARD DRAWING NO. WQ-07 Page 1 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC \_\_\_\_\_

## ENHANCED DRY SWALE

### Installation:

Swale slopes should be limited between 1 and 2 %, unless site topography dictates larger slopes. In this instance, drop structures may be placed in the swale to limit the slope of a particular section of the swale. Spacing between drop structures should be a minimum of 50–feet and energy dissipation techniques may need to be added on the downstream side of the drop structures.

The overall depth of the water quality runoff volume detained in the channel shall not exceed 1.5–feet.

The bottom width of the swale should range between 2– and 8–feet where applicable to ensure an adequate filtration area

The side slopes of the swale shall not exceed 2H:1V, and 4H:1V is recommended for ease of maintenance and for side inflow to remain as sheet flow.

The filter bed for an enhanced dry swale shall consist of a permeable soil layer at least 2.5–feet deep. The drainage pipe shall be a minimum 4–inch diameter perforated PVC pipe (AASHTO M 252) in a 6–inch gravel layer.

### Inspection and Maintenance:


The surface of the filter bed may become clogged with fine sediments over time. Light core aeration may be required to ensure adequate filtration. Other required maintenance includes but is not limited to periodic mowing to maintain the storage volume and to maintain appearance, and the periodic removal of trash and debris as needed.

South Carolina Department of  
Health and Environmental Control


ENHANCED DRY SWALE

STANDARD DRAWING NO. WQ-07 Page 2 of 2

APPROVED BY: \_\_\_\_\_ DATE: AUGUST, 2005  
SCDHEC

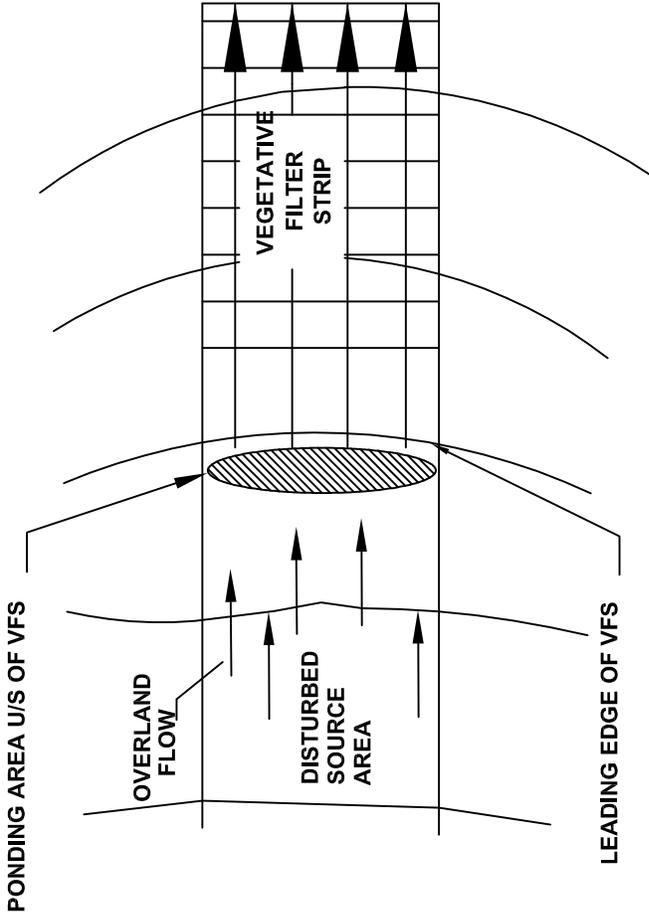

PLAN VIEW

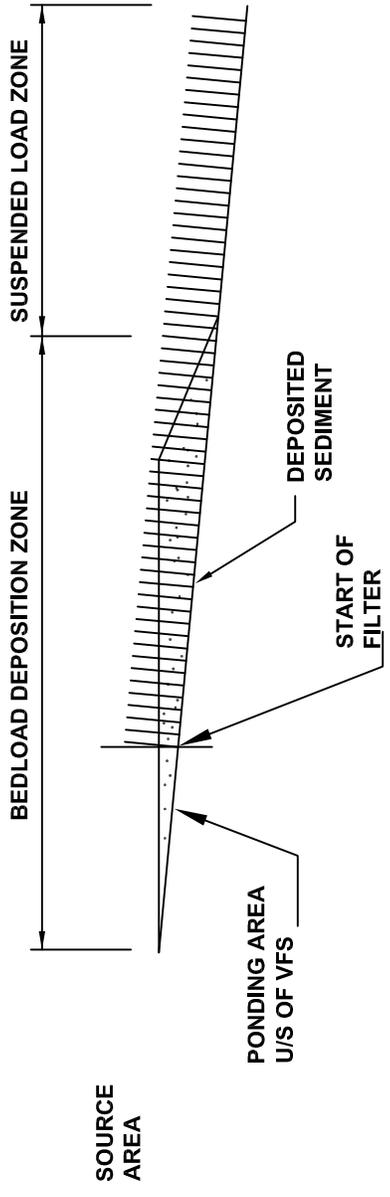

PROFILE VIEW

**SCHEMATIC OF A TYPICAL VEGETATIVE FILTER STRIP**

South Carolina Department of  
Health and Environmental Control

VEGETATED FILTER STRIP

STANDARD DRAWING NO. WQ-08 Page 1

APPROVED BY: \_\_\_\_\_ SCDHEC \_\_\_\_\_ DATE: AUGUST, 2005